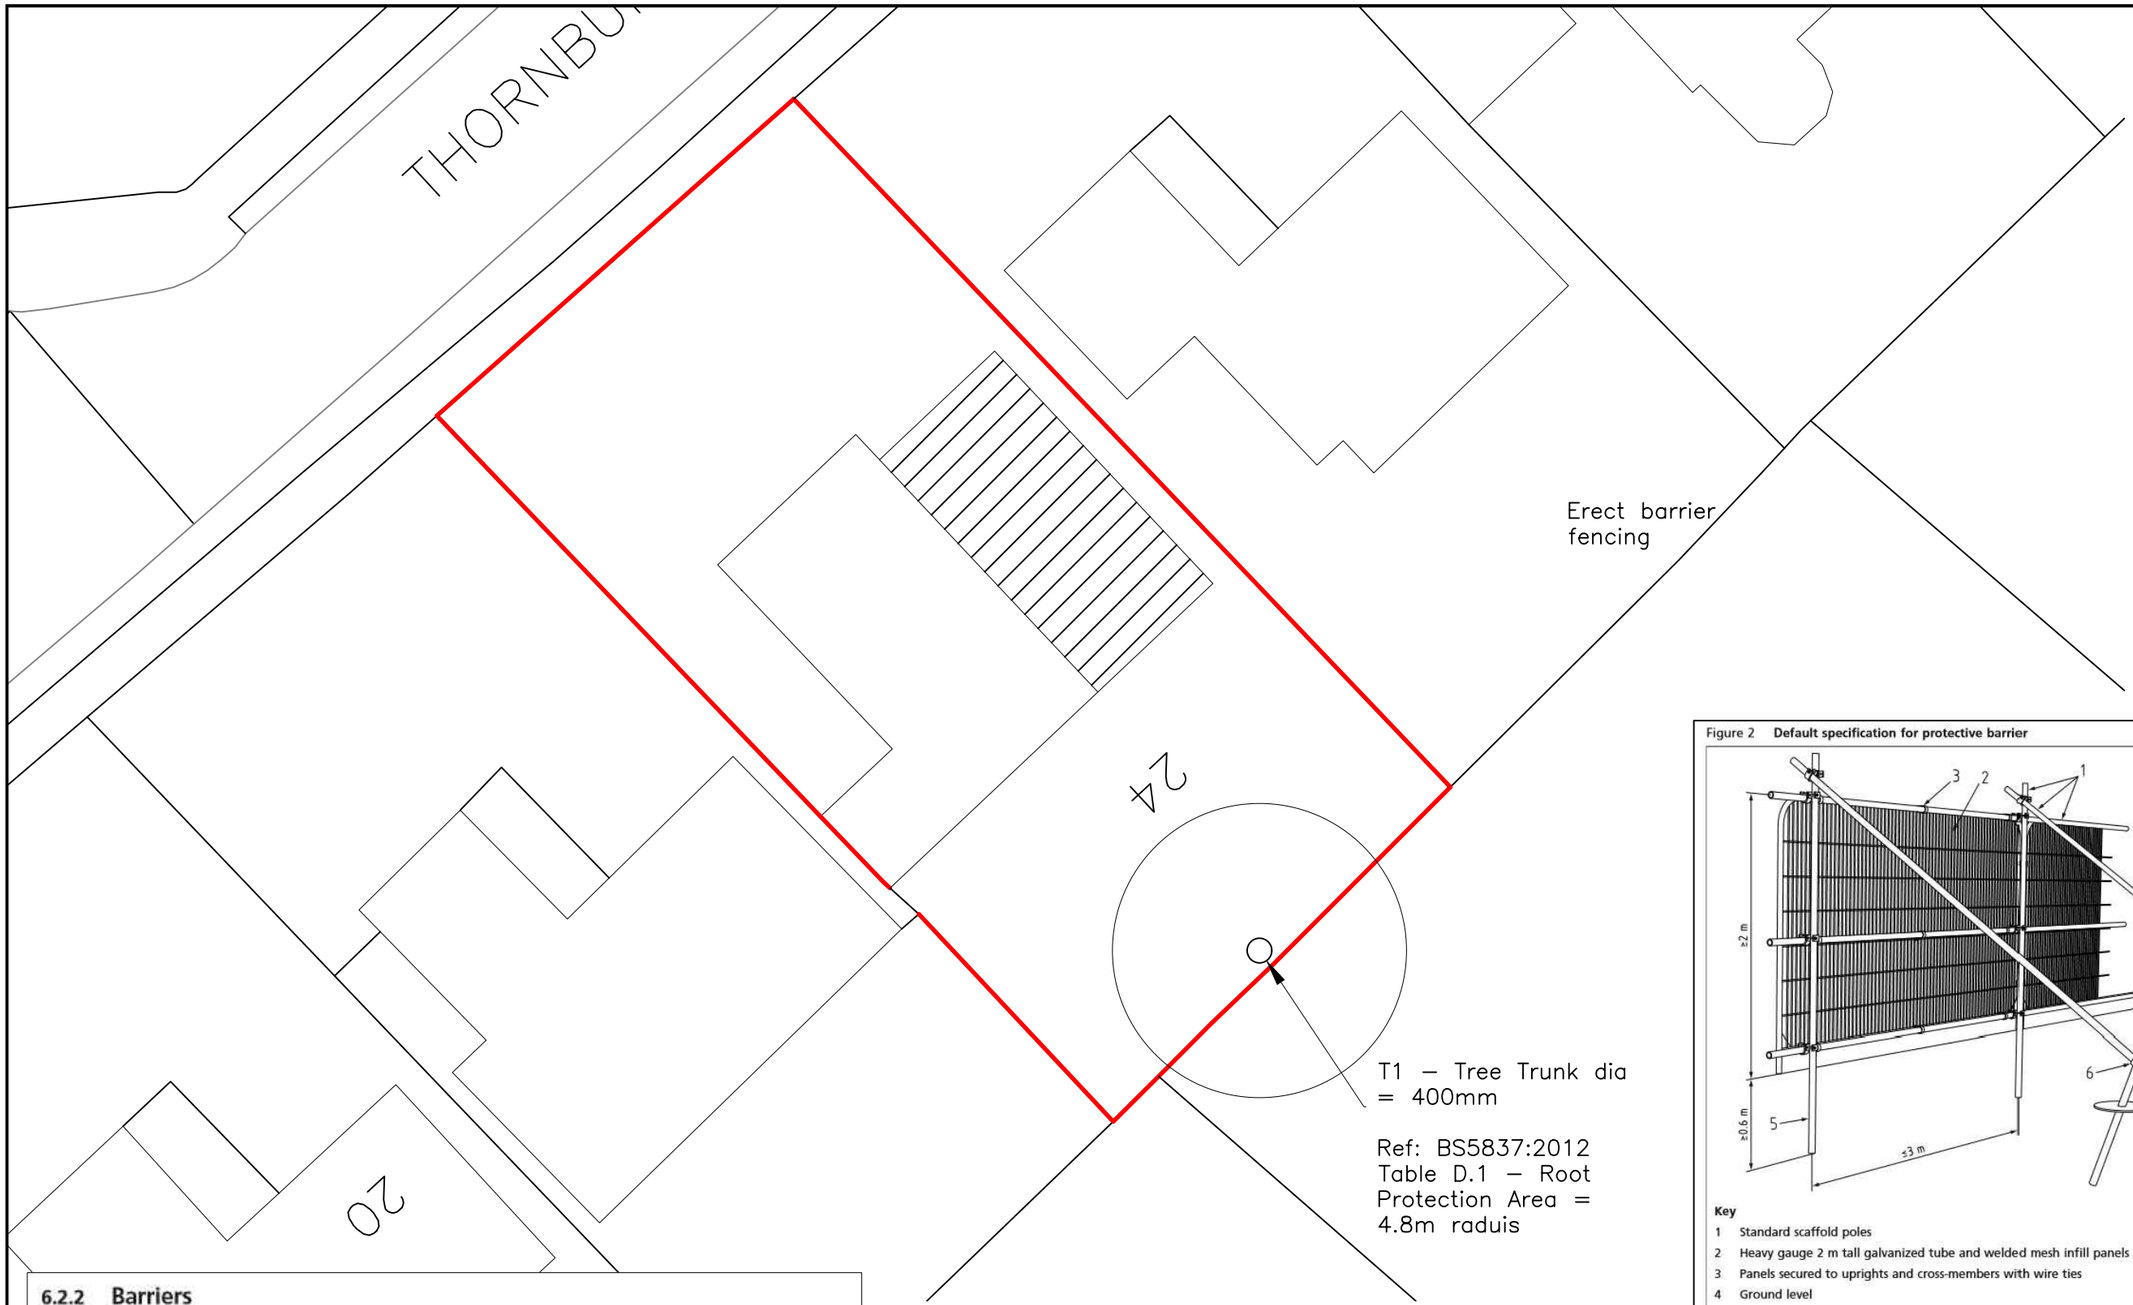


Figure 2 **Default specification for protective barrier**

Key

1 Standard scaffold poles
2 Heavy gauge 2 m tall galvanized tube and welded mesh infill panels
3 Panels secured to uprights and cross-members with wire ties
4 Ground level
5 Uprights driven into the ground until secure (minimum depth 0.6 m)
6 Standard scaffold clamps

6.2.2 Barriers

6.2.2.1 Barriers should be fit for the purpose of excluding construction activity and appropriate to the degree and proximity of work taking place around the retained tree(s). Barriers should be maintained to ensure that they remain rigid and complete.

6.2.2.2 The default specification should consist of a vertical and horizontal scaffold framework, well braced to resist impacts, as illustrated in Figure 2. The vertical tubes should be spaced at a maximum interval of 3 m and driven securely into the ground. Onto this framework, welded mesh panels should be securely fixed. Care should be exercised when locating the vertical poles to avoid underground services and, in the case of the bracing poles, also to avoid contact with structural roots. If the presence of underground services precludes the use of driven poles, an alternative specification should be prepared in conjunction with the project arboriculturist that provides an equal level of protection. Such alternatives could include the attachment of the panels to a free-standing scaffold support framework.

NOTE:

Barrier to be erected before any work starts on–site and remain in place until works completion

© Copyright - WildCry Technical Services 2017

A3

WildCry Technical Services
1 Bealing Close
Southampton
SO16 3AW

SCHEME TITLE
24 Thornbury Wood
Chandlers Ford

DRAWING TITLE
Tree Protection

PROJECT NO.

SCALE
1:200

DRAWING NUMBER
Thorn003

CREATED
MAH

DATE
Jan 2017

CHECKED

APPROVED

REVISION
REV