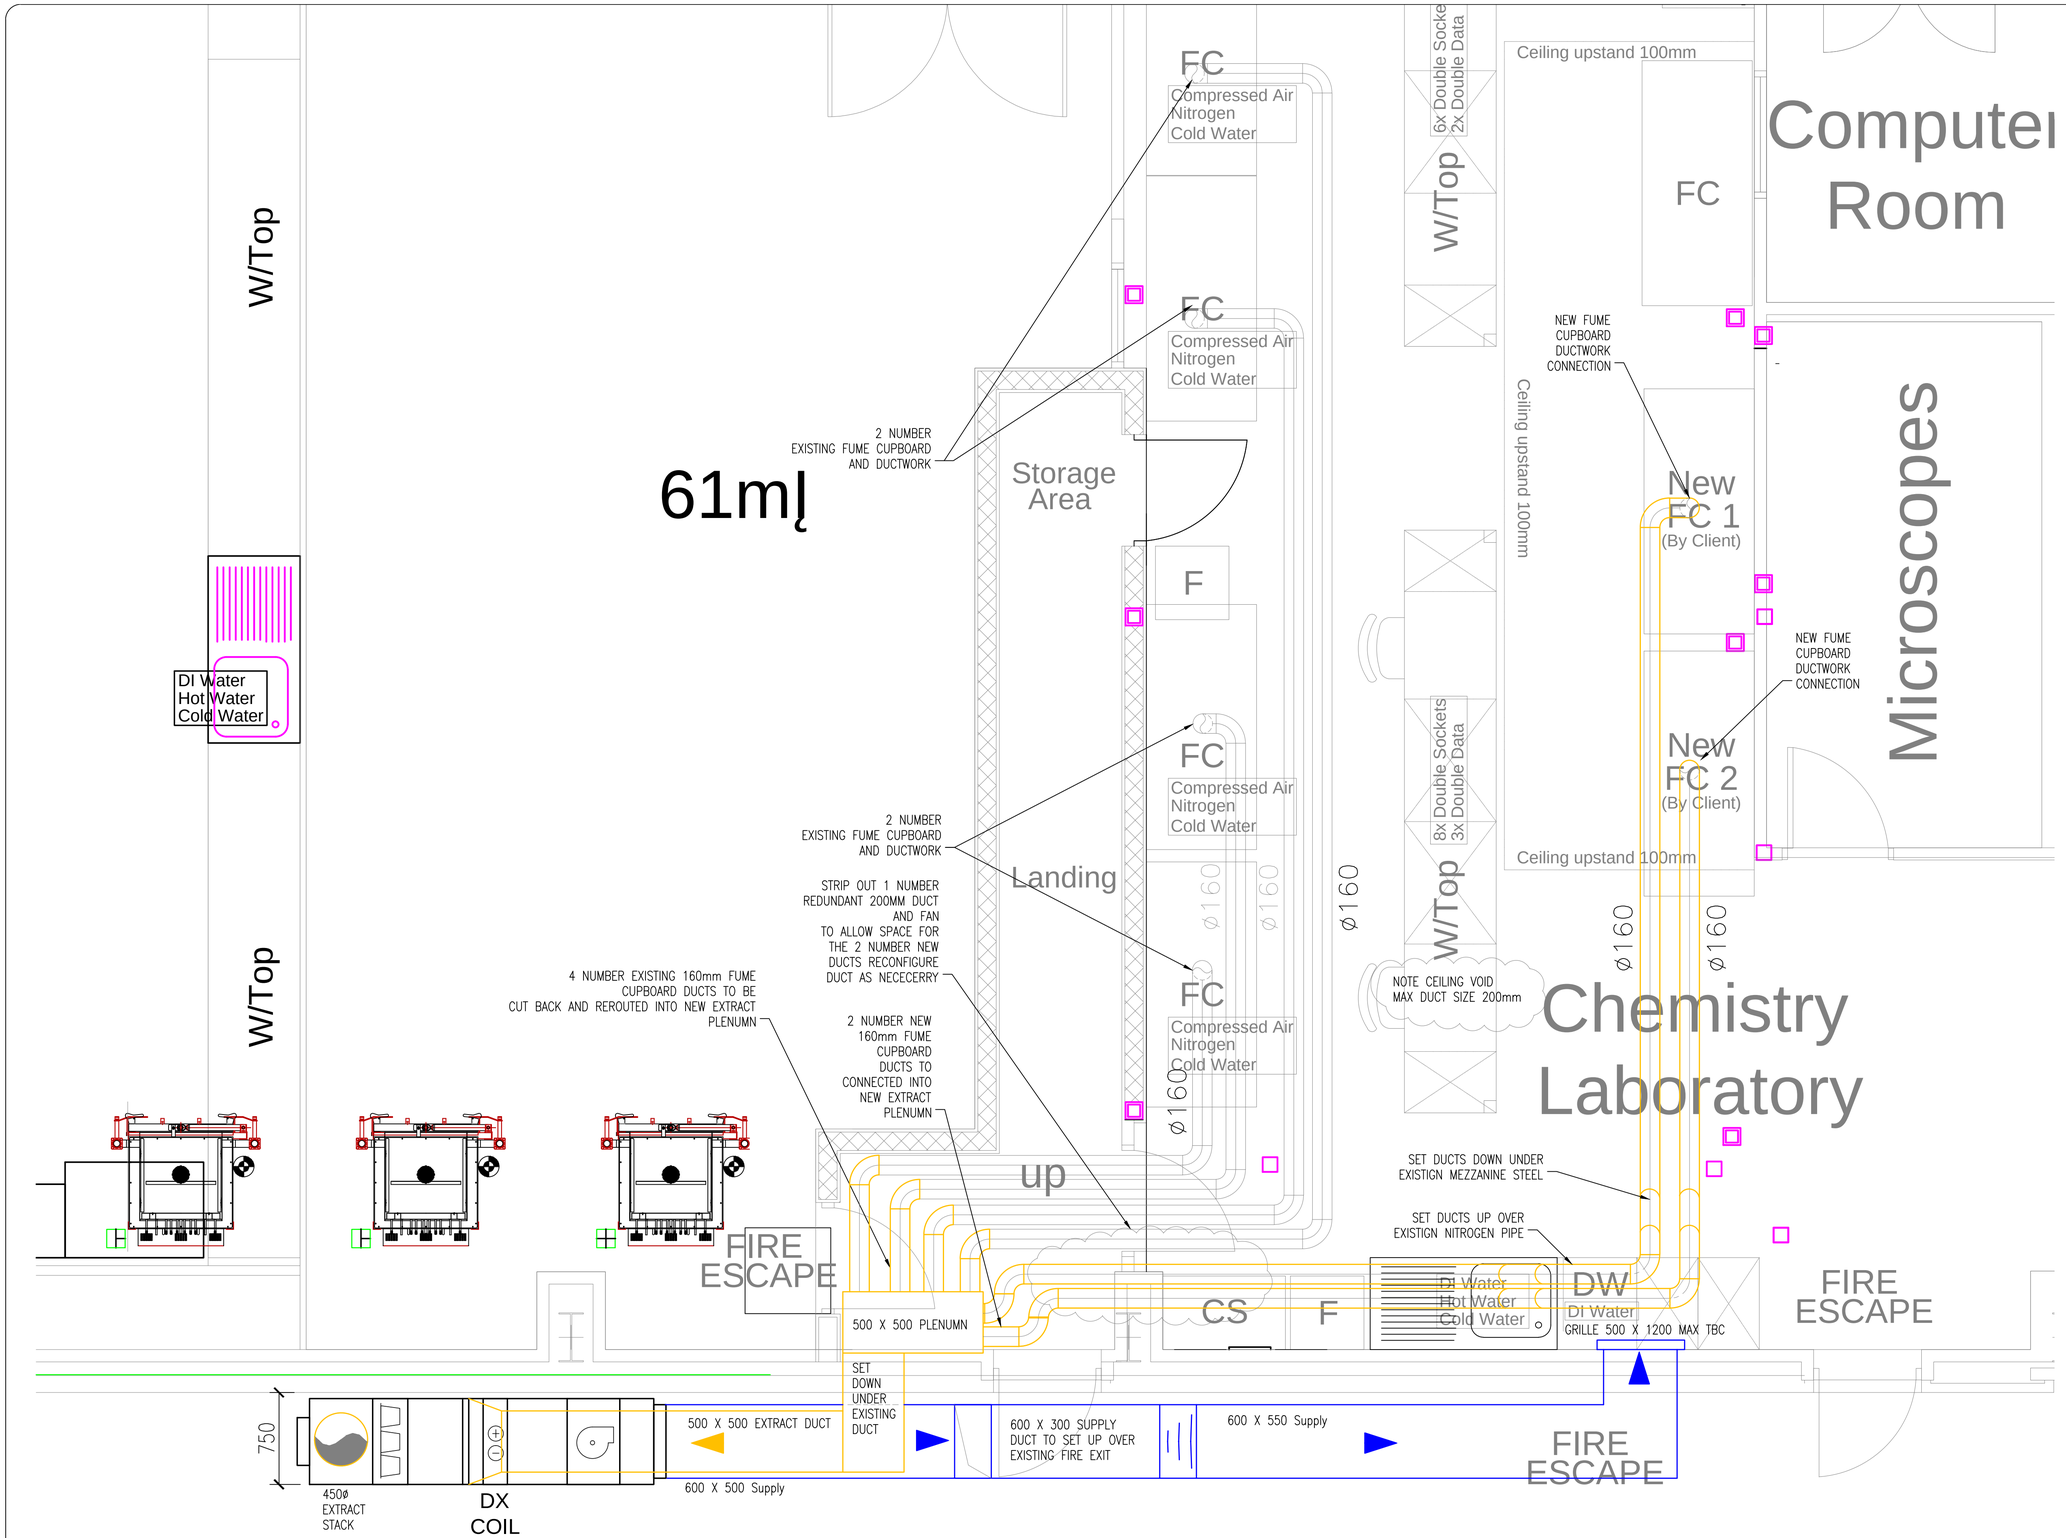


Key

VOL	VEL
DUCT1	ID

- Cleanroom Classified supply air duct galvanized steel
- Cleanroom Classified recirc air duct galvanized steel
- New Extract air duct galvanized steel
- Existing fresh air duct to remain (modifications shown in clouded areas)

- 3210 HEIGHT FFL TO CENTRE LINE OF CIRCULAR DUCT AND UNDER SIDE OF RECTANGULAR DUCT
- 2500 DUCT SIZE
- CLEANROOM HEPA FILTER
- CEILING EXTRACT AIR GRILLE (NO DUCT EXTRACT AIR TO CEILING VOID)
- PERFORATED SUPPLY DIFFUSERS
- SWIRL SUPPLY DIFFUSERS
- LOW LEVEL WALL EXTRACT AIR GRILLE
- FD FIRE DAMPER FUSIBLE LINK TYPE OR INTUMESCENT CRUSH TYPE COLLAR ON UPVC PLASTIC DUCT WORK
- VCD VOLUME CONTROL DAMPERS
- EG XXX EXTRACT GRILLE REF
- EGLL XXX EXTRACT GRILLE LOW LEVEL REF
- SG XXX SUPPLY GRILLE REF
- SGF XXX SUPPLY GRILLE FILTERED REF
- I XXX ISOLATOR REF
- MBSC XXX MICRO BIOLOGICAL SAFETY CABINET CLASS 2 REF
- FTG XXX FIRE TRANSFER GRILLE
- PTG XXX PRESSURE TRANSFER GRILLE

Issue	Appr'd	Date	Revisions	Issue	Appr'd	Date	Revisions

enbloc
clean facilities
enbloc limited
Unit 2, Pale lane, Hartley Wintney,
Hook, Hampshire, RG27 8DH
Tel : 01252 626229 Fax : 01252 629375

CAD Filename:	1905-M-001			A1
Drawn: N.J.P.	Chkd: BM	App: BM		
Date: 12.05.15	Scale: 1.100 @ A1			

THIS DRAWING WAS PRODUCED BY AutoCAD – DO NOT CHANGE MANUALLY
THIS DRAWING IS PRIVATE AND CONFIDENTIAL AND IS THE PROPERTY OF ENBLOC LTD. IT MUST NOT BE COPIED OR LENT WITHOUT THE CONSENT OF ENBLOC LTD. AND MUST BE RETURNED WITH TENDER AND/OR ON COMPLETION OF ORDER.

Client Name:

Coopervision

Project Title:

Lab Fume cupboard and ductwork modifications

Drawing Title:

Fume cupboard ductwork modifications

Drg. No:	Rev:
1905-M-001	0