


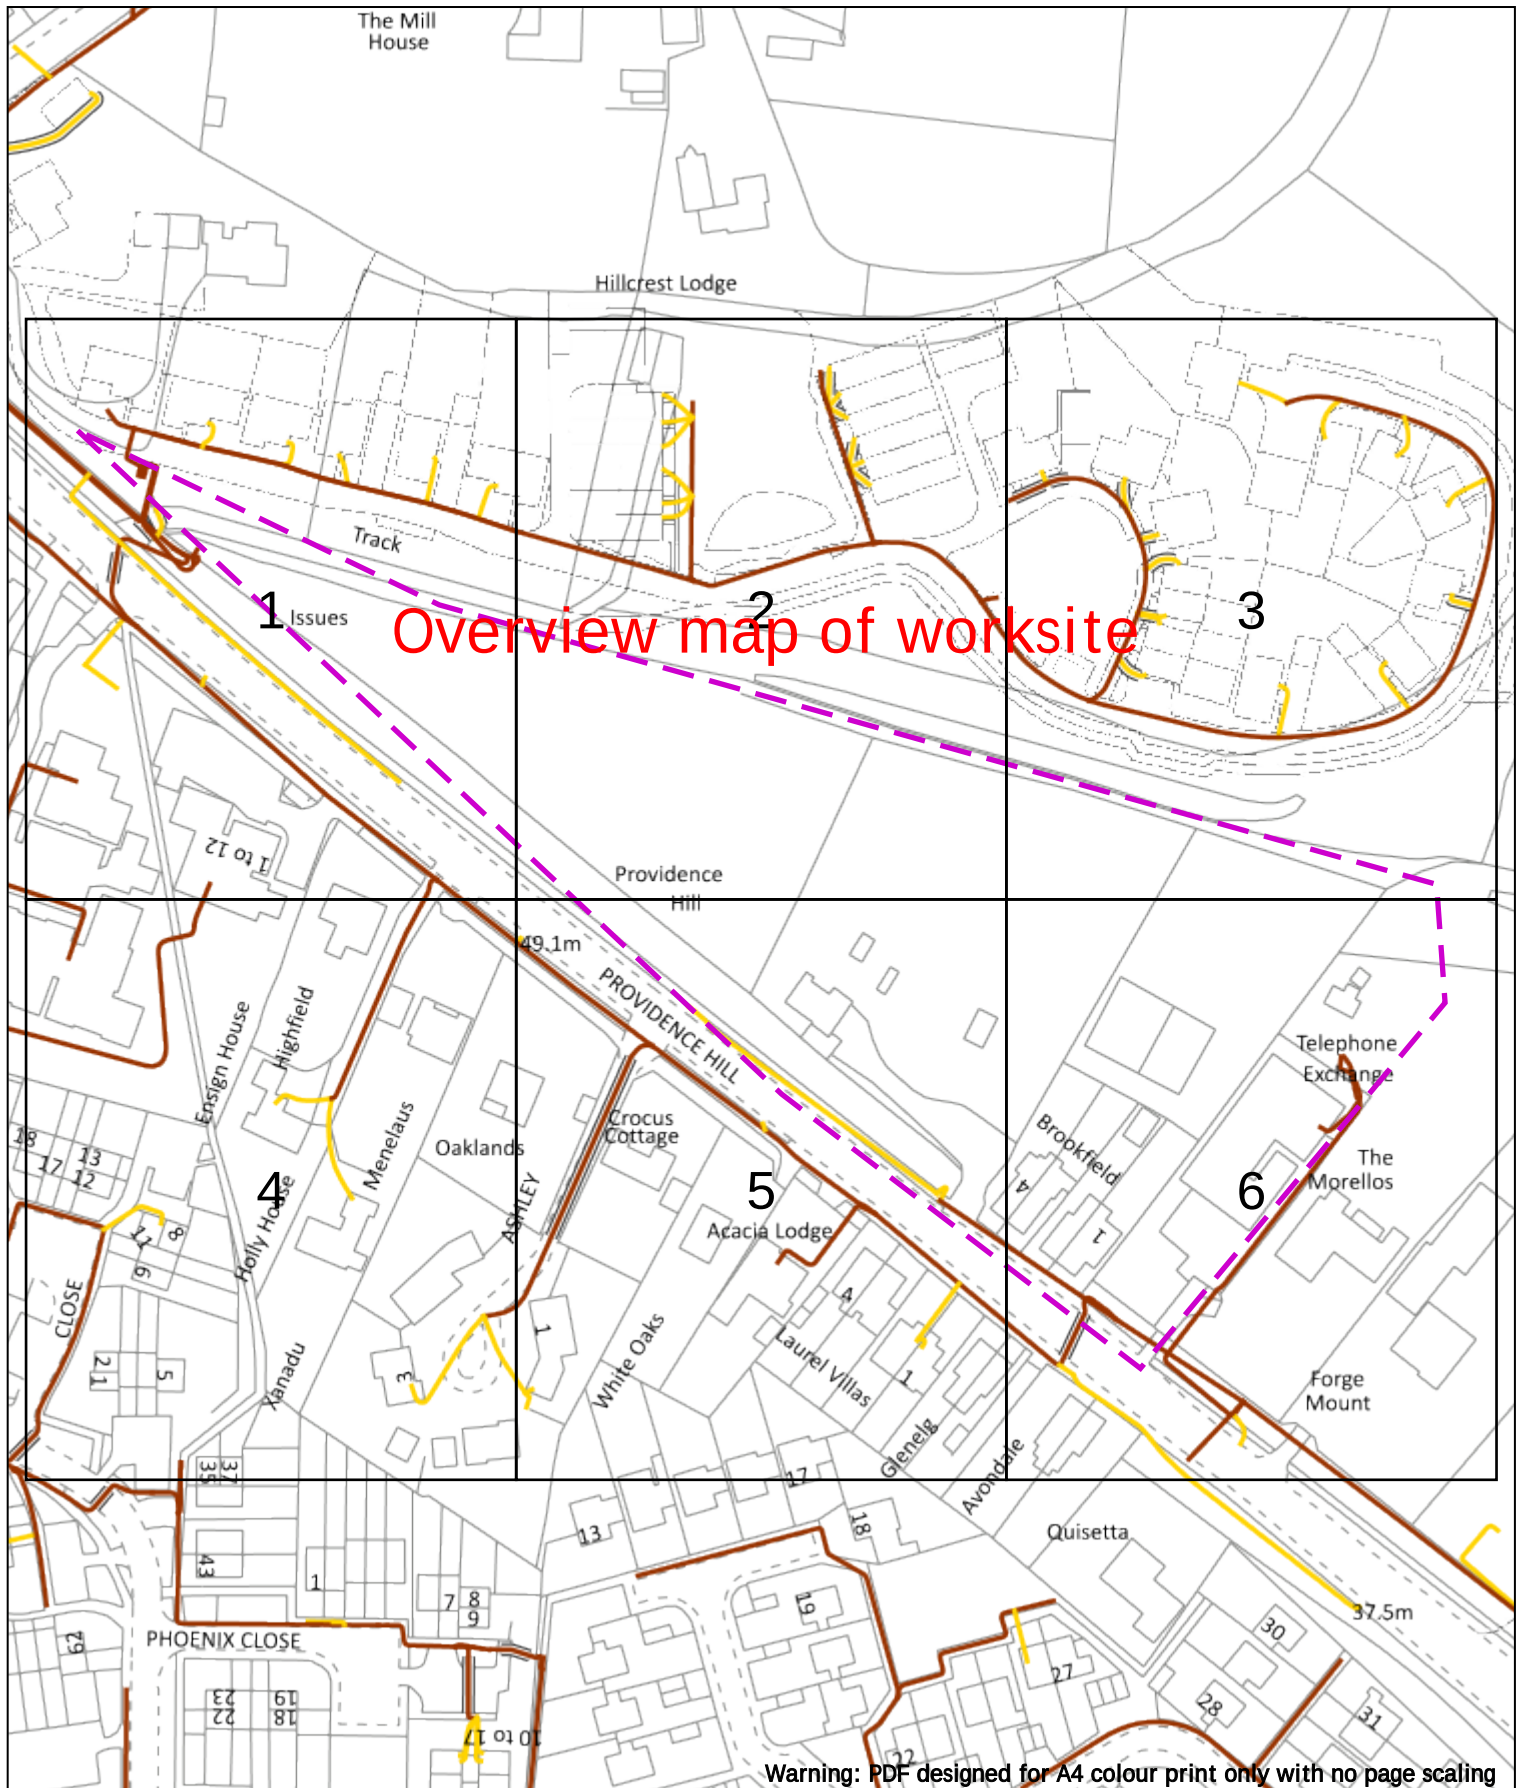

Dig Sites Area:  Line: 

Date Requested: 05/07/2022
Job Reference: 26170679
Site Location: 448347 110613
Requested by: Mr Nick Claydon

Your Scheme/Reference: F/22/93160

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

Legend	
	Service Cable
	LV Mains
	2-3.3kV
	6.6kV
	11kV
	22kV
	33kV
	66kV
	132kV
	275kV
	400kV
	Fibre Optic
	Pilot Cable

Distribution Structures (Electric)	
	Pole, Existing Location
	Pole Structure, Existing Location - Single
	Pole Structure, Existing Location - H
	Duct Route
	Cross Section Route




Southern Electric Power Distribution plc
Registered Office: No.1 Forbury Place
43 Forbury Road Reading RG1 3JH
Registered In England & Wales No.04094290

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516


Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
01256 337 294

Scale: 1:1537 (When plotted at A4)

WARNING
There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.
WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES G56 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

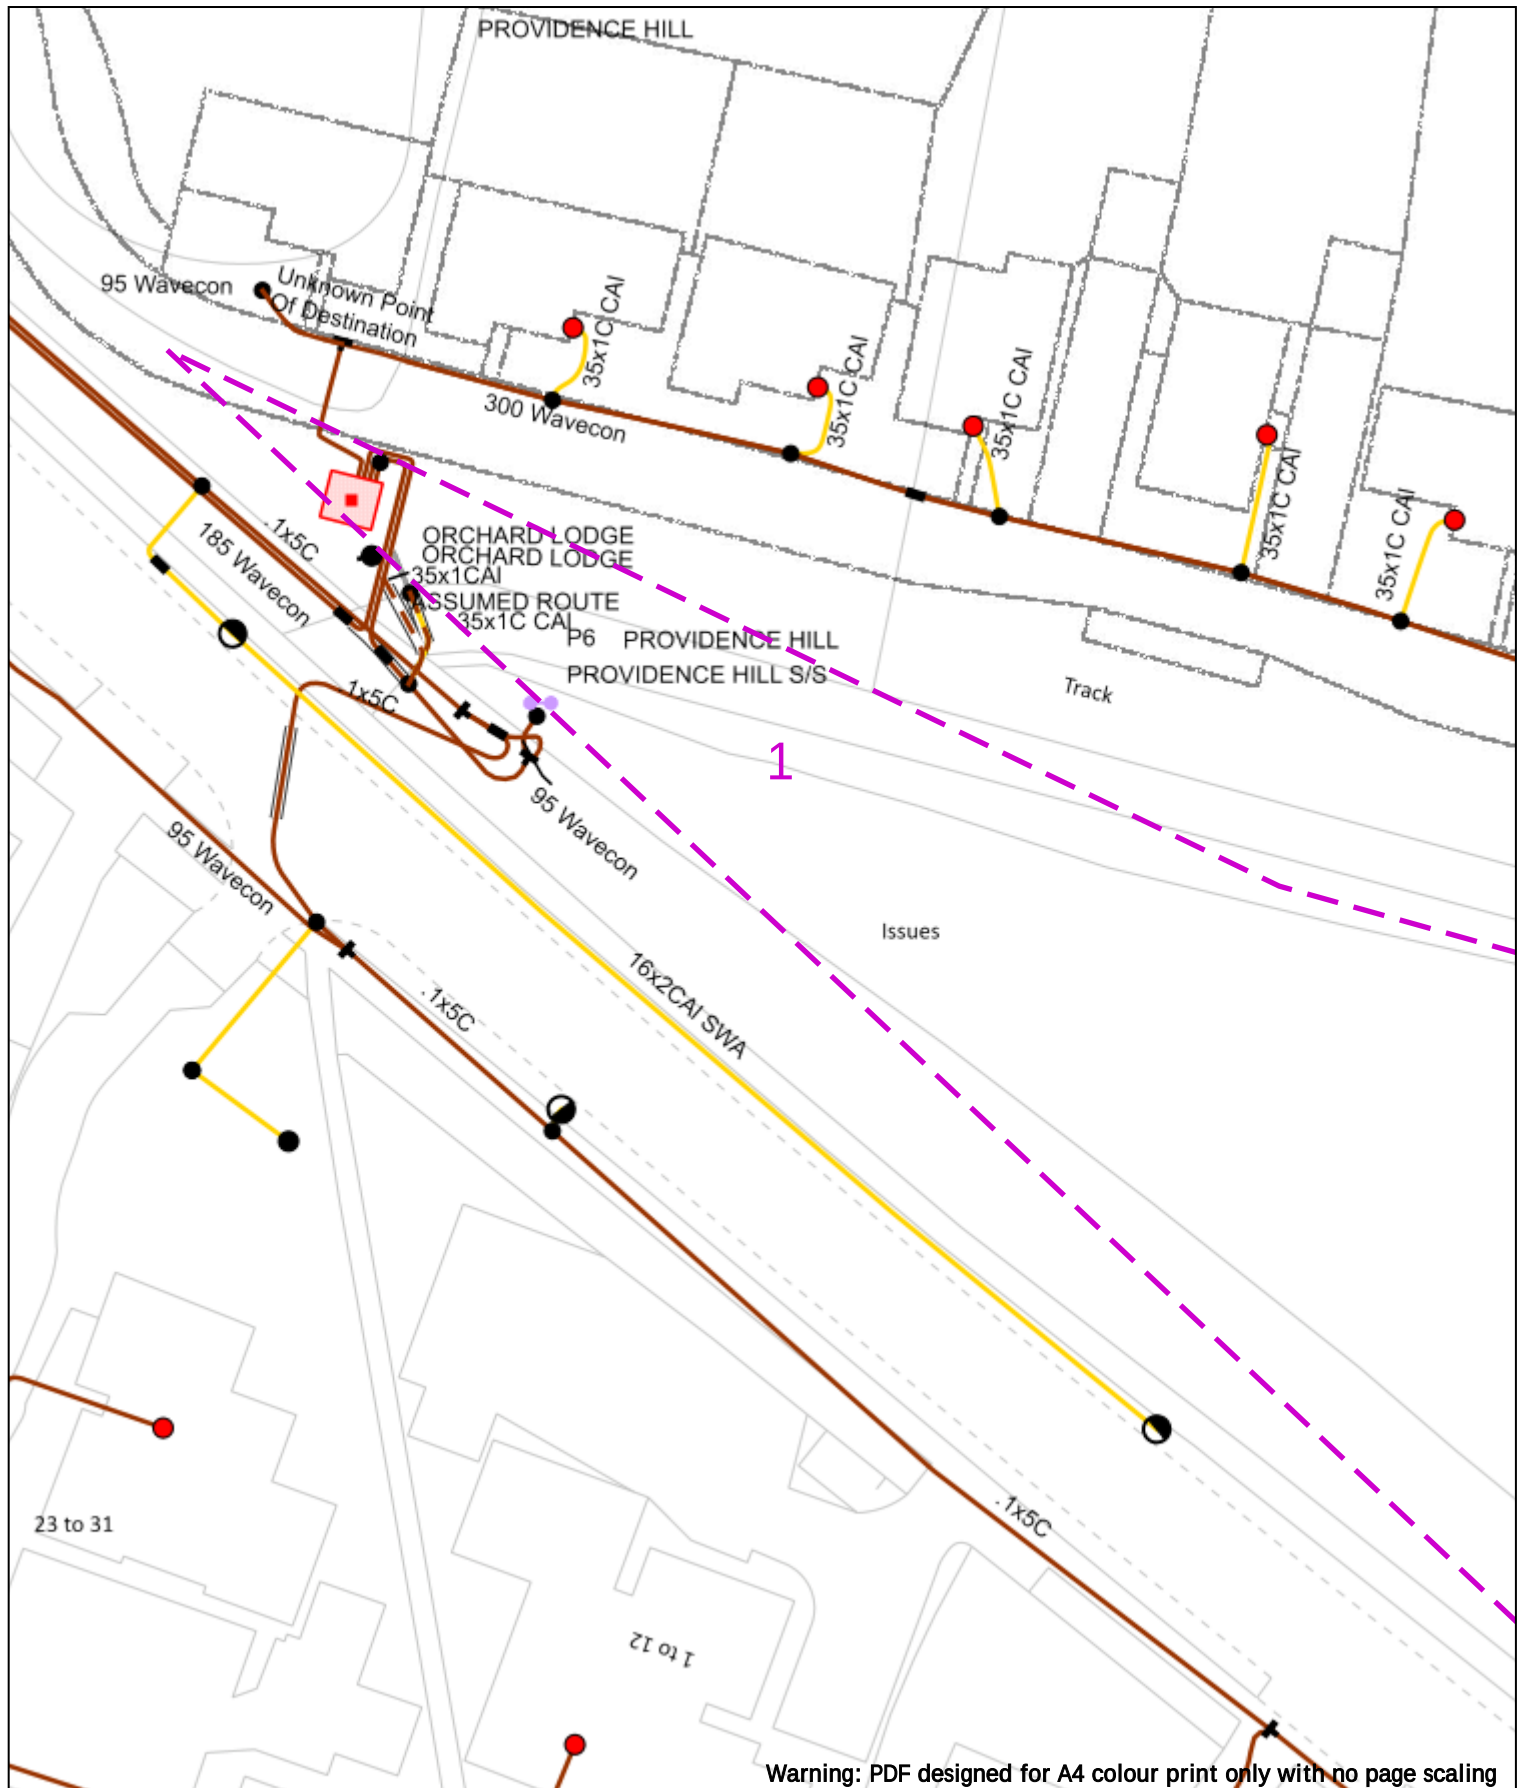

0  20m Dig Sites Area:  Line: 		 																																																																												
Date Requested: 05/07/2022 Job Reference: 26170679 Site Location: 448347 110613 Requested by: Mr Nick Claydon Your Scheme/Reference: F/22/93160		<table><tr><th colspan="2">Volts (V)</th></tr><tr><td>LV (Low Voltage) and Services</td><td>Up to 1,000V</td></tr><tr><td>HV (High Voltage)</td><td>Over 1,000V to 11,000V</td></tr><tr><td>EHV (Extra High Voltage)</td><td>22,000V to 132,000V</td></tr><tr><td>Transmission</td><td>275,000V and 400,000V</td></tr></table> <table><tr><th colspan="5">NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID</th></tr><tr><td>Services</td><td>LV</td><td>HV</td><td>EHV</td><td></td></tr><tr><td>Footpath/Unmade</td><td>0.45m</td><td>0.45m</td><td>0.6m</td><td>0.8m</td></tr><tr><td>Road Crossing</td><td>0.6m</td><td>0.6m</td><td>0.75m</td><td>0.9m</td></tr><tr><td>Agricultural</td><td>1m</td><td>1m</td><td>1m</td><td>1.1m</td></tr></table>	Volts (V)		LV (Low Voltage) and Services	Up to 1,000V	HV (High Voltage)	Over 1,000V to 11,000V	EHV (Extra High Voltage)	22,000V to 132,000V	Transmission	275,000V and 400,000V	NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID					Services	LV	HV	EHV		Footpath/Unmade	0.45m	0.45m	0.6m	0.8m	Road Crossing	0.6m	0.6m	0.75m	0.9m	Agricultural	1m	1m	1m	1.1m	<table><tr><th colspan="2">Legend</th></tr><tr><td></td><td>Service Cable</td></tr><tr><td></td><td>LV Mains</td></tr><tr><td></td><td>2 – 33kV</td></tr><tr><td></td><td>6.6kV</td></tr><tr><td></td><td>11kV</td></tr><tr><td></td><td>22kV</td></tr><tr><td></td><td>33kV</td></tr><tr><td></td><td>66kV</td></tr><tr><td></td><td>132kV</td></tr><tr><td></td><td>275kV</td></tr><tr><td></td><td>400kV</td></tr><tr><td></td><td>Fibre Optic</td></tr><tr><td></td><td>Pilot Cable</td></tr></table> <table><tr><th colspan="2">Distribution Structures (Electric)</th></tr><tr><td></td><td>Pole, Existing Location</td></tr><tr><td></td><td>Pole Structure, Existing Location - Single</td></tr><tr><td></td><td>Pole Structure, Existing Location - H</td></tr><tr><td></td><td>Duct Route</td></tr><tr><td></td><td>Cross Section Route</td></tr></table>	Legend			Service Cable		LV Mains		2 – 33kV		6.6kV		11kV		22kV		33kV		66kV		132kV		275kV		400kV		Fibre Optic		Pilot Cable	Distribution Structures (Electric)			Pole, Existing Location		Pole Structure, Existing Location - Single		Pole Structure, Existing Location - H		Duct Route		Cross Section Route
Volts (V)																																																																														
LV (Low Voltage) and Services	Up to 1,000V																																																																													
HV (High Voltage)	Over 1,000V to 11,000V																																																																													
EHV (Extra High Voltage)	22,000V to 132,000V																																																																													
Transmission	275,000V and 400,000V																																																																													
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID																																																																														
Services	LV	HV	EHV																																																																											
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m																																																																										
Road Crossing	0.6m	0.6m	0.75m	0.9m																																																																										
Agricultural	1m	1m	1m	1.1m																																																																										
Legend																																																																														
	Service Cable																																																																													
	LV Mains																																																																													
	2 – 33kV																																																																													
	6.6kV																																																																													
	11kV																																																																													
	22kV																																																																													
	33kV																																																																													
	66kV																																																																													
	132kV																																																																													
	275kV																																																																													
	400kV																																																																													
	Fibre Optic																																																																													
	Pilot Cable																																																																													
Distribution Structures (Electric)																																																																														
	Pole, Existing Location																																																																													
	Pole Structure, Existing Location - Single																																																																													
	Pole Structure, Existing Location - H																																																																													
	Duct Route																																																																													
	Cross Section Route																																																																													
Scale: 1:500 (When plotted at A4)		Southern Electric Power Distribution plc Registered Office: No.1 Forbury Place 43 Forbury Road Reading RG1 3JH Registered in England & Wales No.04094290 If you're unsure & need to seek advice before commencing excavations, please contact: General Enquiries: 0800 048 3516 Subject to revision – Master held by SSEN Asset Data Team: Asset.Data@sse.com 01256 337 294																																																																												
BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M STATIONERY OFFICE. CROWN COPYRIGHT RESERVED. This copy has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright, the copy must not be copied without prior permission of the copyright owner. Plans generated by DigSAFE Pro™ software provided by LineSearchBeforeDig.																																																																														

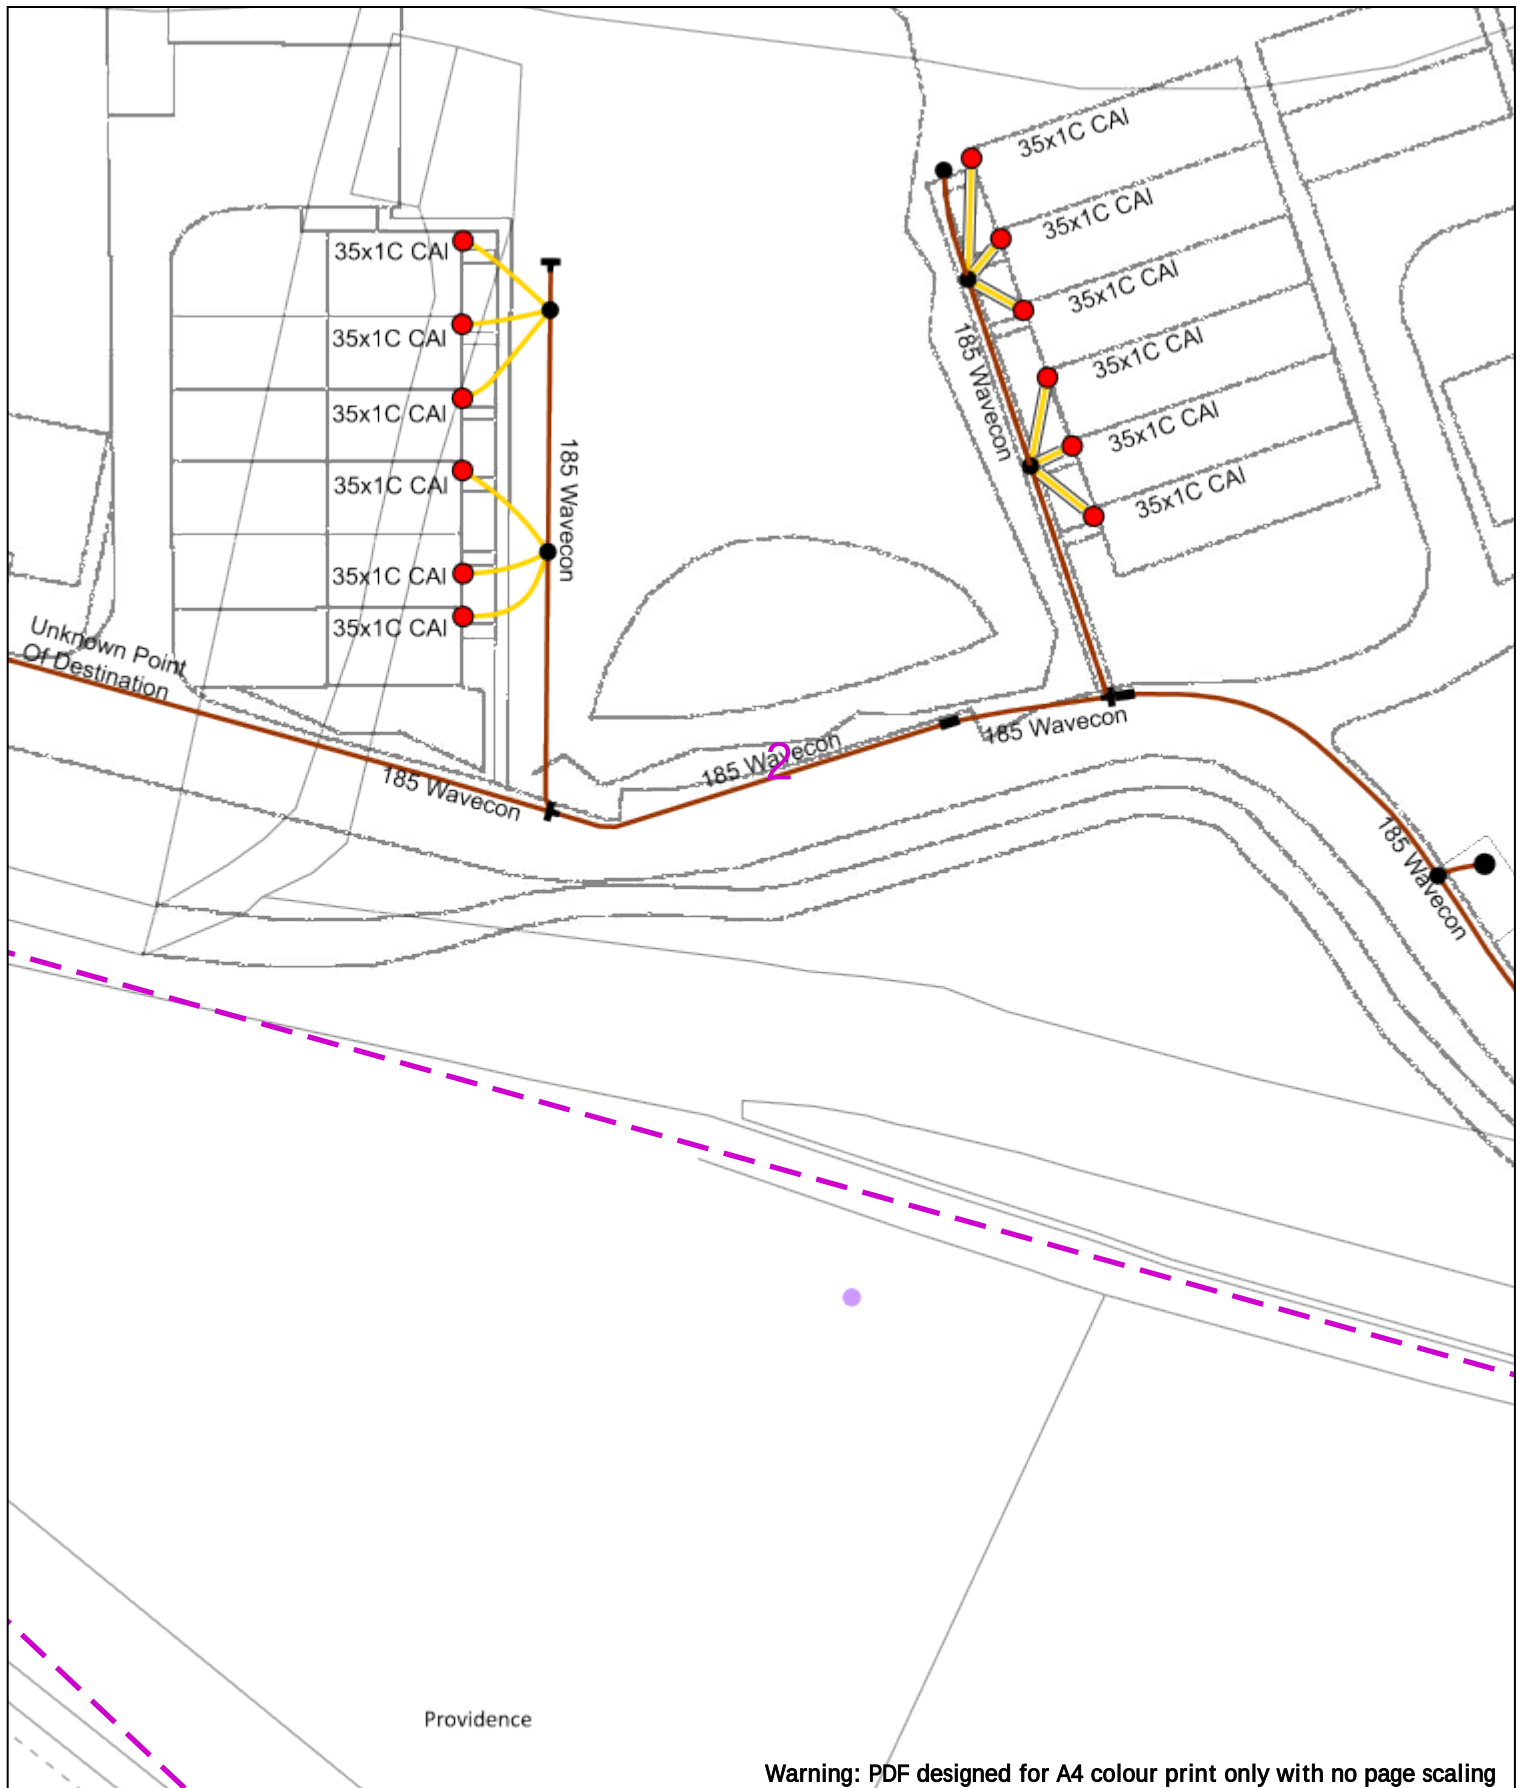

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Date Requested: 05/07/2022
Job Reference: 26170679
Site Location: 448347 110613
Requested by: Mr Nick Claydon

Your Scheme/Reference: F/22/93160

Scale: 1:500 (When plotted at A4)

Voltages (V)	
LV (Low Voltage) and Services	Up to 1,000V
HV (High Voltage)	Over 1,000V to 11,000V
EHV (Extra High Voltage)	22,000V to 132,000V
Transmission	275,000V and 400,000V
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID	
Services	LV HV EHV
Footpath/Unmade	0.45m 0.45m 0.6m 0.8m
Road Crossing	0.6m 0.6m 0.75m 0.9m
Agricultural	1m 1m 1m 1.1m

Legend	
Service Cable	
LV Mains	
2-33kV	
6.6kV	
11kV	
22kV	
33kV	
66kV	
132kV	
275kV	
400kV	
Fibre Optic	
Pilot Cable	

Distribution Structures (Electric)	
Pole, Existing Location	
Pole Structure, Existing Location - Single	
Pole Structure, Existing Location - H	
Duct Route	
Cross Section Route	

WARNING

There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work.


WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES G56 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)



Southern Electric Power Distribution plc
Registered Office: No.1 Forbury Place
43 Forbury Road Reading RG1 3JH
Registered In England & Wales No.04094290

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision - Master held by SSEN Asset Data Team:
Asset.Data@sse.com
01256 337 294

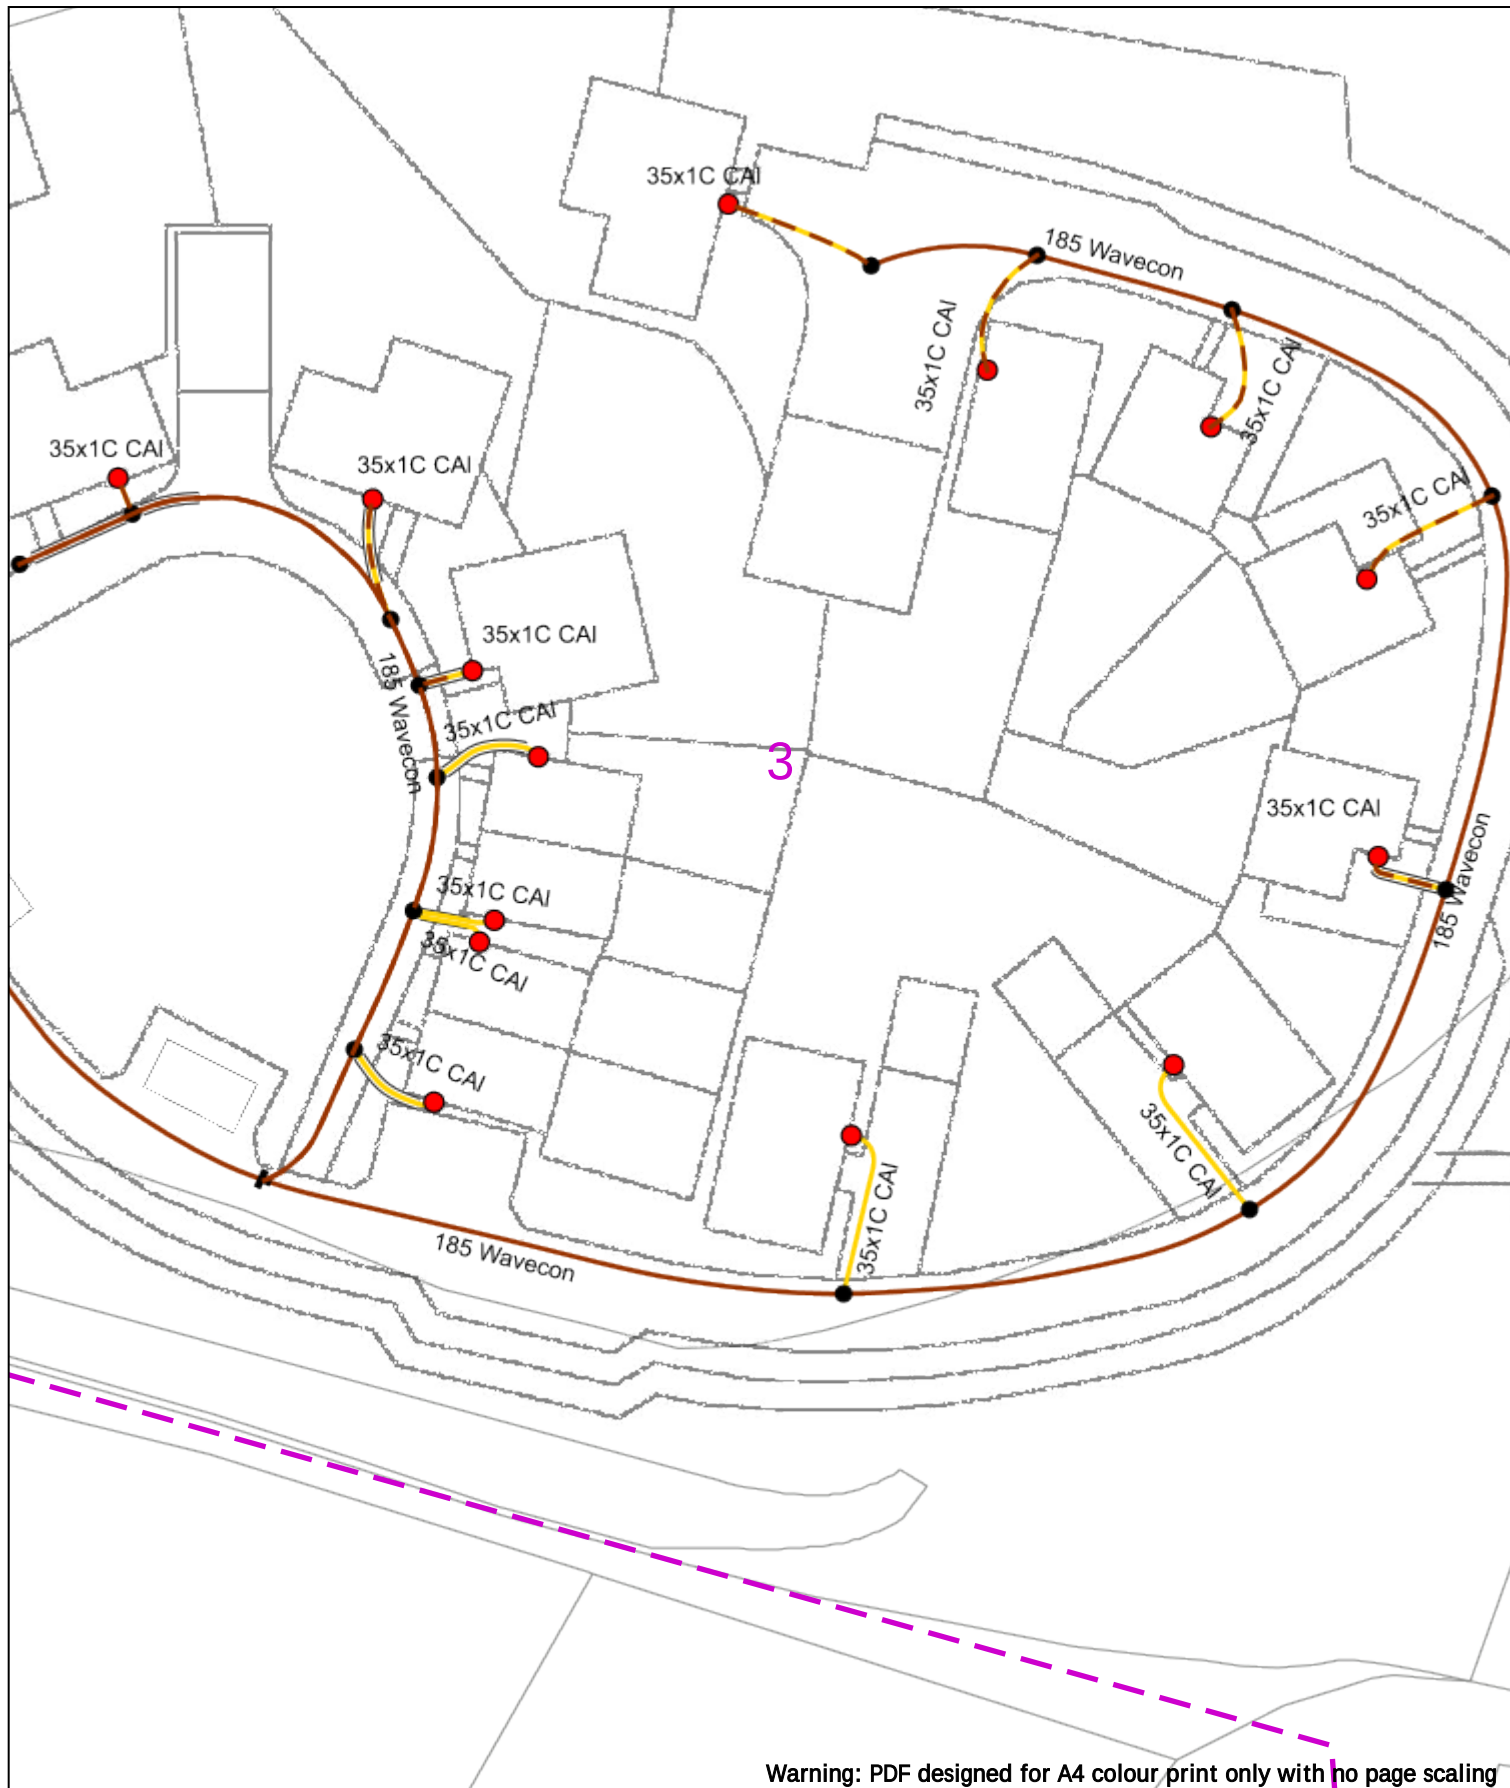

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line: ---

Date Requested: 05/07/2022
Job Reference: 26170679
Site Location: 448347 110613
Requested by: Mr Nick Claydon

Your Scheme/Reference: F/22/93160

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

Legend	
—	Service Cable
—	LV Mains
—	6.6kV
—	11kV
—	22kV
—	33kV
—	66kV
—	132kV
—	275kV
—	400kV
—	Fibre Optic
—	Pilot Cable

Distribution Structures (Electric)	
●	Pole, Existing Location
●	Pole Structure, Existing Location - Single
●	Pole Structure, Existing Location - H
—	Duct Route
—	Cross Section Route




Southern Electric Power Distribution plc
Registered Office: No.1 Forbury Place
43 Forbury Road Reading RG1 3JH
Registered In England & Wales No.04094290

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
01256 337 294

Scale: 1:500 (When plotted at A4)

WARNING
There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.
WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES G56 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

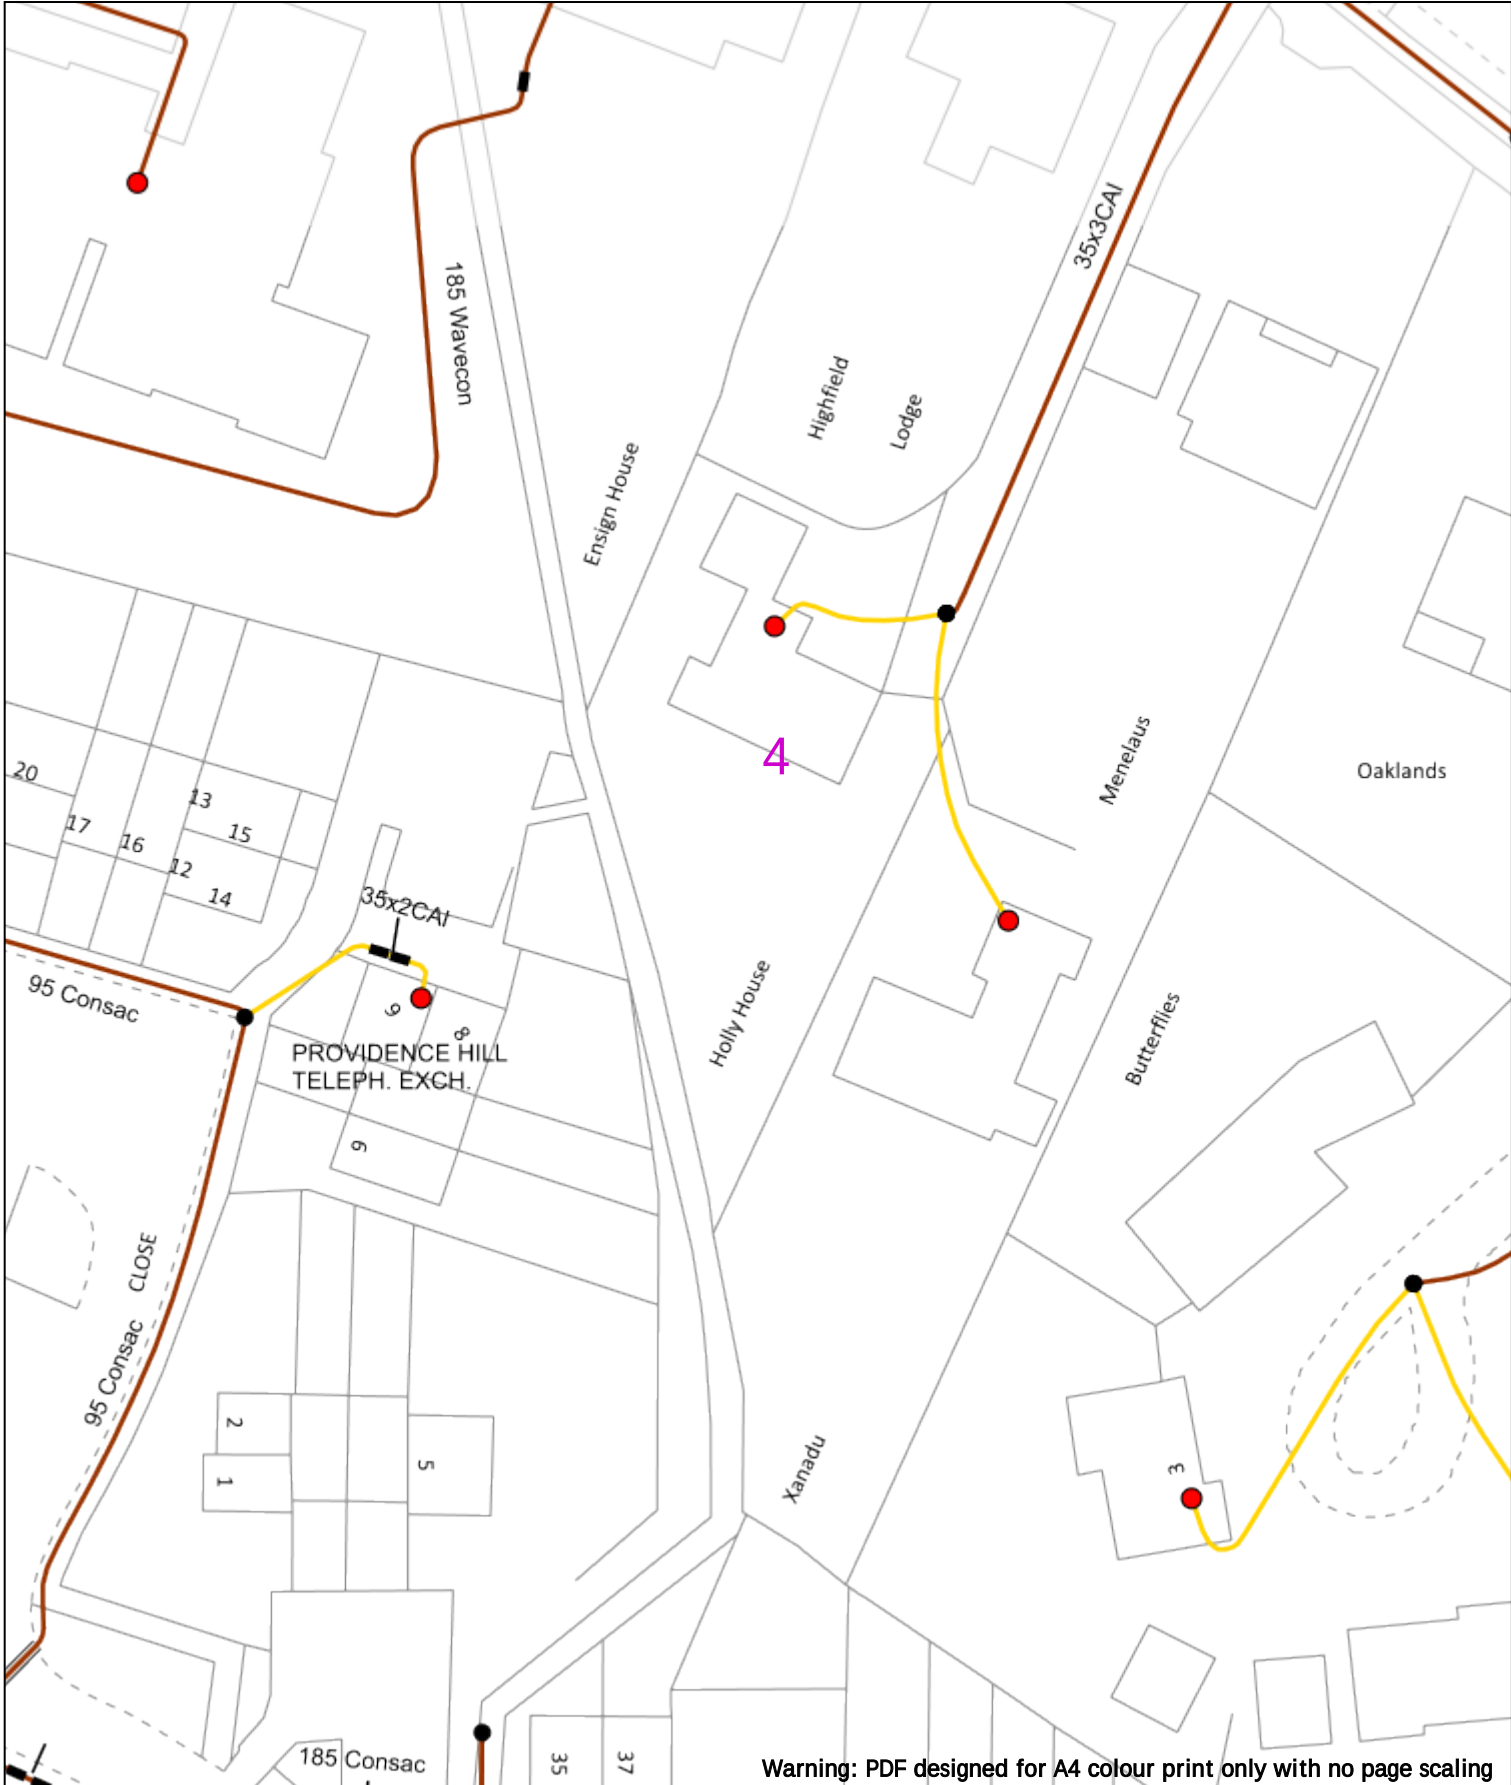

Warning: PDF designed for A4 colour print only with no page scaling

020m

Dig Sites

Area:

Line:

Date Requested: 05/07/2022

Job Reference: 26170679

Site Location: 448347 110613

Requested by: Mr Nick Claydon

Your Scheme/Reference: F/22/93160

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
Services	LV	HV	EHV	
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

Legend

Service Cable

LV Mains

2 - 33kV

6.6kV

11kV

22kV

33kV

66kV

132kV

275kV

400kV

Fibre Optic

Pilot Cable

Distribution Structures (Electric)

Pole, Existing Location

Pole Structure, Existing Location - Single

Pole Structure, Existing Location - H

Duct Route

Cross Section Route

WARNING

There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work.

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES G56 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

Southern Electric Power Distribution plc

Registered Office: No.1 Forbury Place

43 Forbury Road Reading RG1 3JH

Registered In England & Wales No.04094290

If you're unsure & need to seek advice before commencing excavations, please contact:

General Enquiries: 0800 048 3516

Subject to revision - Master held by SSEN Asset Data Team:

Asset.Data@sse.com

01256 337 294

Scale: 1:500 (When plotted at A4)

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE CROWN COPYRIGHT RESERVED.


This copy has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by Linesearchbeforeldg.



Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.
This copy has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd, Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.
Plans generated by DigSAFE Pro™ software provided by LinesearchbeforeUdig.

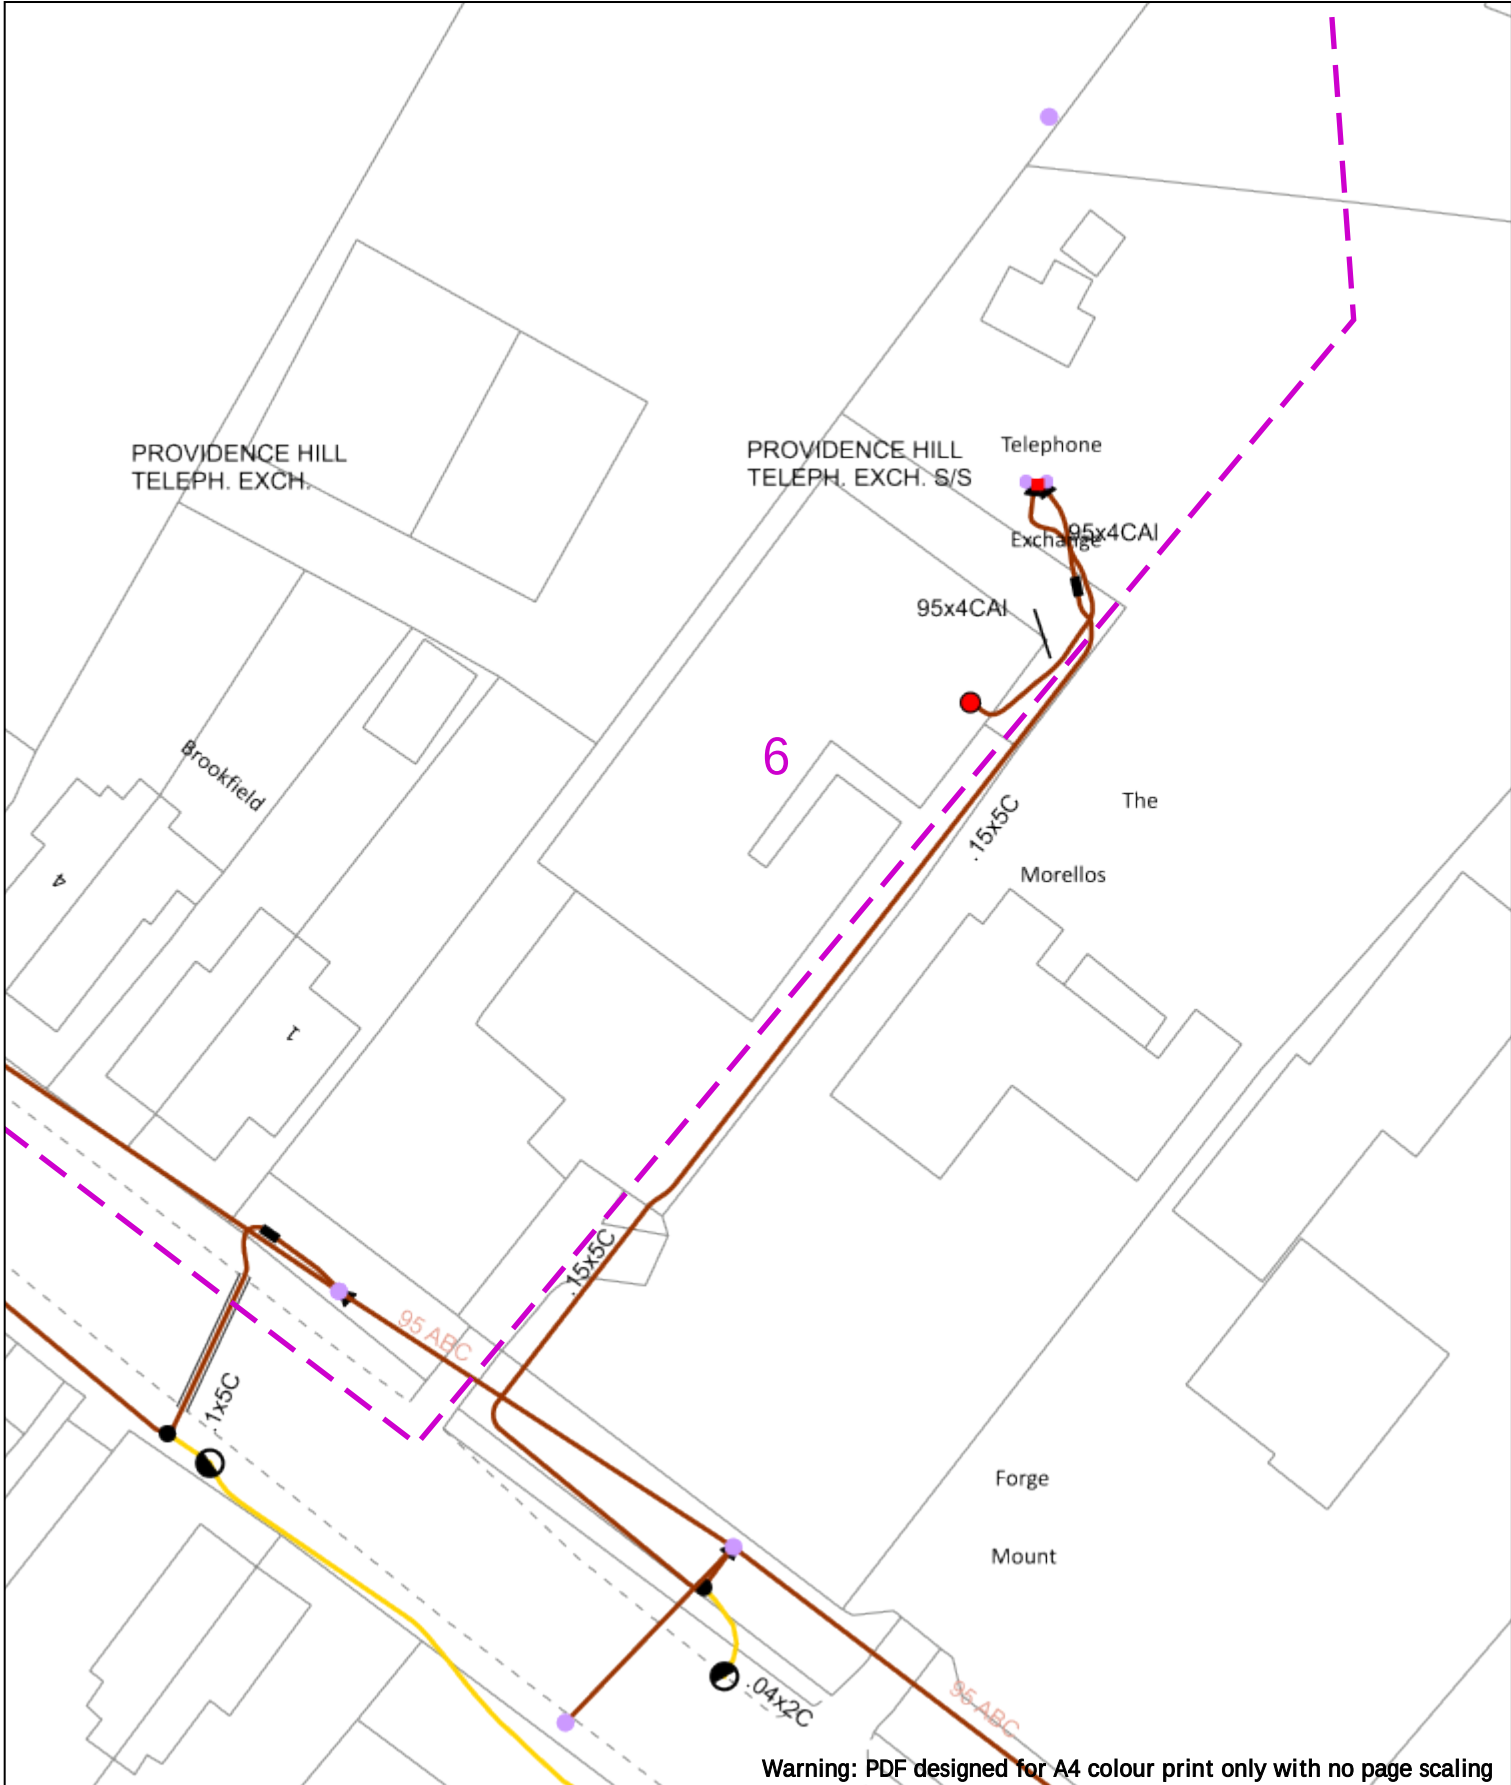

020m Dig Sites Area: Line:

Date Requested: 05/07/2022

Job Reference: 26170679

Site Location: 448347 110613

Requested by: Mr Nick Claydon

Your Scheme/Reference: F/22/93160

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

Legend

Service Cable

LV Mains

6.6kV

11kV

22kV

33kV

66kV

132kV

275kV

400kV

Fibre Optic

Pilot Cable

Distribution Structures (Electric)

Pole, Existing Location

Pole Structure, Existing Location - Single

Pole Structure, Existing Location - H

Duct Route

Cross Section Route

Warning

There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work.

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES G56 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

Southern Electric Power Distribution plc

Registered Office: No.1 Forbury Place

43 Forbury Road Reading RG1 3JH

Registered In England & Wales No.04094290

If you're unsure & need to seek advice before commencing excavations, please contact:

General Enquiries: 0800 048 3516

Subject to revision - Master held by SSEN Asset Data Team:

Asset.Data@sse.com


01256 337 294

Scale: 1:500 (When plotted at A4)

Based upon the Ordnance Survey map with the sanction of the Controller of Her Majesty's Stationery Office Crown Copyright Reserved.

This copy has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by Lineasarchitectonics.

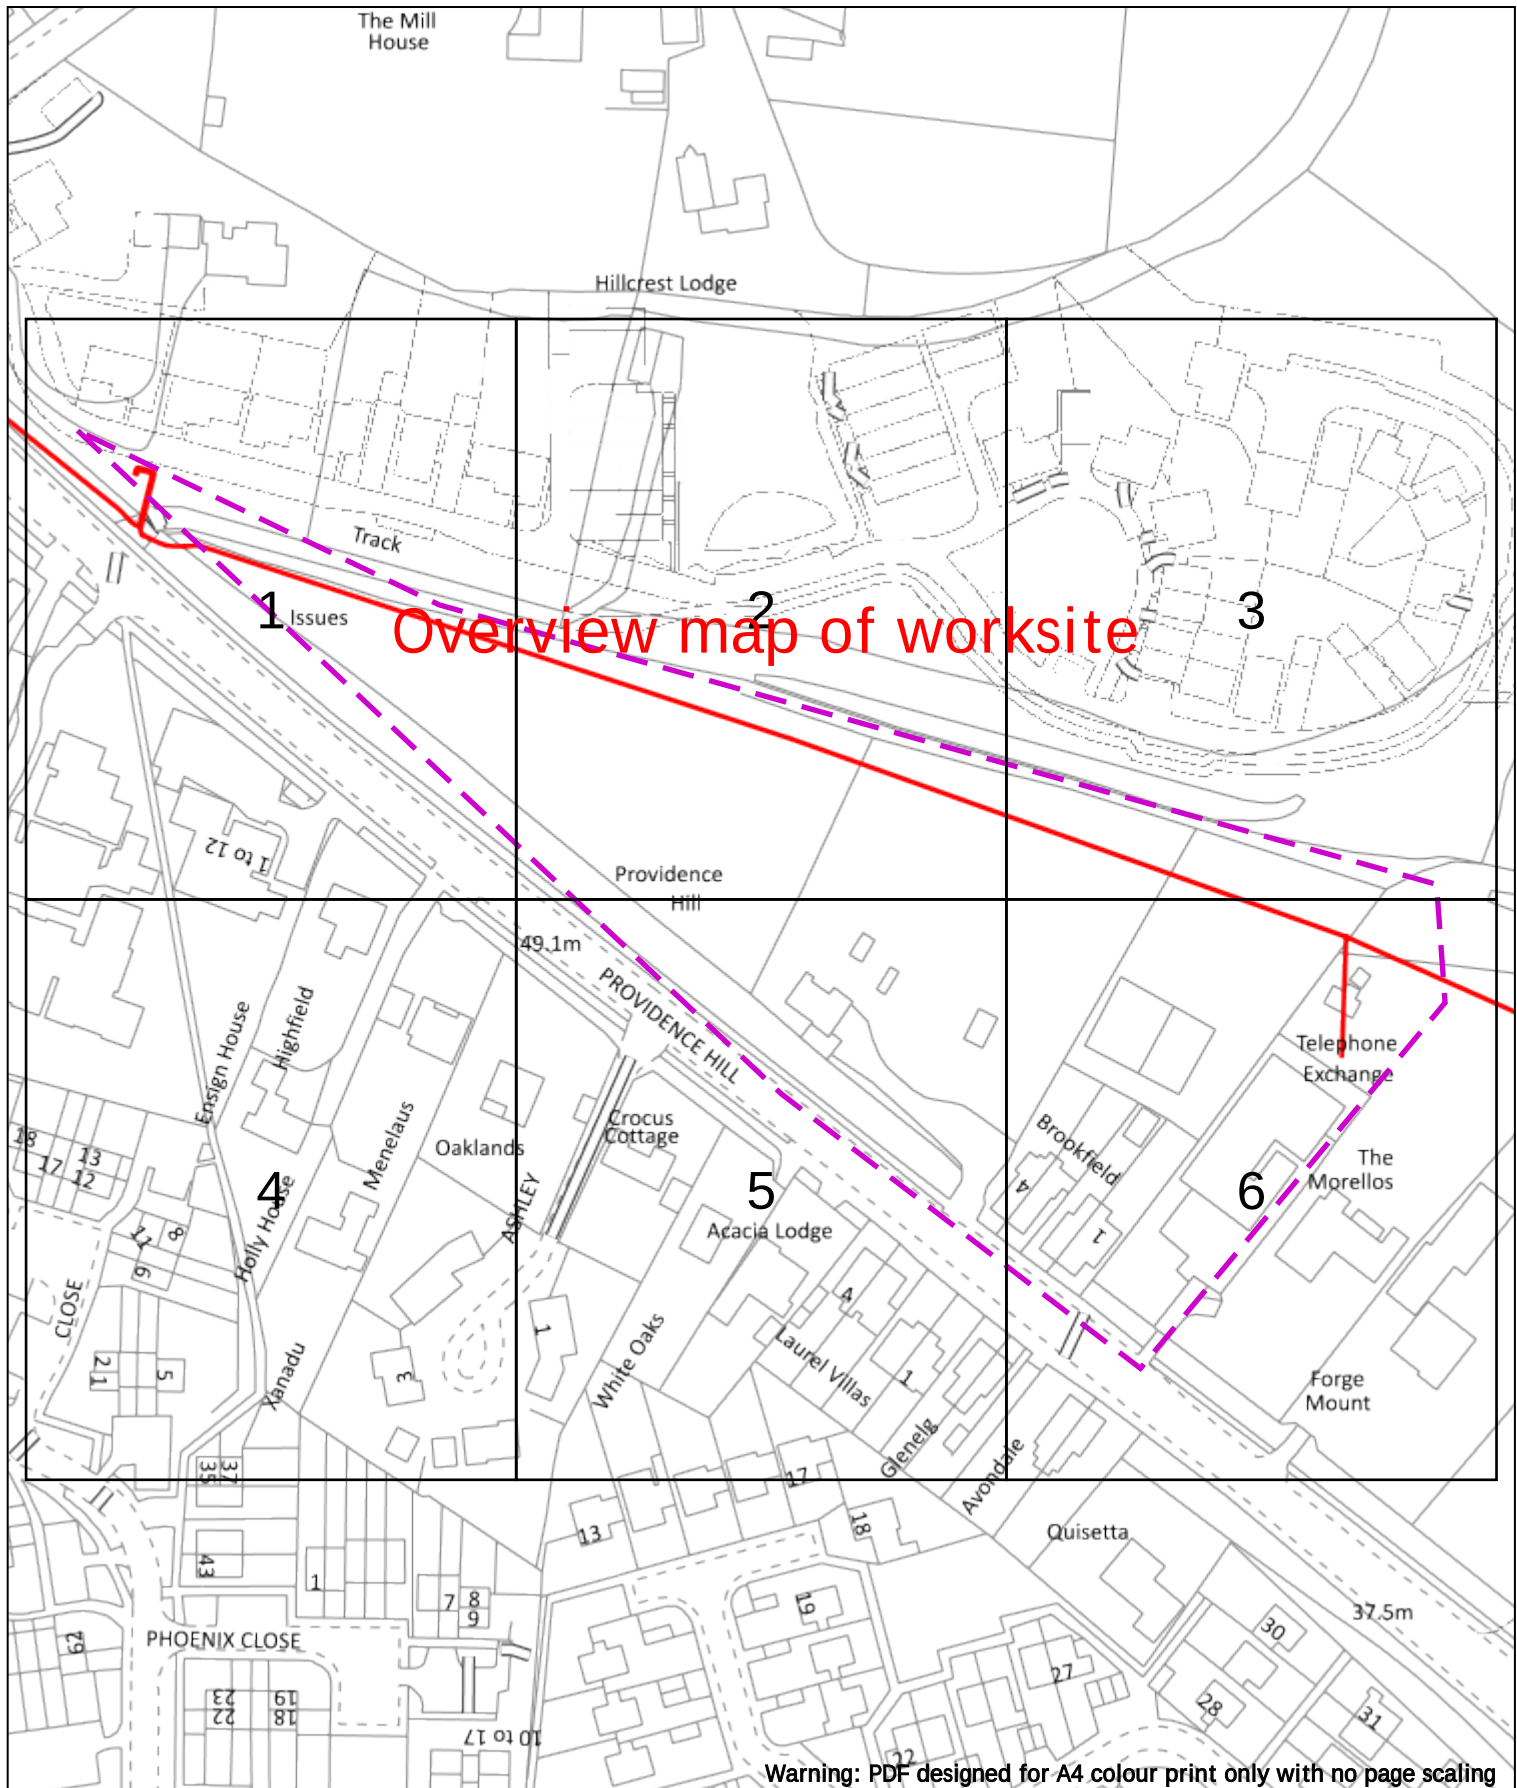

Dig Sites Area: ---- Line: ----

Date Requested: 05/07/2022
Job Reference: 26170679
Site Location: 448347 110613
Requested by: Mr Nick Claydon

Your Scheme/Reference: F/22/93160

Scale: 1:1537 (When plotted at A4)

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

WARNING
There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.
WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES G56 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

Legend	
—	Service Cable
—	LV Mains
—	2 – 3.3kV
—	6.6kV
—	11kV
—	22kV
—	33kV
—	66kV
—	132kV
—	275kV
—	400kV
—	Fibre Optic
—	Pilot Cable



Distribution Structures (Electric)	
●	Pole, Existing Location
●	Pole Structure, Existing Location - Single
●	Pole Structure, Existing Location - H
—	Duct Route
—	Cross Section Route



Southern Electric Power Distribution plc
Registered Office: No.1 Forbury Place
43 Forbury Road Reading RG1 3JH
Registered In England & Wales No.04094290

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
01256 337 294

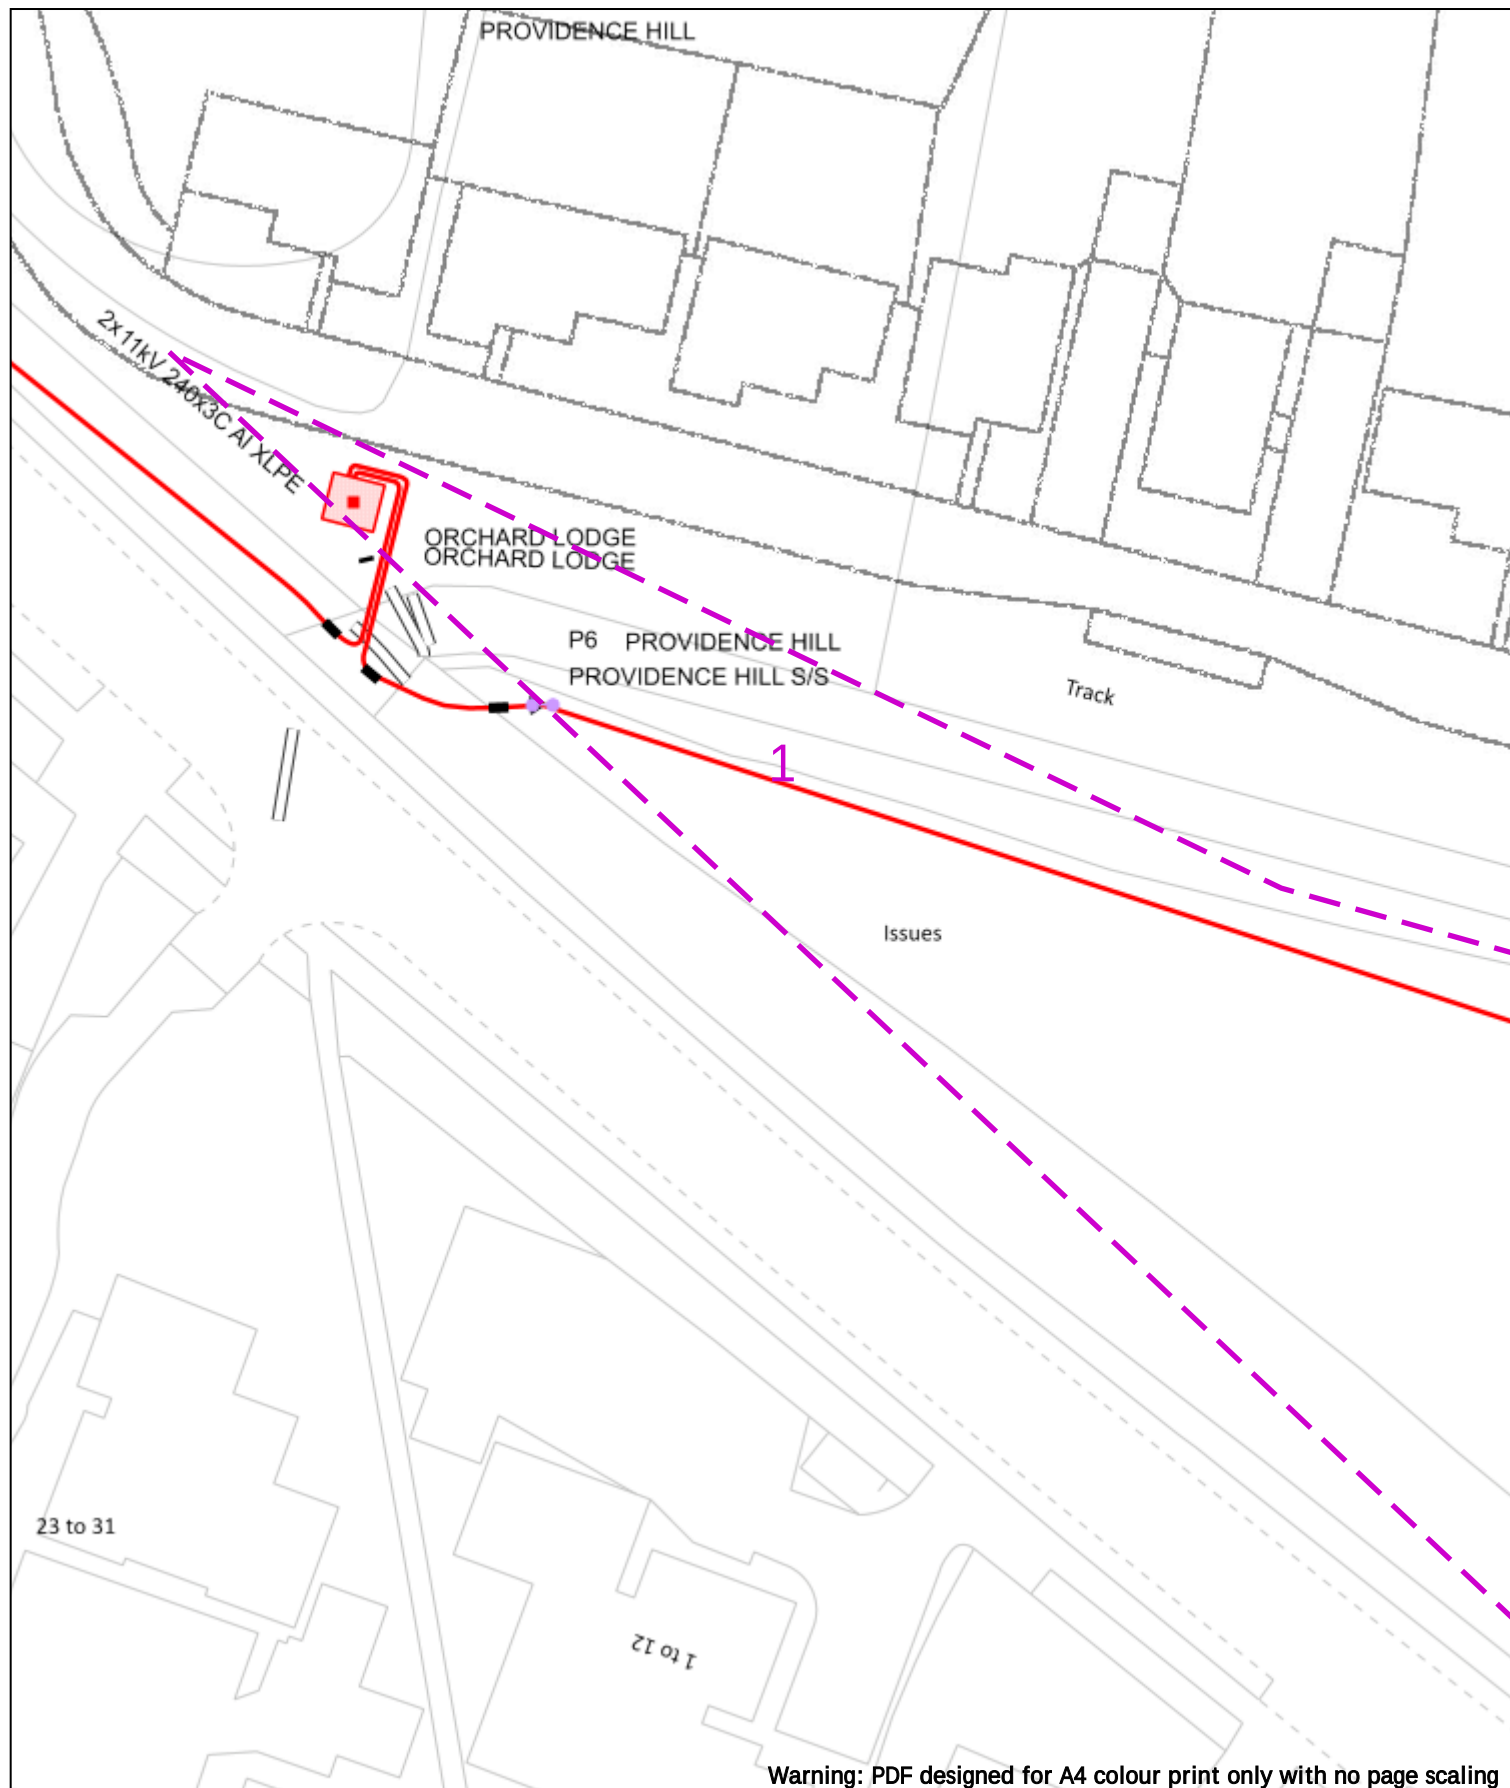

Date Requested: 05/07/2022
Job Reference: 26170679
Site Location: 448347 110613
Requested by: Mr Nick Claydon

Your Scheme/Reference: F/22/93160

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

Legend

- Service Cable
- LV Mains
- 2 – 3.3kV
- 6.6kV
- 11kV
- 22kV
- 33kV
- 66kV
- 132kV
- 275kV
- 400kV
- Fibre Optic
- Pilot Cable

Distribution Structures [Electric]

- Pole, Existing Location
- Pole Structure, Existing Location - Single
- Pole Structure, Existing Location - H
- Duct Route
- Cross Section Route

Southern Electric Power Distribution plc
Registered Office: No.1 Forbury Place
43 Forbury Road Reading RG1 3JH
Registered In England & Wales No.04094290

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294


Scale: 1:500 (When plotted at A4)

WARNING

There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES G56 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE CROWN COPYRIGHT RESERVED,
This copy has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.
Plans generated by DigSAFE Pro™ software provided by LinesearchbeforeLidg.

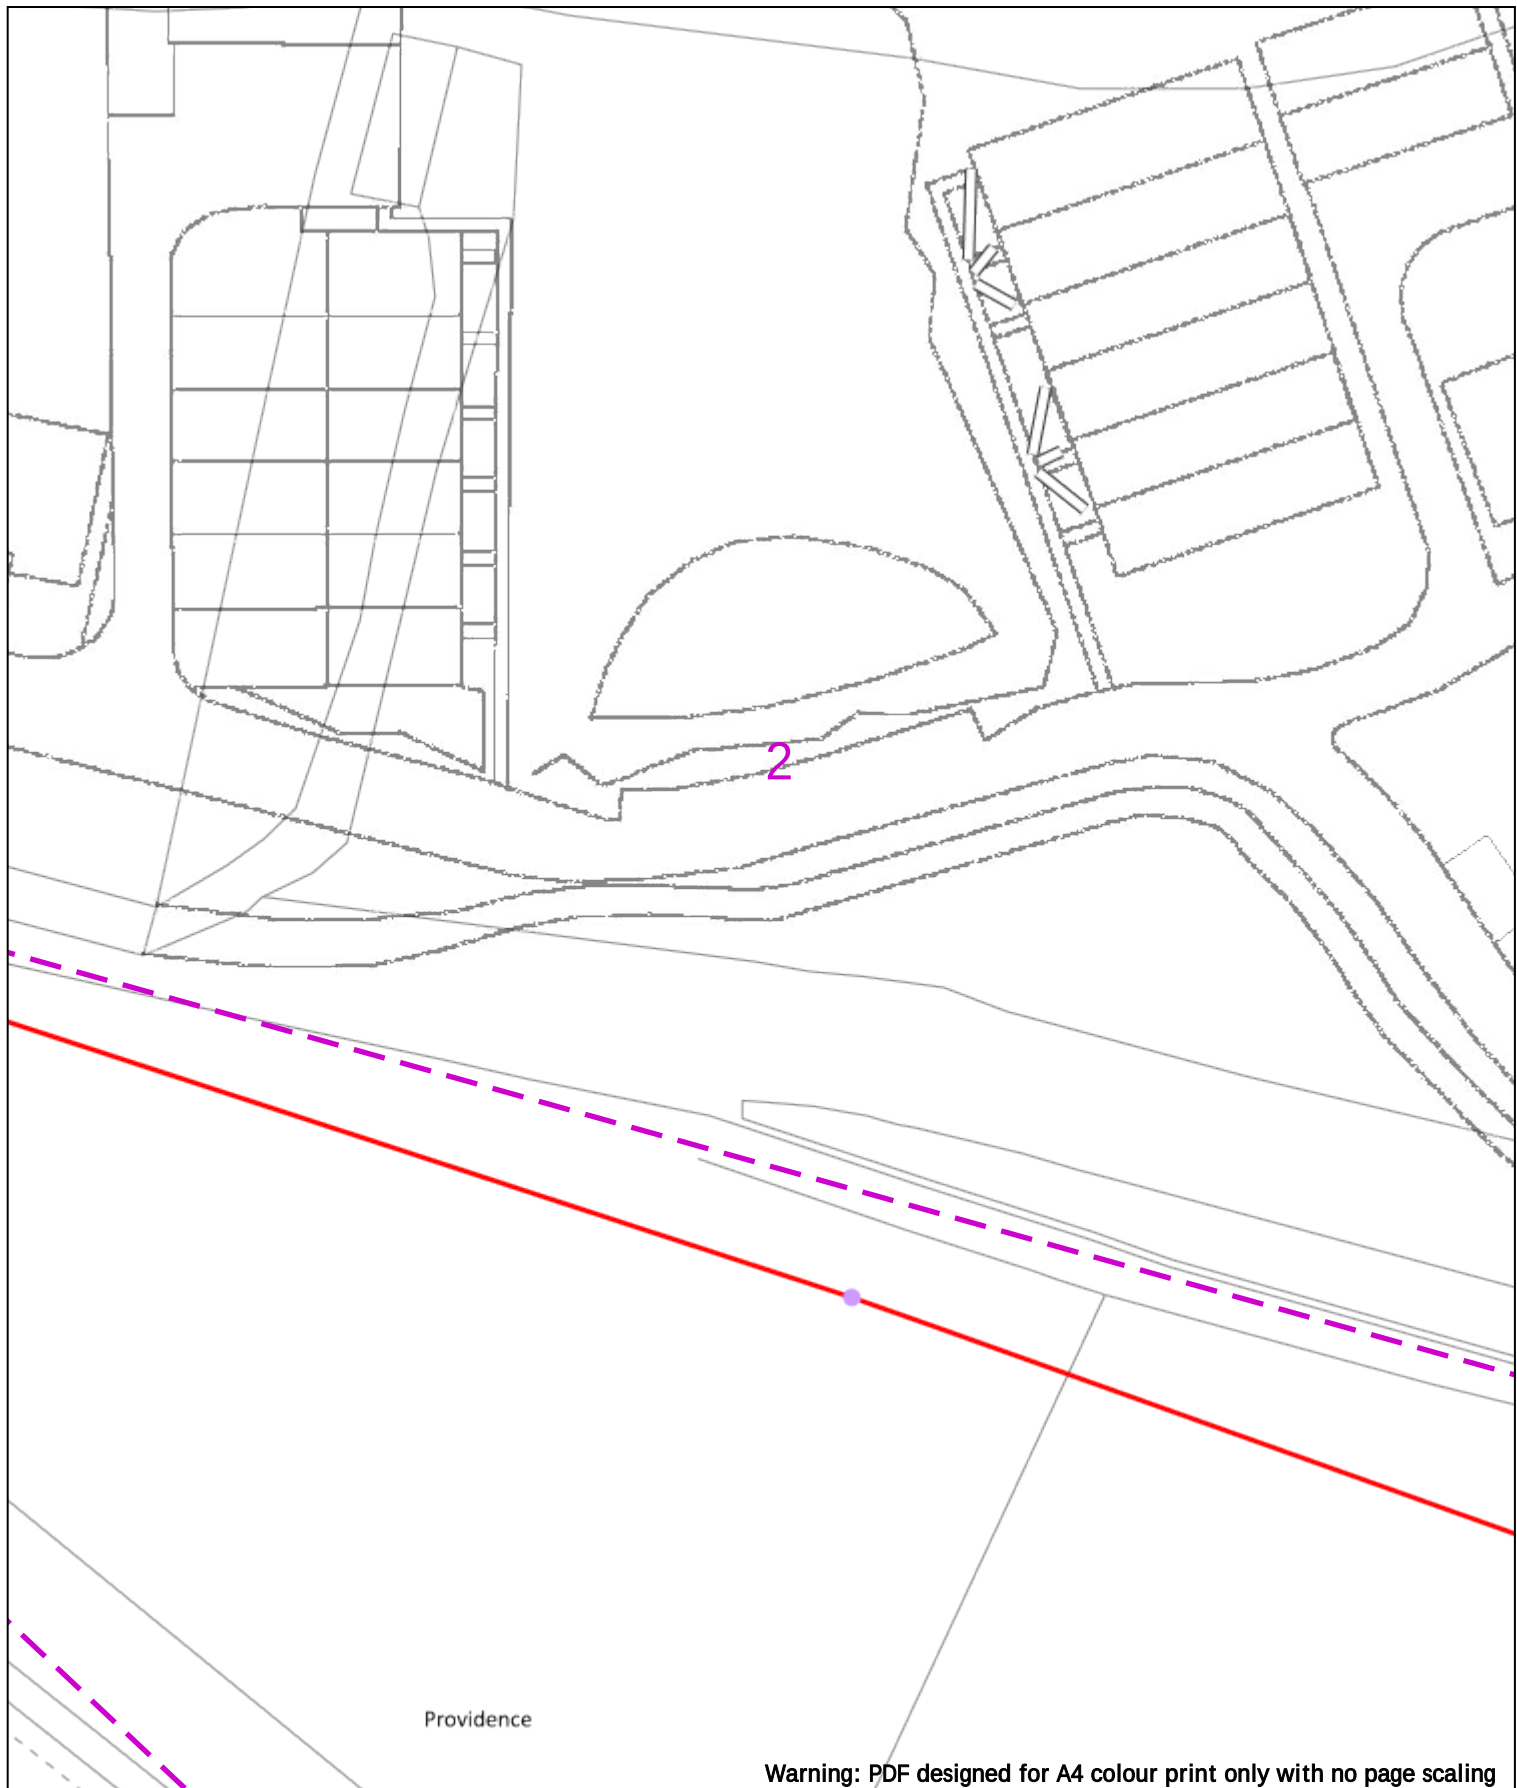

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Date Requested: 05/07/2022
 Job Reference: 26170679
 Site Location: 448347 110613
 Requested by: Mr Nick Claydon
 Your Scheme/Reference: F/22/93160

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

Legend

- Service Cable
- LV Mains
- 2 - 3.3kV
- 6.6kV
- 11kV
- 22kV
- 33kV
- 66kV
- 132kV
- 275kV
- 400kV
- Fibre Optic
- Pilot Cable

Distribution Structures (Electric)

- Pole, Existing Location
- Pole Structure, Existing Location - Single
- Pole Structure, Existing Location - H
- Duct Route
- Cross Section Route

Southern Electric Power Distribution plc
 Registered Office: No.1 Forbury Place
 43 Forbury Road Reading RG1 3JH
 Registered In England & Wales No.04094290


If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

Scale: 1:500 (When plotted at A4)

WARNING
 There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.
 WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES G56 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE CROWN COPYRIGHT RESERVED.
 This copy has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.
 Plans generated by DigSAFE Pro™ software provided by Linesearchbeforeldg.

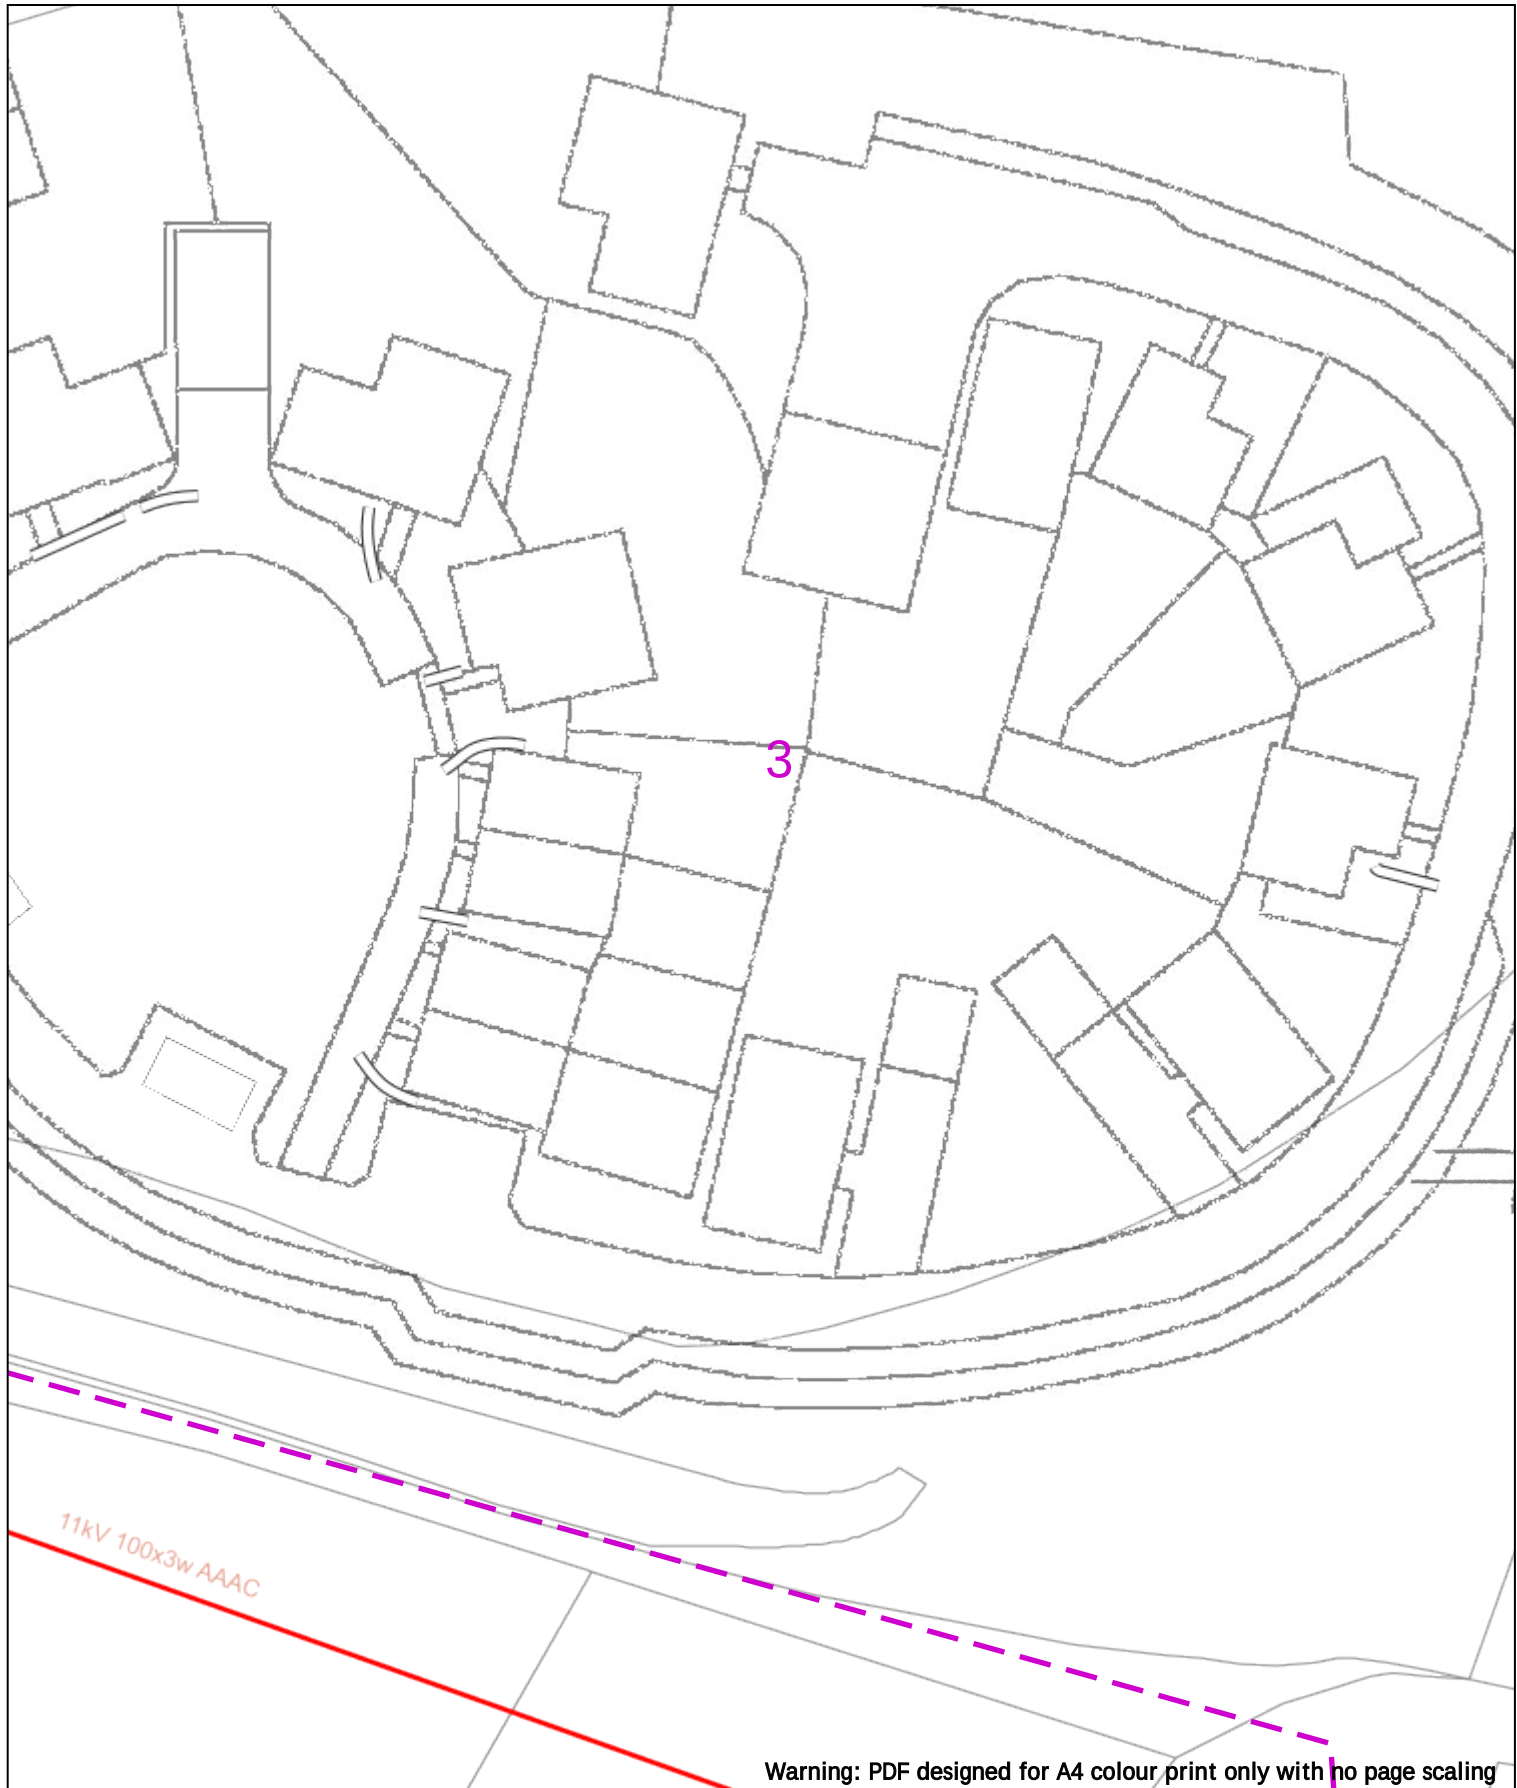

Warning: PDF designed for A4 colour print only with no page scaling

020m Dig Sites Area: Line:

Date Requested: 05/07/2022
Job Reference: 26170679
Site Location: 448347 110613
Requested by: Mr Nick Claydon
Your Scheme/Reference: F/22/93160

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
Services	LV	HV	EHV	
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

Legend

Service Cable

LV Mains

6.6kV

11kV

22kV

33kV

66kV

132kV

275kV

400kV

Fibre Optic

Pilot Cable

Distribution Structures (Electric)

Pole, Existing Location

Pole Structure, Existing Location - Single

Pole Structure, Existing Location - H

Duct Route

Cross Section Route

WARNING

There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES G56 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

N

E

S

W

Scottish & Southern
Electricity Networks

Southern Electric Power Distribution plc

Registered Office: No.1 Forbury Place
43 Forbury Road Reading RG1 3JH
Registered In England & Wales No.04094290

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516


Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
01256 337 294


Scale: 1:500 (When plotted at A4)

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE CROWN COPYRIGHT RESERVED.

This copy has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by Linsearchbeforeldg.

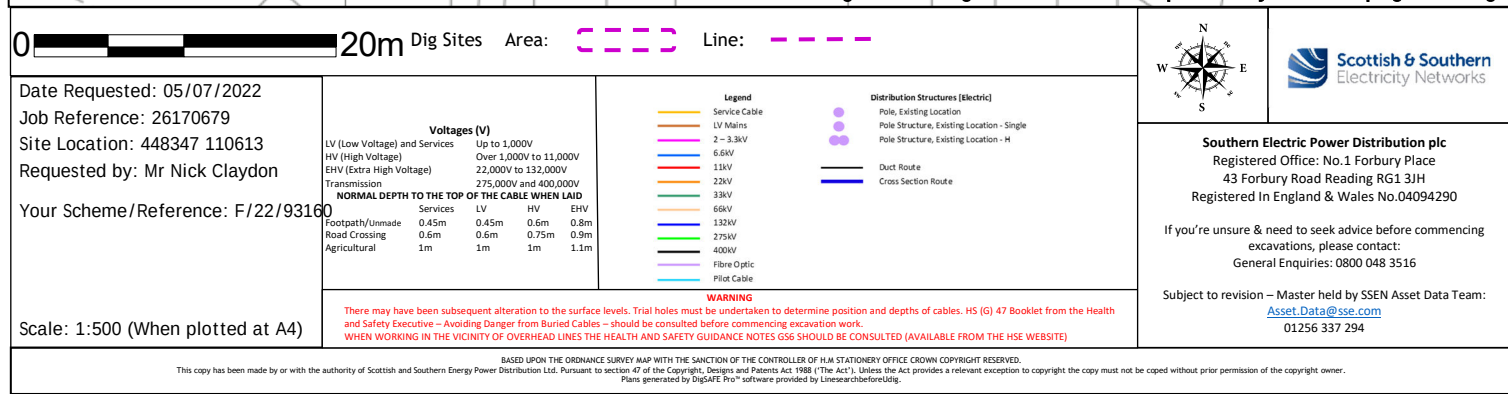

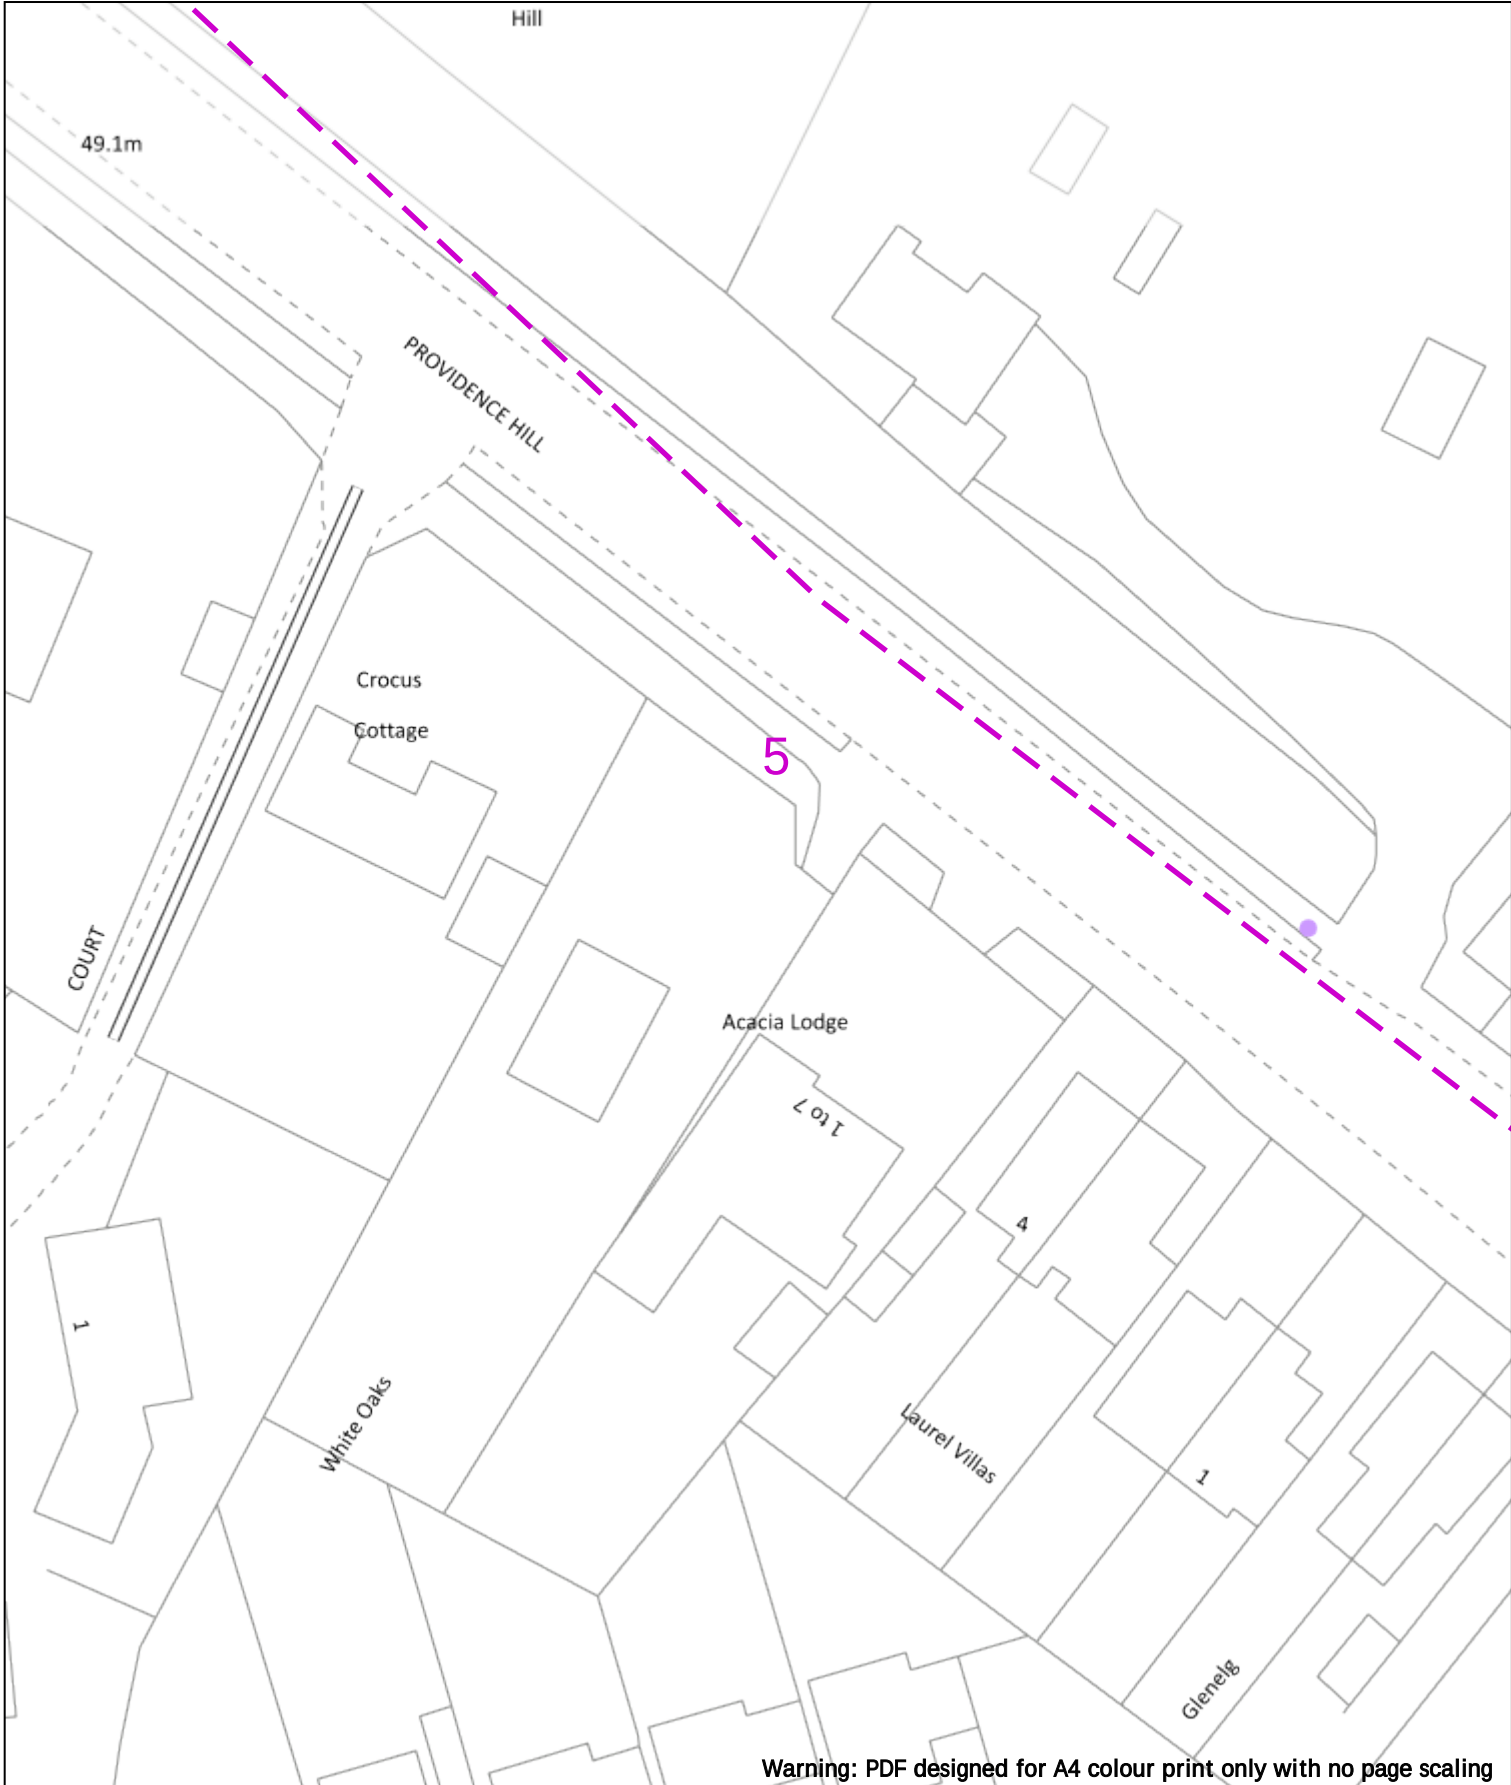

020m Dig Sites Area: Line:

Date Requested: 05/07/2022

Job Reference: 26170679

Site Location: 448347 110613

Requested by: Mr Nick Claydon

Your Scheme/Reference: F/22/93160

Voltages (V)

LV (Low Voltage) and Services Up to 1,000V

HV (High Voltage) Over 1,000V to 11,000V

EHV (Extra High Voltage) 22,000V to 132,000V

Transmission 275,000V and 400,000V

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID

Services LV HV EHV

Footpath/Unmade 0.45m 0.45m 0.6m 0.8m

Road Crossing 0.6m 0.6m 0.75m 0.9m

Agricultural 1m 1m 1m 1.1m

Legend

Service Cable

LV Mains

6.6kV

11kV

22kV

33kV

66kV

132kV

275kV

400kV

Fibre Optic

Pilot Cable

Distribution Structures (Electric)

Pole, Existing Location

Pole Structure, Existing Location - Single

Pole Structure, Existing Location - H

Duct Route

Cross Section Route

WARNING

There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES G56 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

Southern Electric Power Distribution plc

Registered Office: No.1 Forbury Place

43 Forbury Road Reading RG1 3JH

Registered In England & Wales No.04094290

If you're unsure & need to seek advice before commencing excavations, please contact:

General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:

Asset.Data@sse.com


01256 337 294

Scale: 1:500 (When plotted at A4)

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE CROWN COPYRIGHT RESERVED.

This copy has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by Lineasearchbeforeldg.

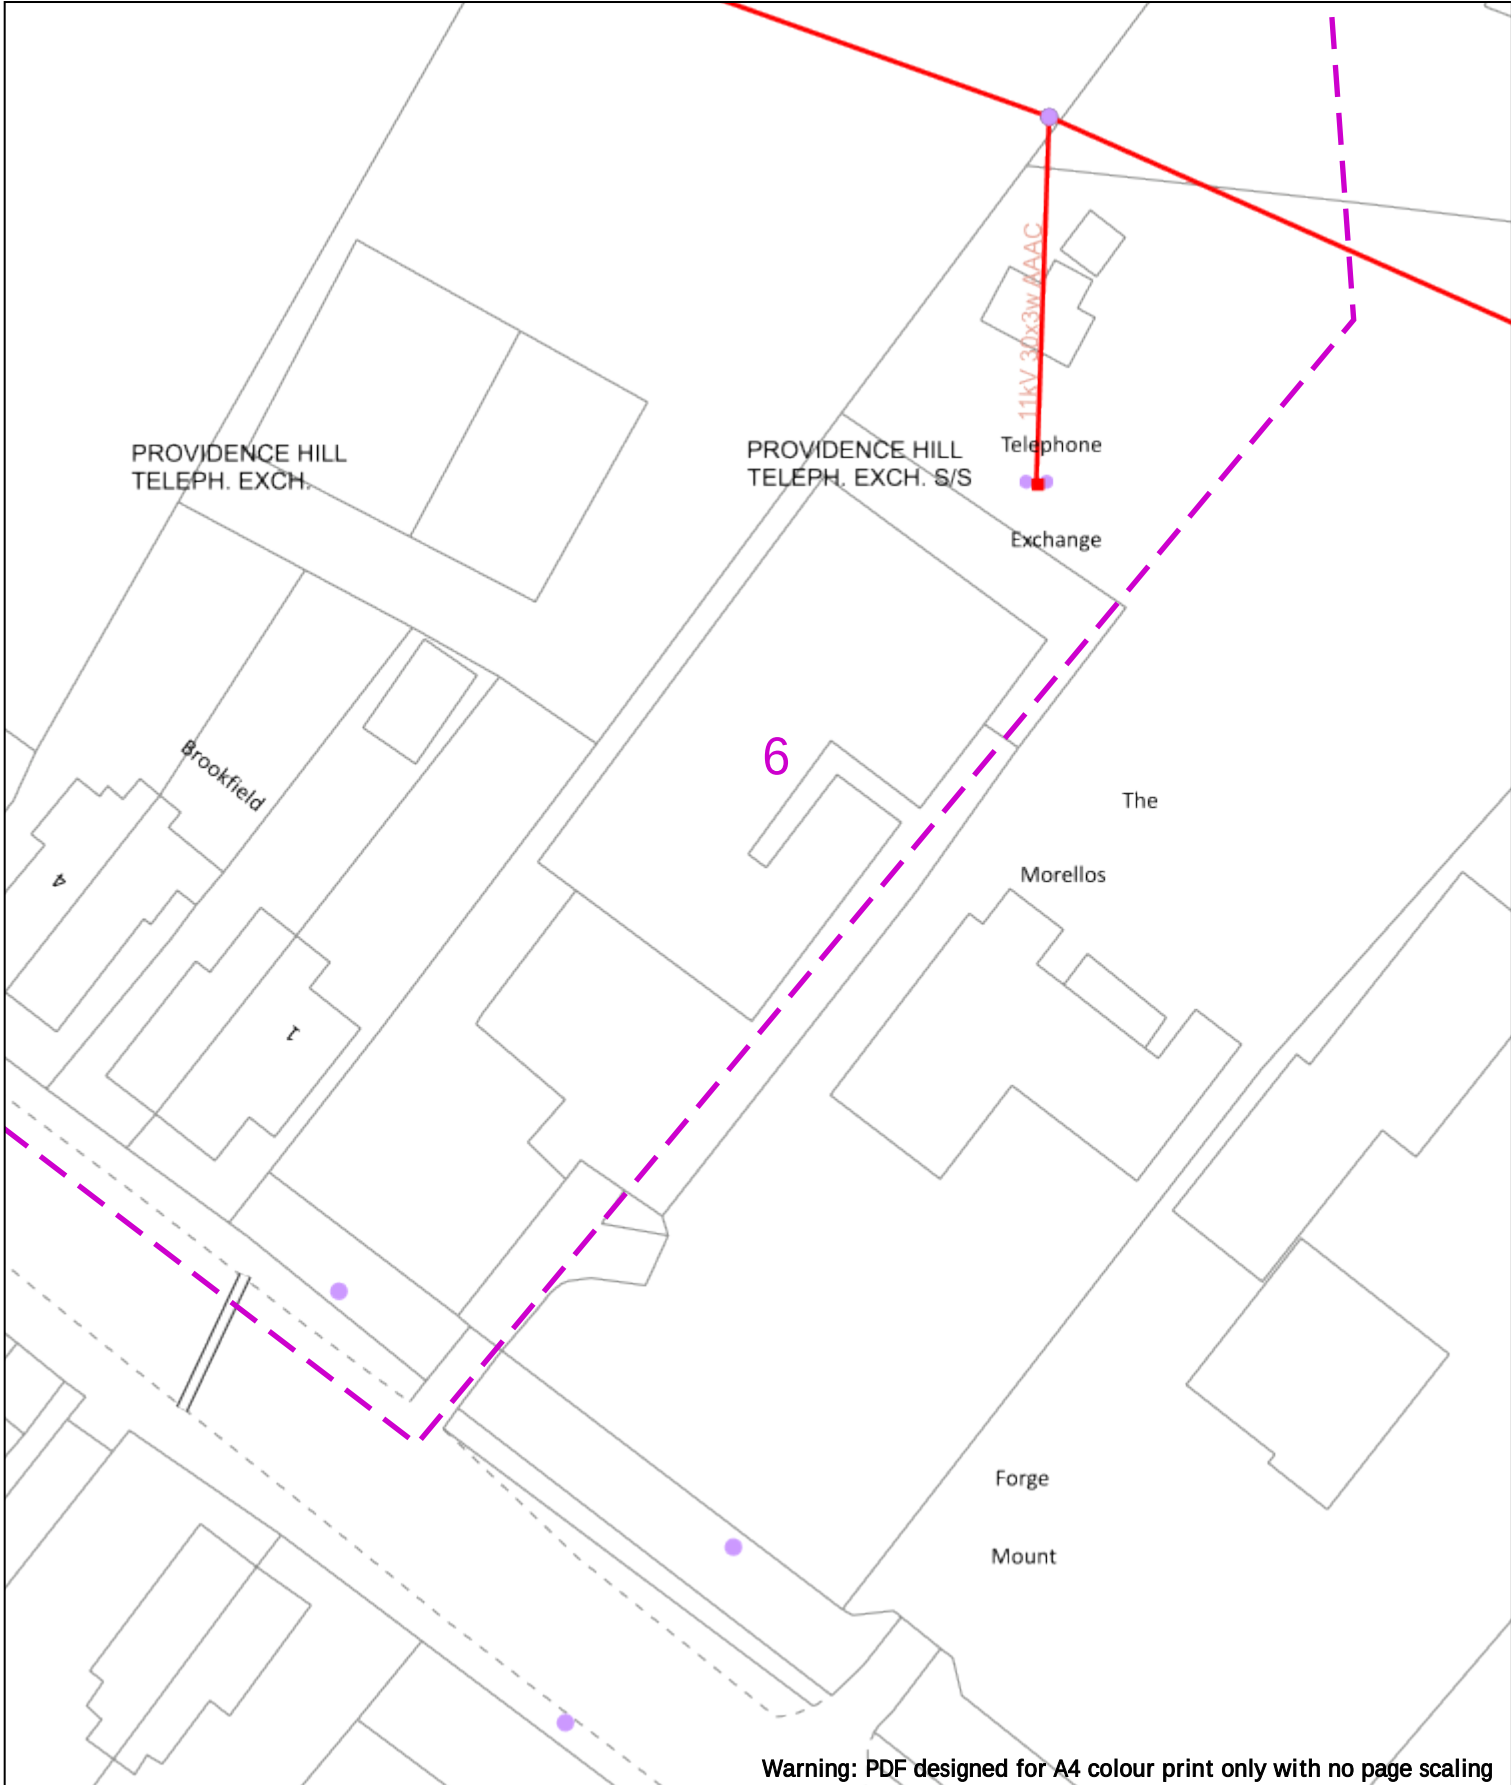

Warning: PDF designed for A4 colour print only with no page scaling

020m Dig Sites Area: Line:

Date Requested: 05/07/2022
Job Reference: 26170679
Site Location: 448347 110613
Requested by: Mr Nick Claydon
Your Scheme/Reference: F/22/93160

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
Services	LV	HV	EHV	
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

WARNING

There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES G56 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

Legend

- Service Cable
- LV Mains
- 11kV
- 22kV
- 33kV
- 66kV
- 132kV
- 275kV
- 400kV
- Fibre Optic
- Pilot Cable

Distribution Structures (Electric)

- Pole, Existing Location
- Pole Structure, Existing Location - Single
- Pole Structure, Existing Location - H

Duct Route

- Cross Section Route

Southern Electric Power Distribution plc
Registered Office: No.1 Forbury Place
43 Forbury Road Reading RG1 3JH
Registered In England & Wales No.04094290

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
01256 337 294

Scale: 1:500 (When plotted at A4)

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE CROWN COPYRIGHT RESERVED.
This copy has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.
Plans generated by DigSAFE Pro™ software provided by Lineasarchbeforeldg.