


SALES DRAWING: NOT FOR CONSTRUCTION

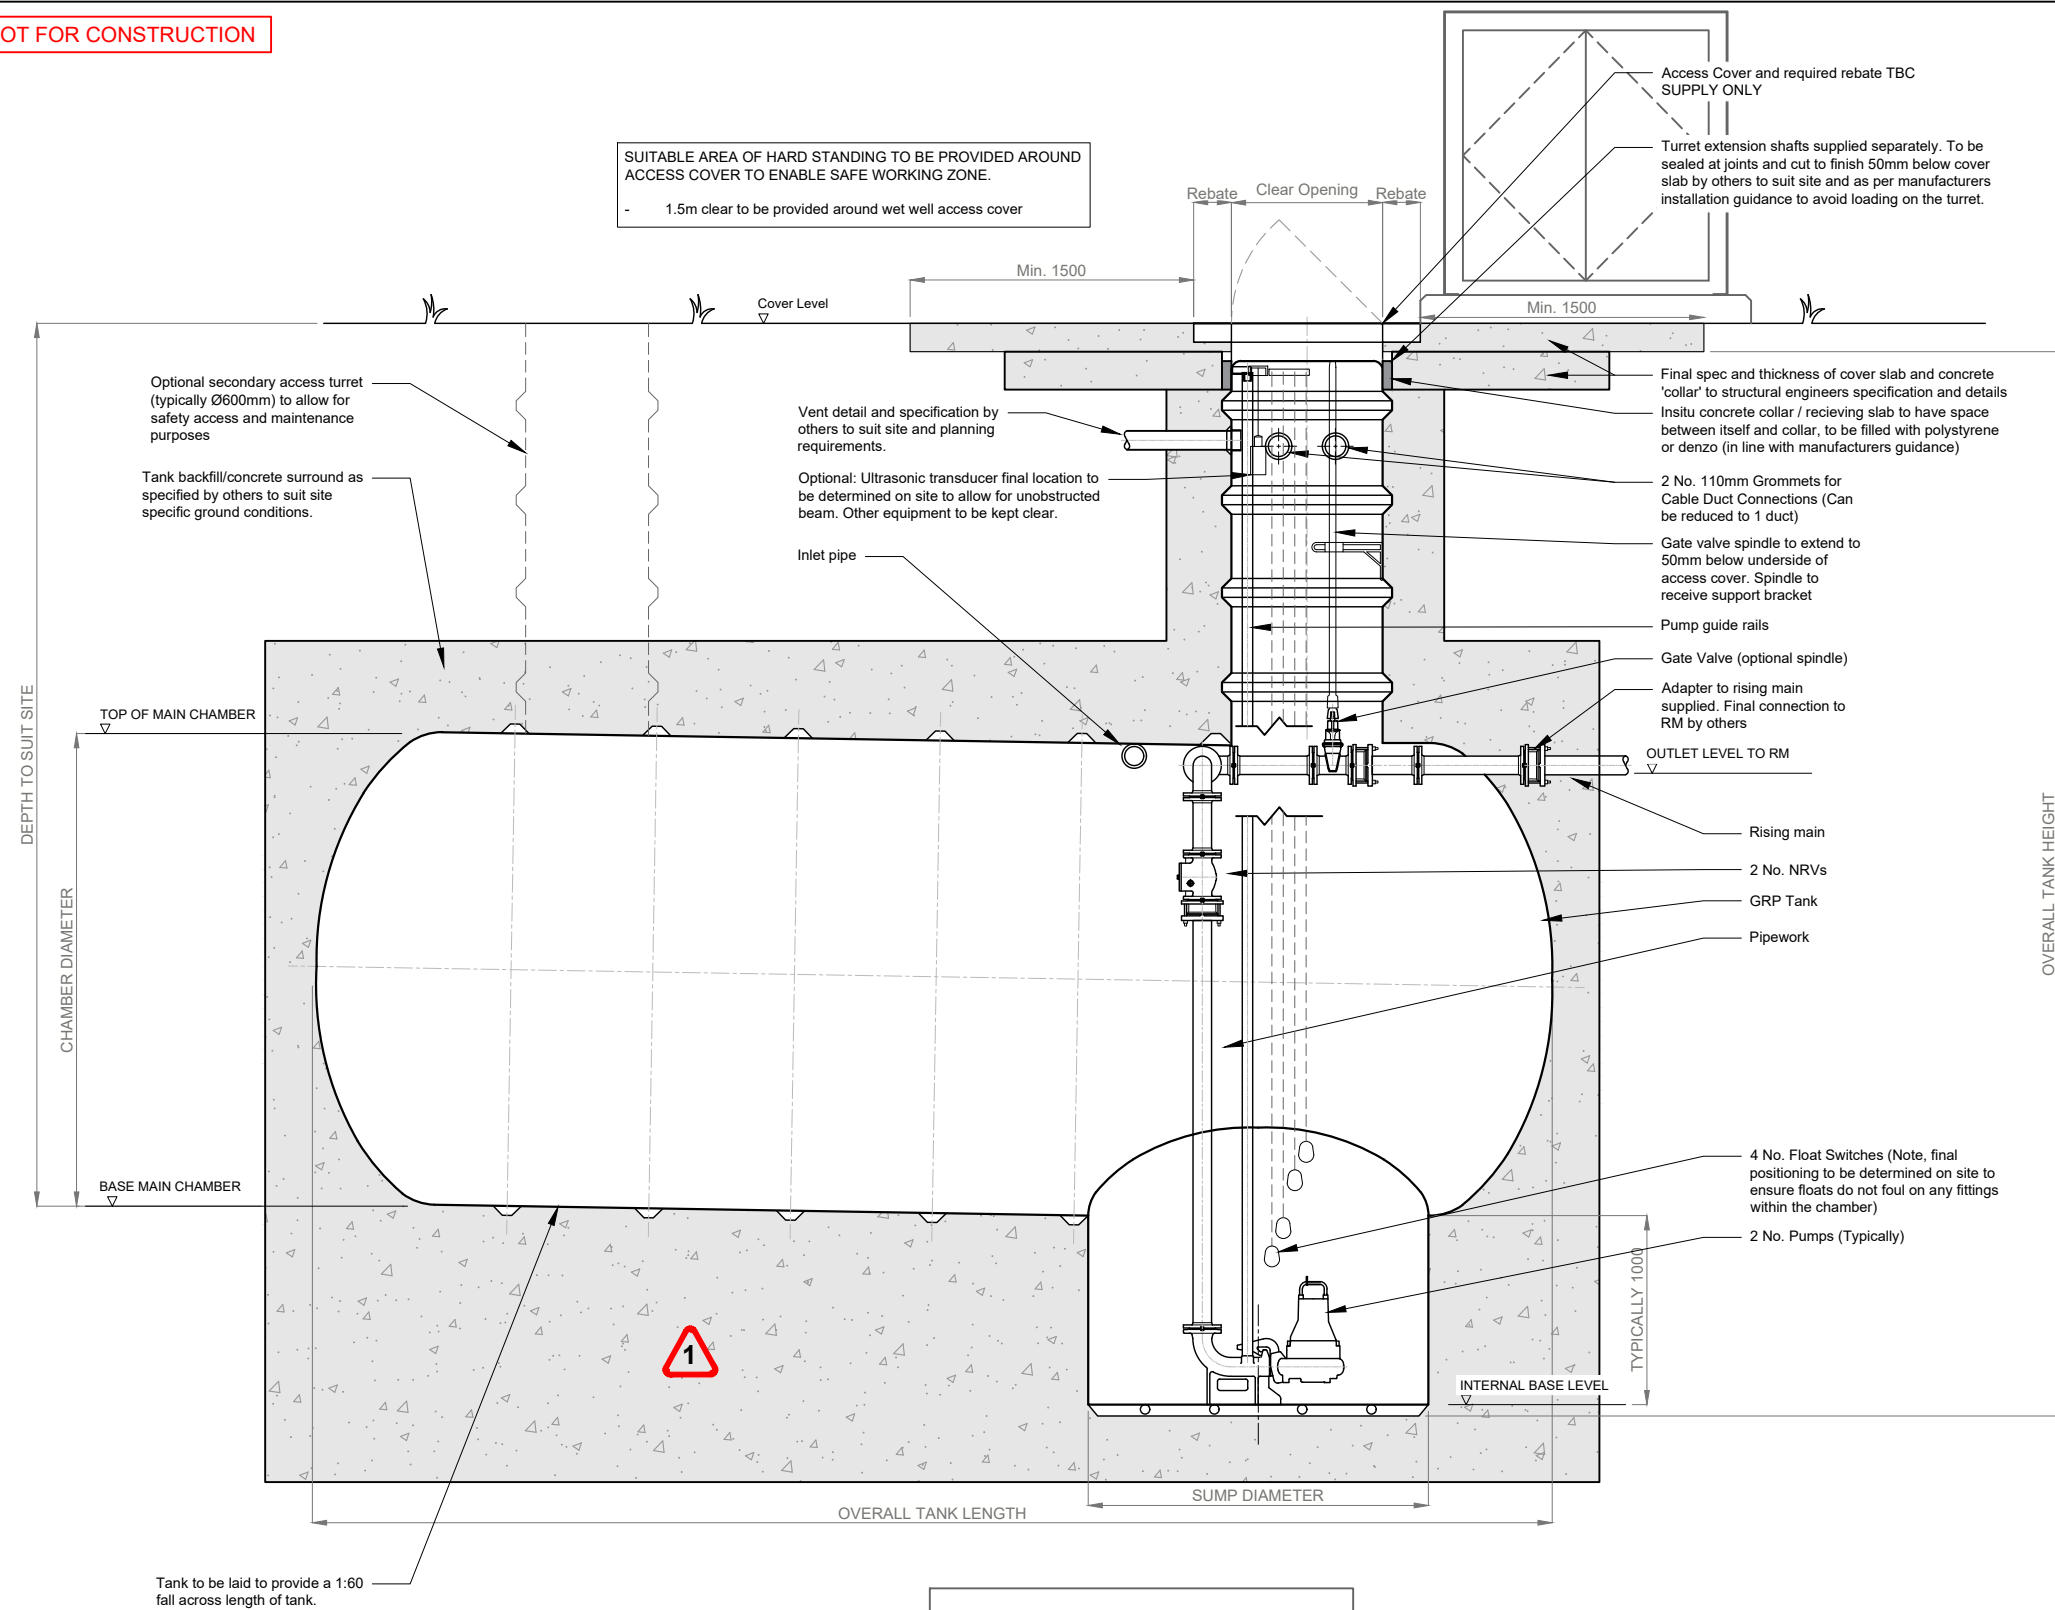

SUITABLE AREA OF HARD STANDING TO BE PROVIDED AROUND ACCESS COVER TO ENABLE SAFE WORKING ZONE.
- 1.5m clear to be provided around wet well access cover

Access Cover and required rebate TBC
SUPPLY ONLY

Turret extension shafts supplied separately. To be sealed at joints and cut to finish 50mm below cover slab by others to suit site and as per manufacturers installation guidance to avoid loading on the turret.

1. Do not scale from this drawing.
2. All Dimensions shown in millimeters and all inverts in meters AOD unless stated otherwise.
3. This drawing is diagrammatical only and not project specific.

High level support to be provided to all risers and spindles over 1m.

All cut pipe joints to be as close to structures as possible consistent with making the joint. The rocker pipes to be 1m OR equal to one nominal pipe diameter, whichever is greater.

RISK SCHEDULE - CDM

WARNING TRIANGLES DENOTE FORESEEABLE SIGNIFICANT RISKS ASSOCIATED WITH THIS DRAWING



DEEP EXCAVATIONS REQUIRED

Typical Chamber Sizes

Horizontal chambers are available in a range of diameters:

Ø1800,
Ø2100,
Ø2500,
Ø3000

The length of the chamber is adjustable to suit site requirements.

SALES DRAWING: NOT FOR CONSTRUCTION

REV.	DATE	DESCRIPTION	DR'n	CHK'd
SALES DRAWING				



Willow Pumps Ltd

Hall Park Farm,
Hall Road,
Aylesford,
Kent
ME20 7QZ
01634 201 111
WWW.WILLOWPUMPS.CO.UK

Title: HORIZONTAL GRP STATION
ELEVATION

Scale: 1:20 @ A1 1:40 @ A3	Date: 15/09/21	Drawn: ZP	Checked: JI
----------------------------------	-------------------	--------------	----------------

Project No: Standard	Drawing No: 030	Revision: -
-------------------------	--------------------	----------------

SALES DRAWING: NOT FOR CONSTRUCTION

- High level support to be provided to all risers and spindles over 1m.
- All cut pipe joints to be as close to structures as possible consistent with making the joint. The rocker pipes to be 1m OR equal to one nominal pipe diameter, whichever is greater.

