


Notes:-


- 1) All Loft and unheated void ducting fitted with Insulated Duct Wrap.
1.1. MEV Terminations- last 1500mm of ducting fitted with Insulated Duct Wrap.
1.2. MVHR Terminations - All exhaust and fresh air ducting fitted with Insulated Duct Wrap.
- 2) Duct Positioning is Indicative Only. Final Co-ordination to be Undertaken at Site Level.
- 3) Condensate Drainage To be Provided & Installed By Others.

THIS DRAWING IS FOR
APPROVAL ONLY
TO BE CHECKED WITH
DESIGN CO-ORDINATOR

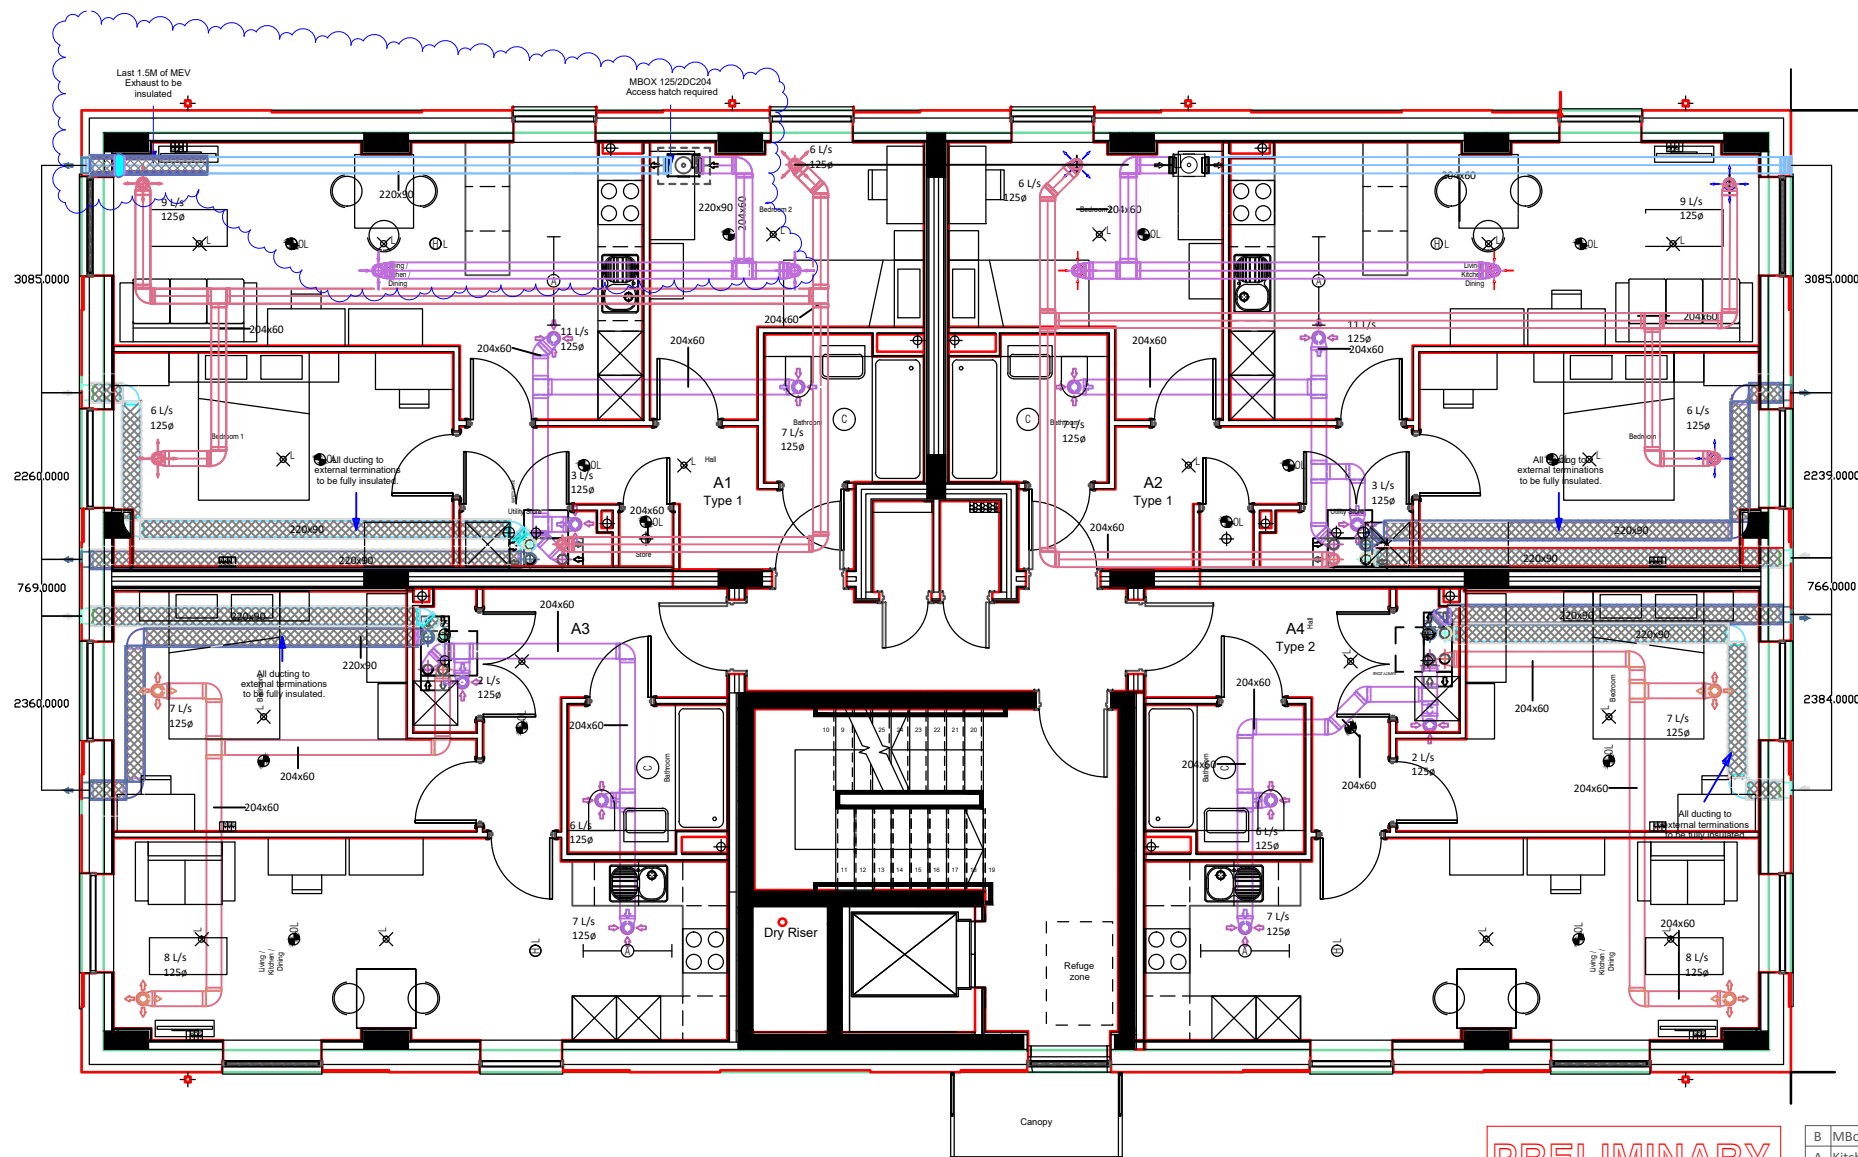

- 1) All Loft and unheated void ducting fitted with Insulated Duct Wrap.
 - 1.1. MEV Terminations- last 1500mm of ducting fitted with Insulated Duct Wrap.
 - 1.2. MVHR Terminations - All exhaust and fresh air ducting fitted with Insulated Duct Wrap.
- 2) Duct Positioning is Indicative Only. Final Co-ordination to be Undertaken at Site Level.
- 3) Condensate Drainage To Be Provided & installed By Others.

THIS DRAWING IS FOR
APPROVAL ONLY
TO BE CHECKED WITH
DESIGN CO-ORDINATOR

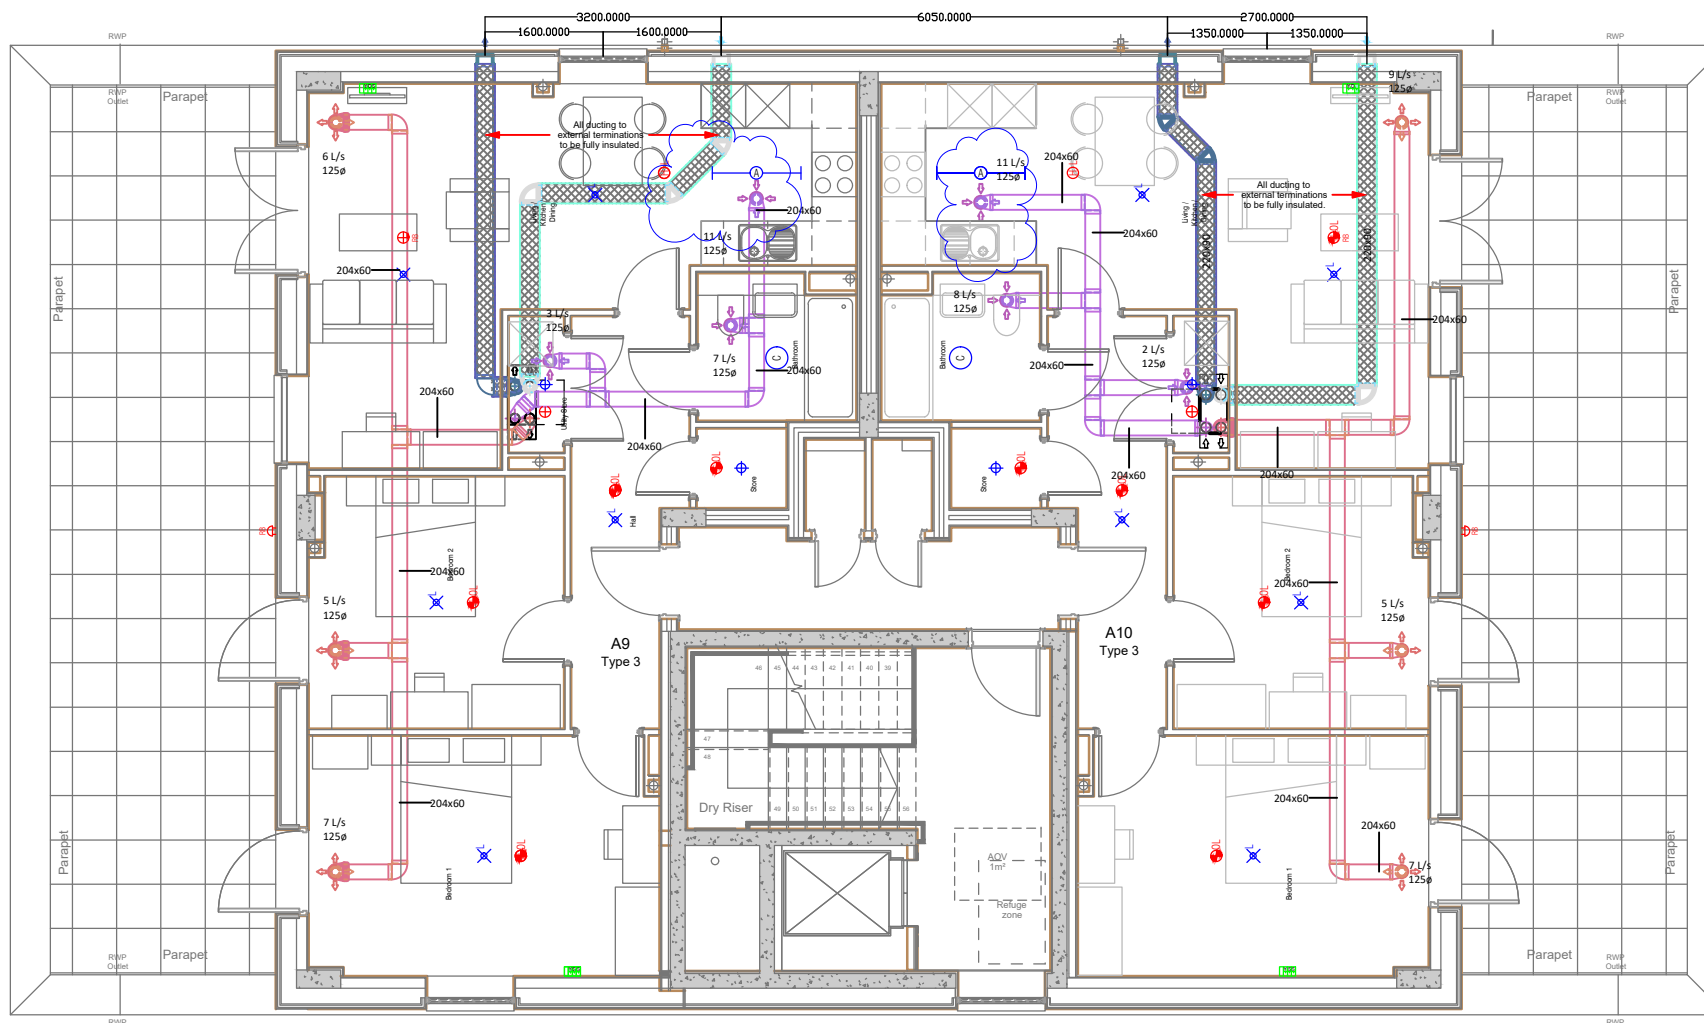

PRELIMINARY

A	Kitchen AV moved to avoid light. Tweaks to other duct to avoid lights.	SPB	28/02/22
Rev	Description	By	Date
Title:- Block A Third Floor Duct Layouts			
Drawing Number:- V1-395-A3			Revision:- B

○

3rd Flr Duct Layouts Block A

1 : 50

Vectaire Limited
Hampden Building
Lincoln Road
Cressex Business Park
High Wycombe
Buck HP12 3RH
Tel 01494 522333
E-mail: estimating@vectaire.co.uk

Drawn by:-	Author
Checked by:-	Ben Miller
Date:-	02/01/22
Scale:-	As indicated @ A3

This drawing, its contents & its associated properties are the property of Vectaire Ltd. No reproduction is permitted without prior written consent by the management of Vectaire Ltd.

Project:-	Eastleigh Post Office
-----------	-----------------------

Block A Third Floor Duct Layouts