


Notes:-

- 1) All Loft and unheated void ducting fitted with Insulated Duct Wrap.
1.1. MEV Terminations- last 1500mm of ducting fitted with Insulated Duct Wrap.
1.2. MVHR Terminations - All exhaust and fresh air ducting fitted with Insulated Duct Wrap.
2) Duct Positioning is Indicative Only. Final Co-ordination to be Undertaken at Site Level.
3) Condensate Drainage To be Provided & installed By Others.

THIS DRAWING IS FOR
APPROVAL ONLY
TO BE CHECKED WITH
DESIGN CO-ORDINATOR

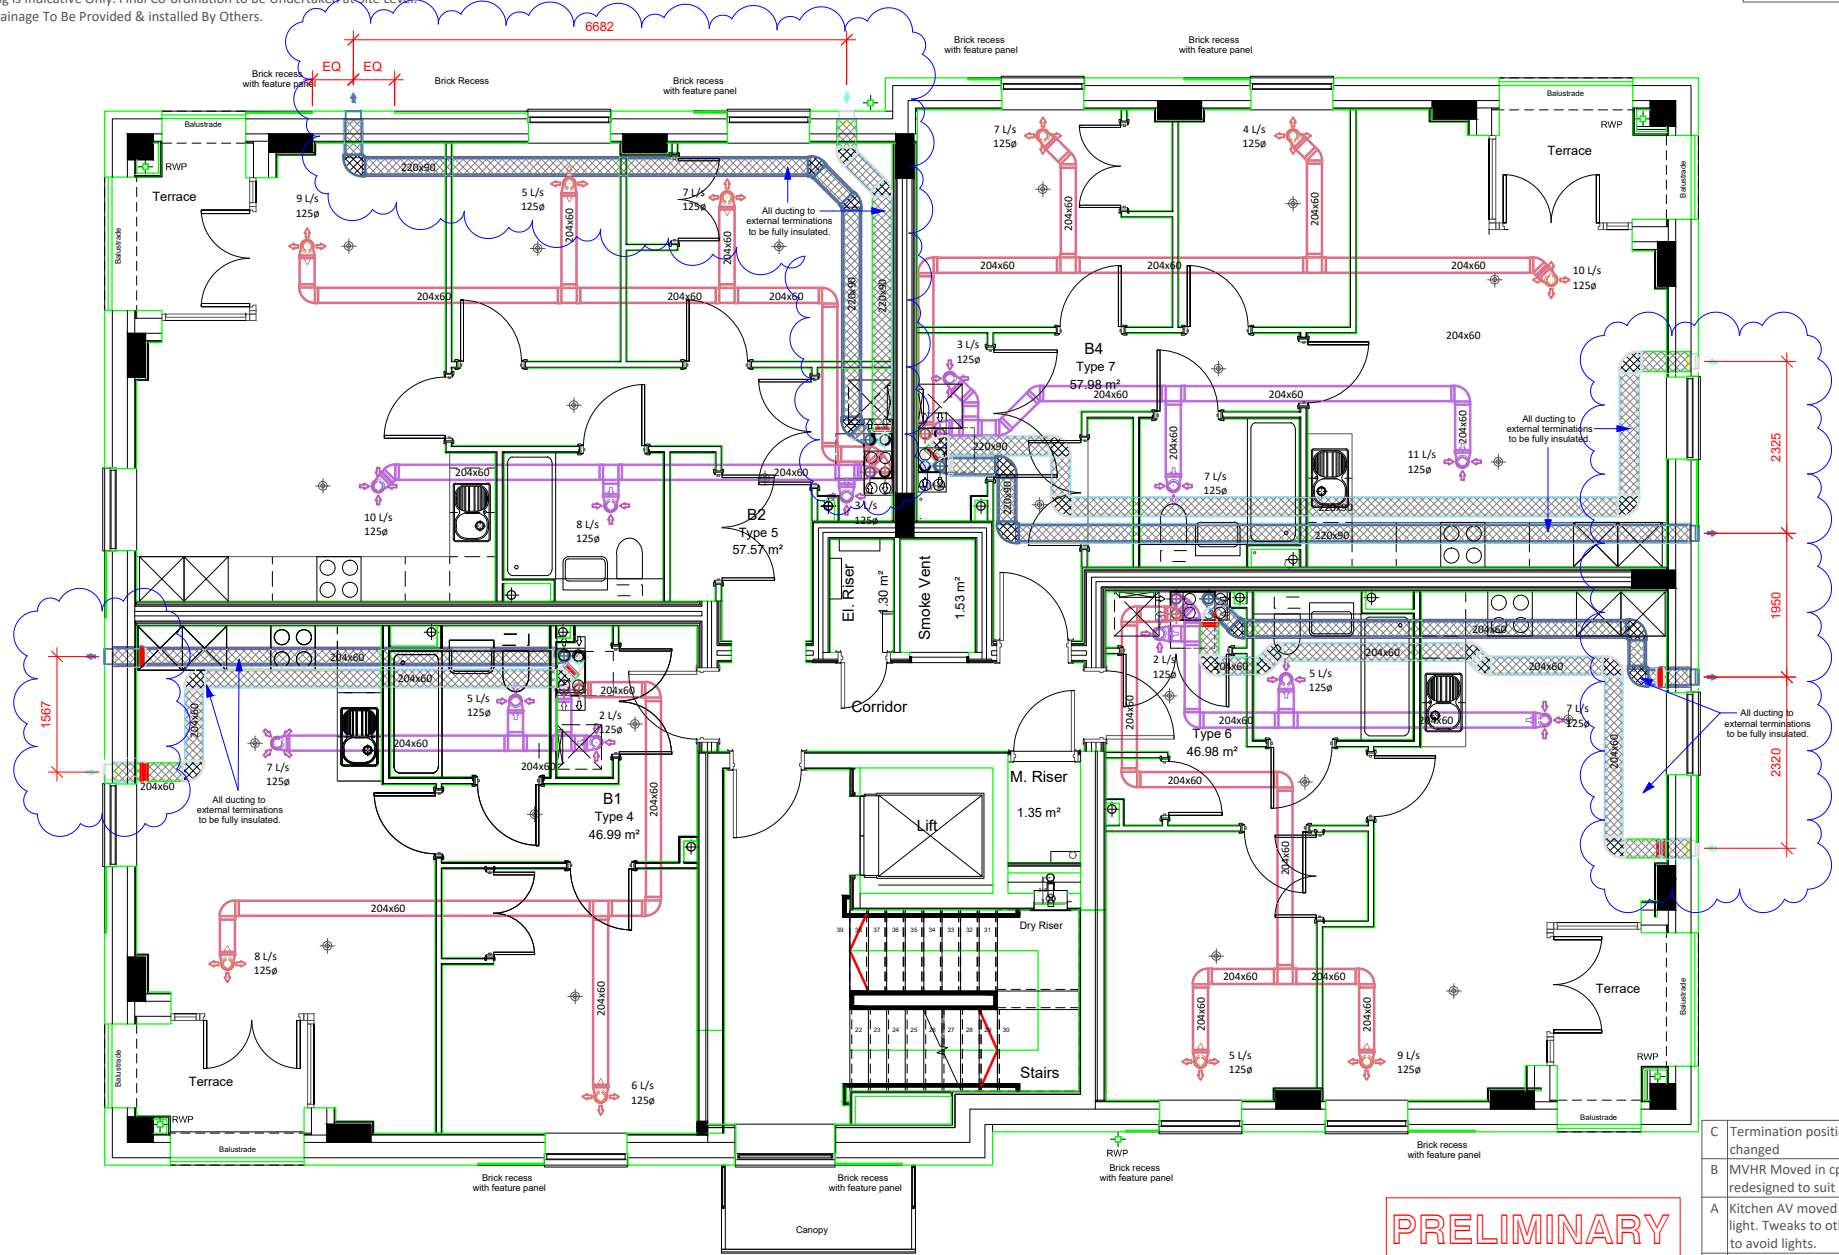

1 1st Floor Ducting Block B
1 : 50

Vectaire Limited
Hampden Building
Lincoln Road
Cressex Business Park
High Wycombe
Buck HP12 3RH
Tel 01494 522333
E-mail: estimating@vectaire.co.uk

Drawn by:- S Blackwell
Checked by:- Ben Miller
Date:- 1st February 2022
Scale:- As indicated @ A3

This drawing, its contents & its associated
properties are the property of Vectaire Ltd. No
Reproduction is permitted without prior written
consent by the management of Vectaire Ltd.

Project:-
Eastleigh Post Office


C	Termination positions changed	SPB	09/05/22
B	MVHR Moved in cpd. Duct redesigned to suit	SPB	19/04/22
A	Kitchen AV moved to avoid light. Tweaks to other duct to avoid lights.	SPB	28/02/22
Rev	Description	By	Date

Title:-
Block B 1st Floor Duct Layouts

Drawing Number:-
V1-395-B1
Revision:-
C

- Notes:-
- 1) All Loft and unheated void ducting fitted with Insulated Duct Wrap.
 - 1.1. MEV Terminations- last 1500mm of ducting fitted with Insulated Duct Wrap.
 - 1.2. MVHR Terminations - All exhaust and fresh air ducting fitted with Insulated Duct Wrap.
 - 2) Duct Positioning is Indicative Only. Final Co-ordination to be Undertaken at Site Level.
 - 3) Condensate Drainage To Be Provided & installed By Others.

THIS DRAWING IS FOR
APPROVAL ONLY
TO BE CHECKED WITH
DESIGN CO-ORDINATOR

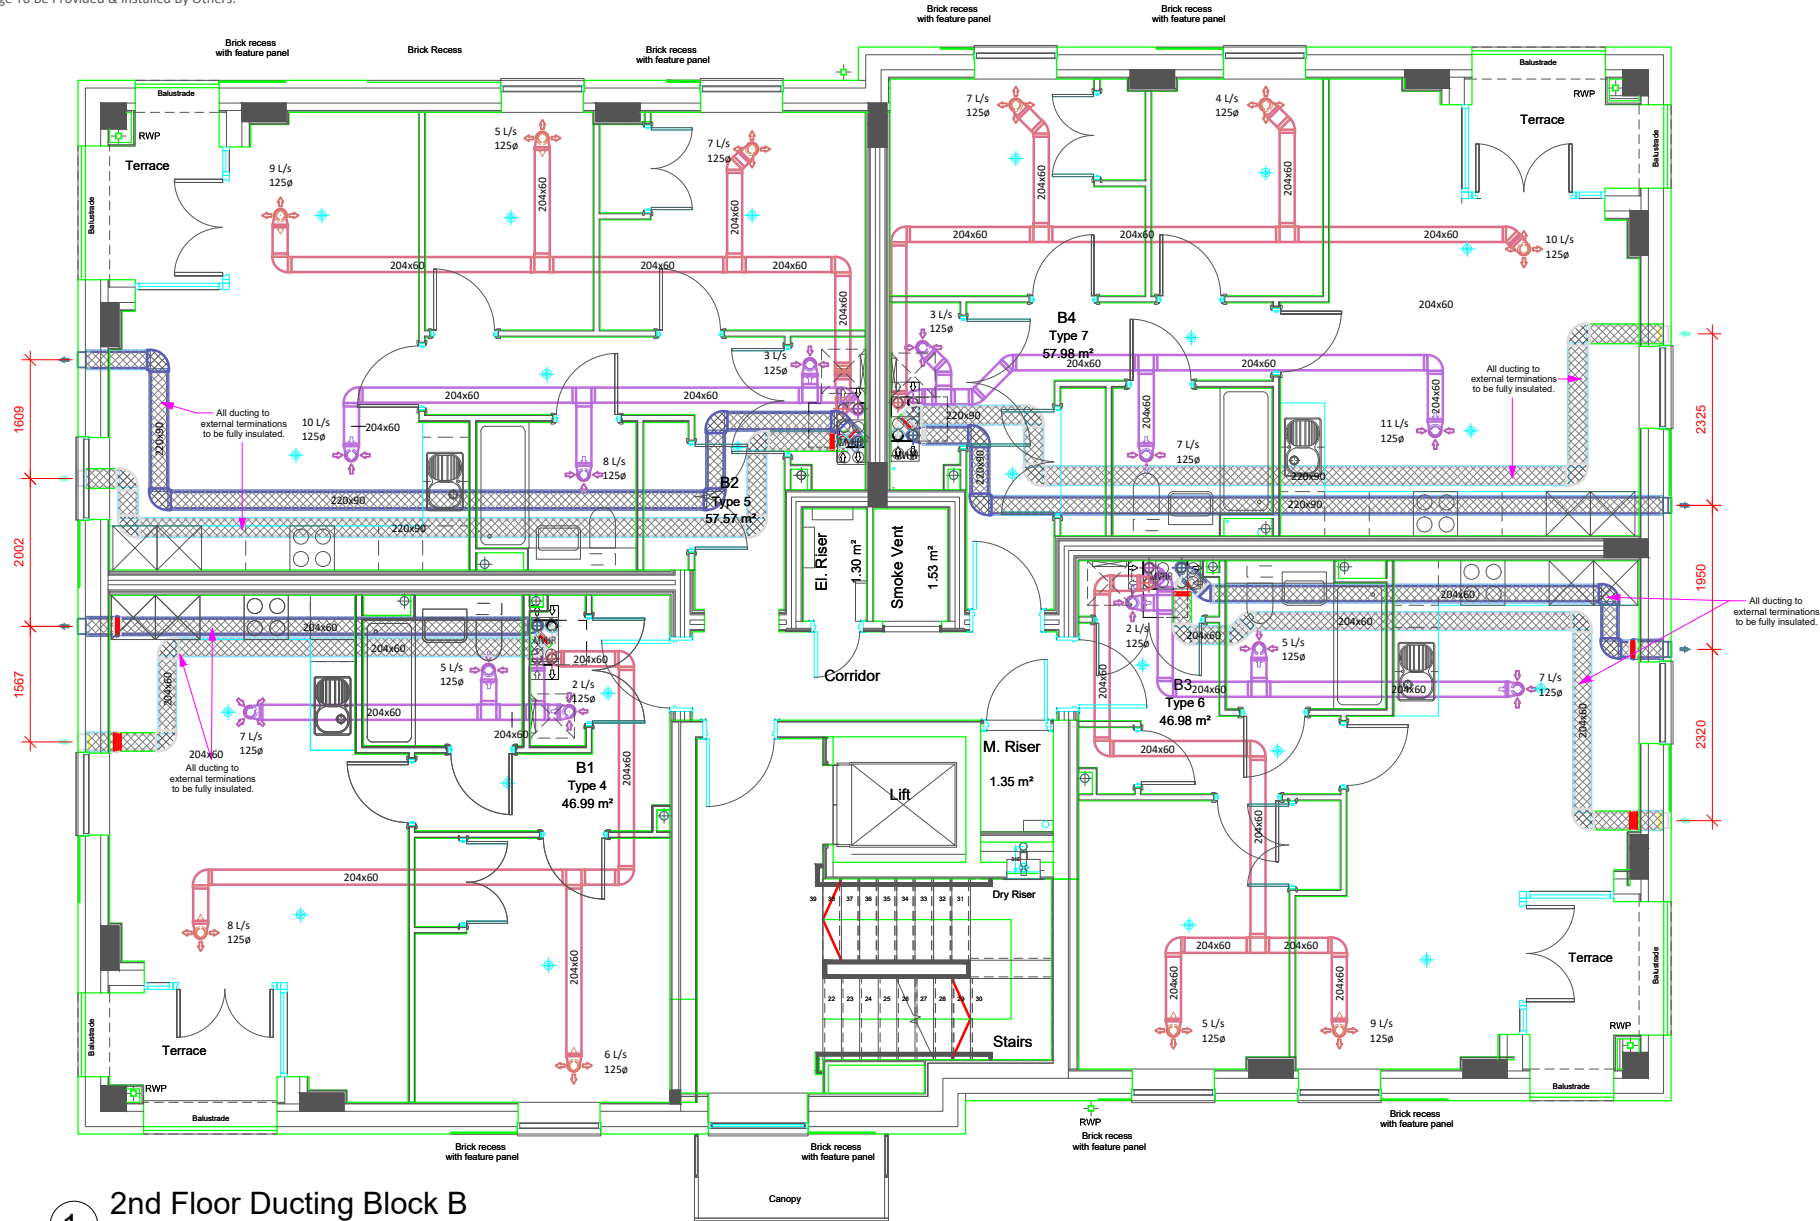

1 2nd Floor Ducting Block B
1 : 50

Vectaire Limited
Hampden Building
Lincoln Road
Cressex Business Park
High Wycombe
Buck HP12 3RH
Tel 01494 522333
E-mail: estimating@vectaire.co.uk

Drawn by:- S Blackwell
Checked by:- Ben Miller
Date:- 9th May 2022
Scale:- As indicated @ A3

This drawing, its contents & its associated properties are the property of Vectaire Ltd. No reproduction is permitted without prior written consent by the management of Vectaire Ltd.


Project:- Eastleigh Post Office

Rev	Description	By	Date
	Title:- Block B 2nd Floor Duct Layouts		
	Drawing Number:- V1-395-B2		
	Revision:-		

Notes:-

- 1) All Loft and unheated void ducting fitted with Insulated Duct Wrap.
1.1. MEV Terminations- last 1500mm of ducting fitted with Insulated Duct Wrap.
1.2. MVHR Terminations - All exhaust and fresh air ducting fitted with Insulated Duct Wrap.
- 2) Duct Positioning is Indicative Only. Final Co-ordination to be Undertaken at Site Level.
- 3) Condensate Drainage To Be Provided & installed by Others.

THIS DRAWING IS FOR
APPROVAL ONLY
TO BE CHECKED WITH
DESIGN CO-ORDINATOR

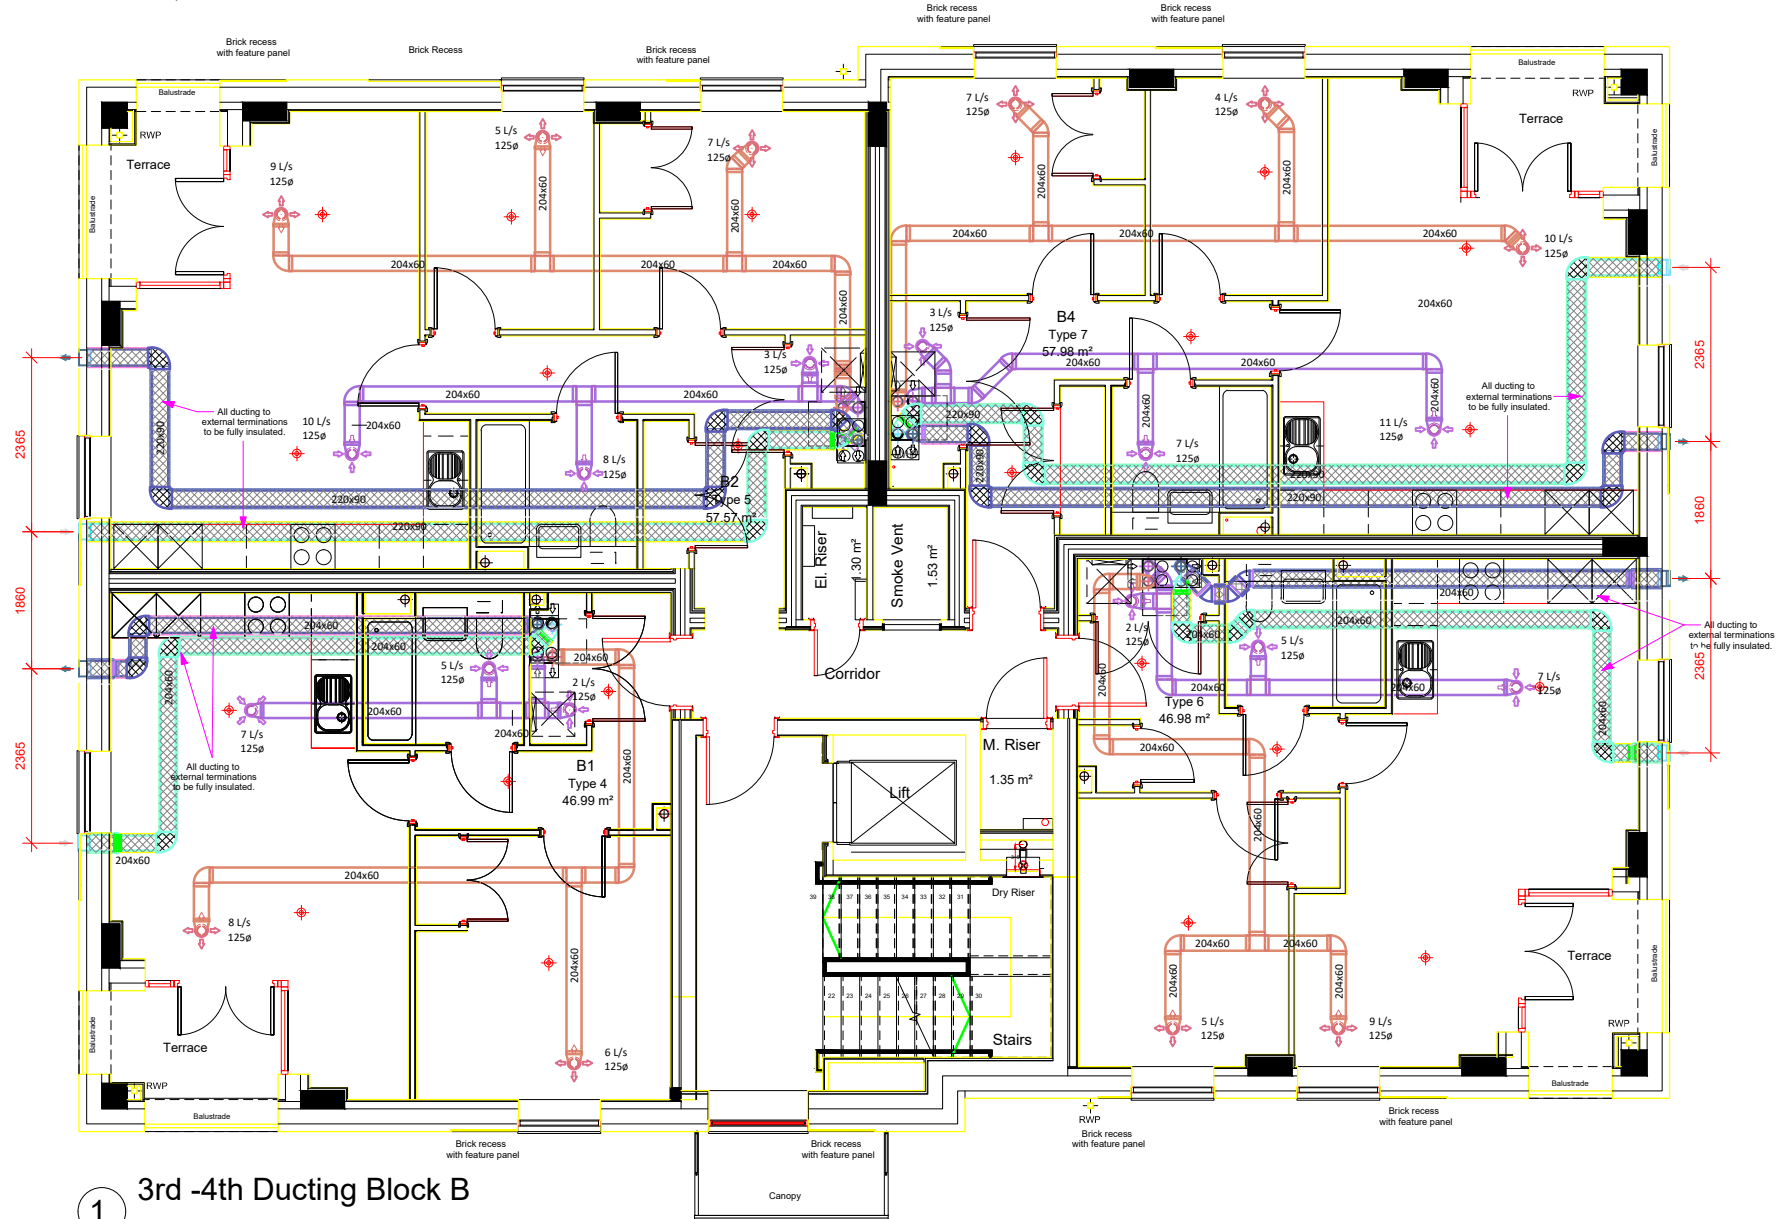

1 3rd -4th Ducting Block B
1 : 50

Vectaire Limited
Hampden Building
Lincoln Road
Cressex Business Park
High Wycombe
Buck HP12 3RH
Tel 01494 522333
E-mail: estimating@vectaire.co.uk

Drawn by:- S Blackwell
Checked by:- Ben Miller
Date:- 9th May 2022
Scale:- As indicated @ A3

This drawing, its contents & its associated
properties are the property of Vectaire Ltd. No
Reproduction is permitted without prior written
consent by the management of Vectaire Ltd.


Project:-
Eastleigh Post Office

Rev	Description	By	Date
	Title:- Block B 3rd/4th Floor Duct Layout		
	Drawing Number:- V1-395-B3	Revision:-	

Notes:-

- 1) All Loft and unheated void ducting fitted with Insulated Duct Wrap.
1.1. MEV Terminations- last 1500mm of ducting fitted with Insulated Duct Wrap.
1.2. MVHR Terminations - All exhaust and fresh air ducting fitted with Insulated Duct Wrap.
2) Duct Positioning is Indicative Only. Final Co-ordination to be Undertaken at Site Level.
3) Condensate Drainage To be Provided & Installed By Others.

THIS DRAWING IS FOR
APPROVAL ONLY
TO BE CHECKED WITH
DESIGN CO-ORDINATOR

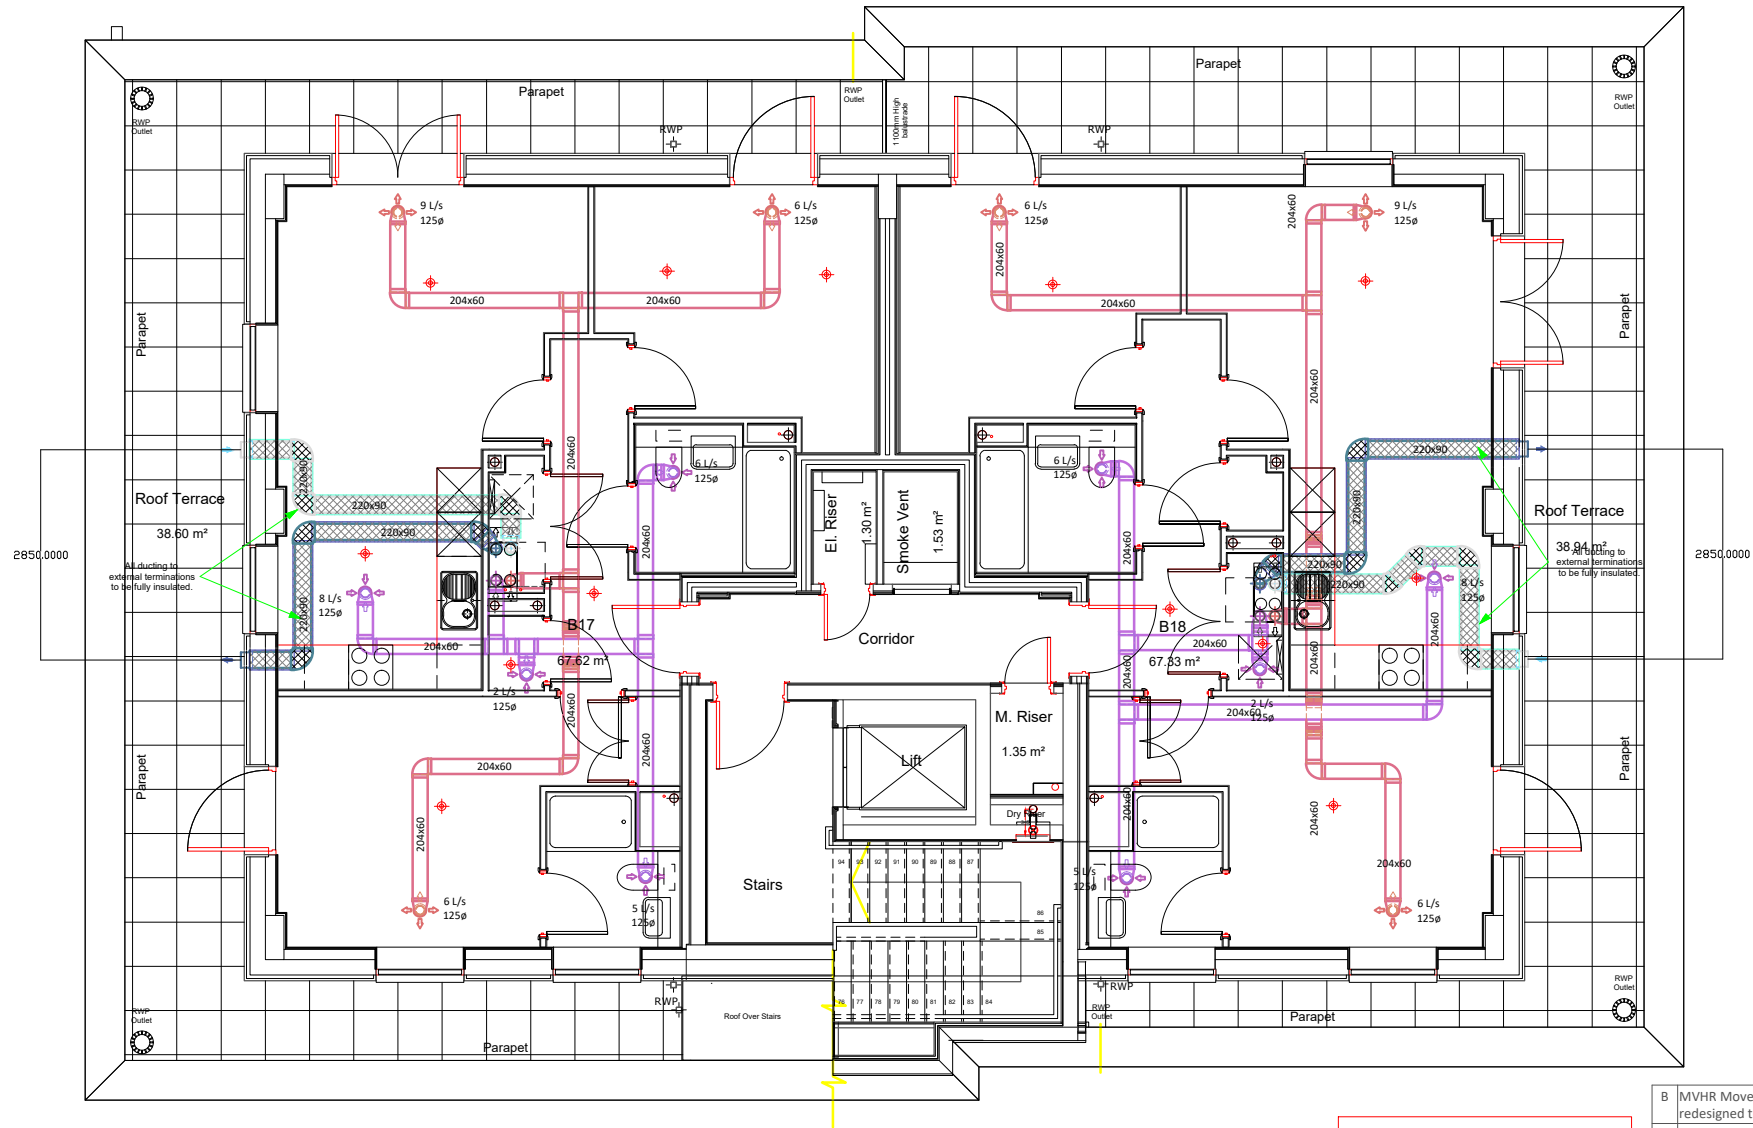

PRELIMINARY

5th Duct Layouts Block B
1 : 50

Vectaire Limited
Hampden Building
Lincoln Road
Cressex Business Park
High Wycombe
Buck HP12 3RH
Tel 01494 522333
E-mail: estimating@vectaire.co.uk

Drawn by:- S Blackwell
Checked by:- Ben Miller
Date:- 02/01/22
Scale:- As indicated @ A3

This drawing, its contents & its associated
properties are the property of Vectaire Ltd. No
Reproduction is permitted without prior written
consent by the management of Vectaire Ltd.

Project:-
Eastleigh Post Office

Rev	Description	By	Date
B	MVHR Moved in cpd. Duct redesigned to suit	SPB	19/04/22
A	Kitchen AV moved to avoid light. Tweaks to other duct to avoid lights.	SPB	28/02/22

Title:-
Block B 5th Floor Duct Layouts

Drawing Number:-
V1-395-B5

Revision:-
B