




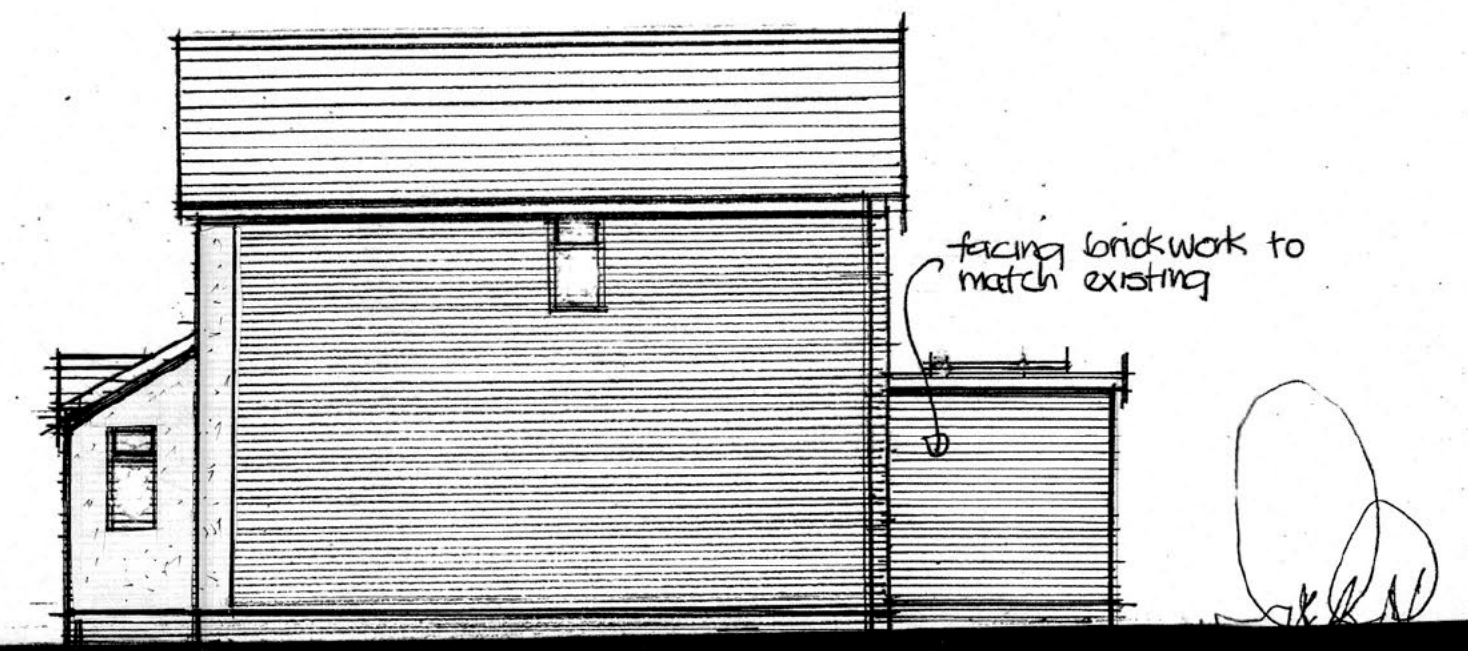


side elevation

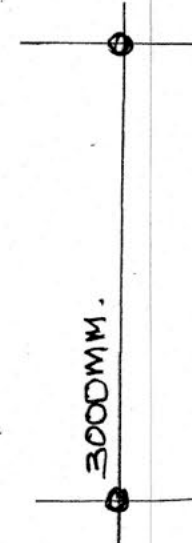

groundfloor plan



first floor plan

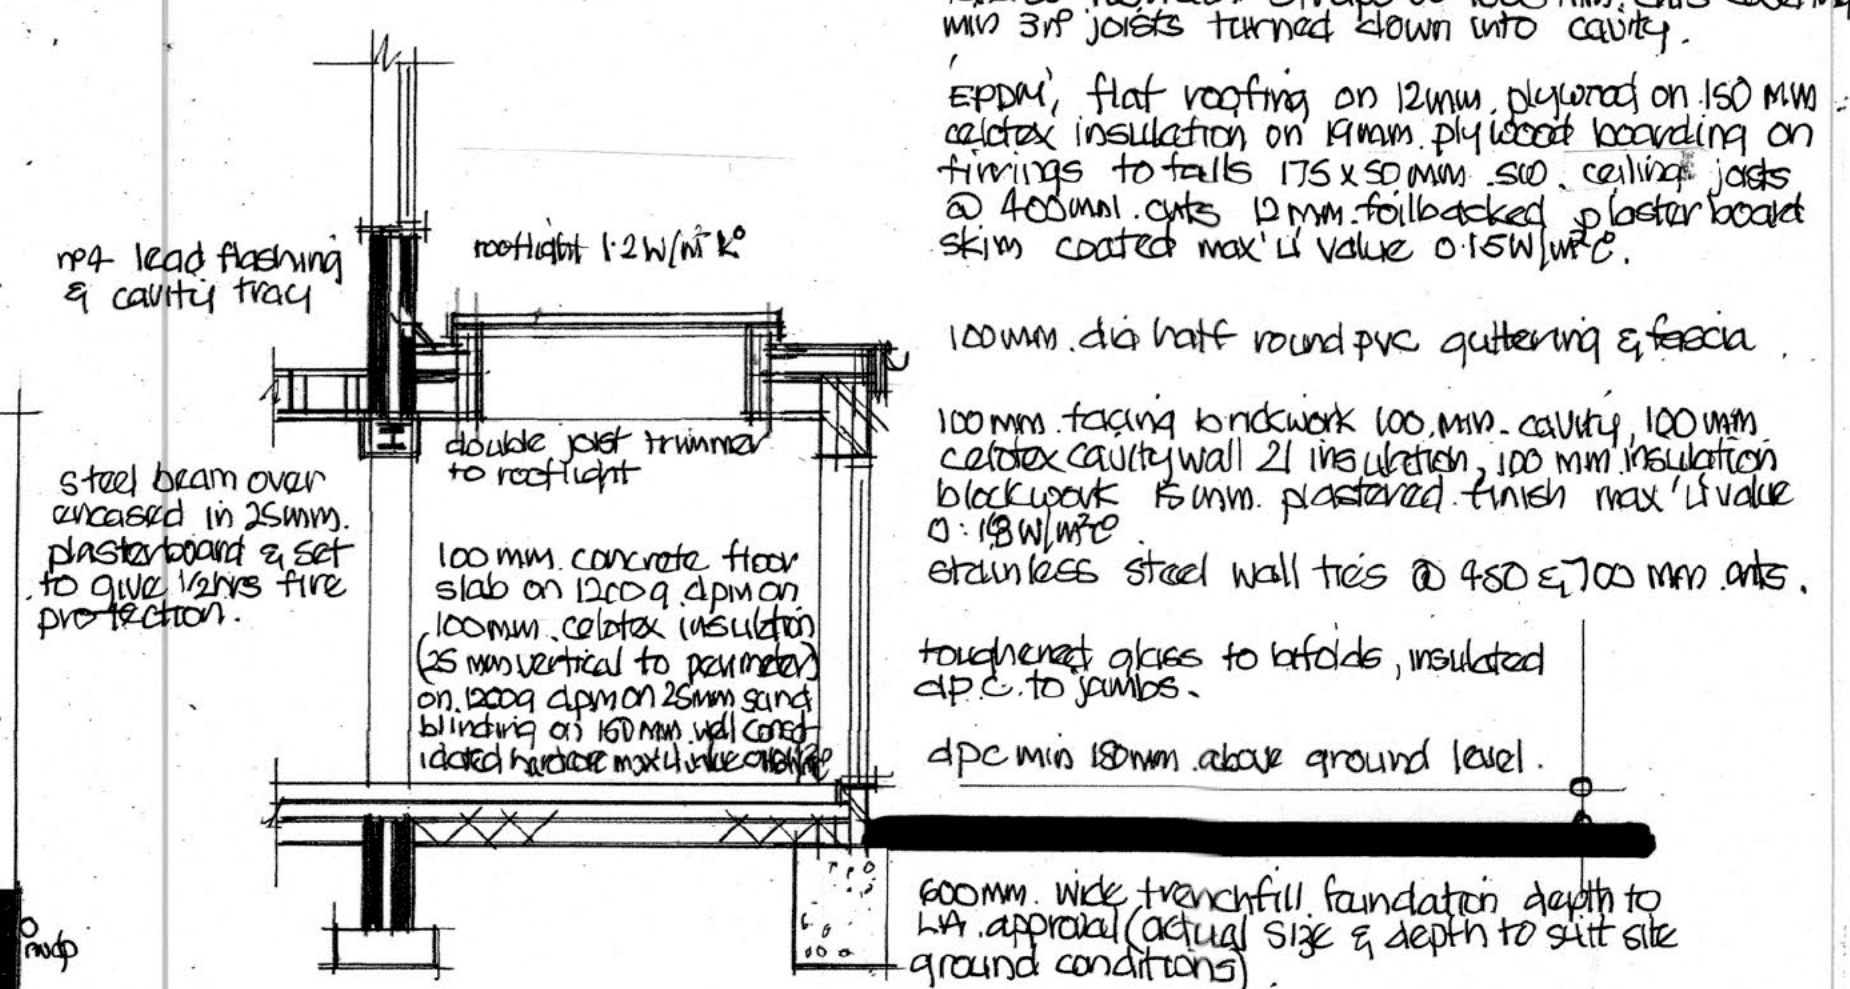

section a-a

600mm. wide trenchfill foundation depth to
LA approval (actual size & depth to suit site
ground conditions)

Heating - Gas fired boiler SUDEUK rating 'A' for supply of space heating & hot water needs. Thermostatic radiator valves, gas certificate provided on completion. All to BS 5588.

Drawing title

Proposed alterations and extension,
10 Lower New Road, West End,
Hants, SO30 3FL.

scale 1:50 1:100 @ A1.

Date December 22

Drawing re
N.R.02

stormwater - To discharge into existing stormwater system or 100mm dia pvc stormwater drain to discharge into soakaways min. 5m from any buildings, min. size of soakaway 1m² subject to percolation test.

Windows & doors — double glazed windows acrylic cougars, linbks over all openings insulated dpc to jambs, opening lights equal to 1/20 th floor area, trickle vent to behd equal to 8000mm² Inhabitable rooms means of escape windows min clear opening size 450 x 500mm, max L/V value 1:20 m²/m² G.

B) clients amendments 16/01/23
A) clients amendments 9-01-23