


Schedule						
Symbol	Label	Image	Quantity	Catalog Number	Description	Lumens Per Lamp
	AW		4	DSX0.1.LA063.NR	Wall Mounted @ 6m 0" Tilt	5529
	BW		3	DSX0.1.LA103.AY	Wall Mounted @ 6m 0" Tilt	8732
	C1		2	DSX0.1.LA133.SY	Column Mounted @8m 0" Tilt	12802
	DW		8	DWL1.LA013.HN.W007	Wall Mounted @ 3.5m	840
	EW		4	DSX1.2.LA223.AY	Wall Mounted @ 8m 0" Tilt	21869
	F1		4	DSX0.1.LA103.BLC	Column Mounted @ 6m 0" Tilt, with Shield	7366
	GW		10	WAP.1.LA063.AY	Wall Mounted @ 6m	5244
	HW		14	DWL1.LA043.NR.W025	Wall Mounted @ 3.5m	3645

Note
Design to be confirmed on elevations.

Statistics					
Description	Symbol	Avg	Max	Min	Min/Avg
Unit 1-2 Perimeter	+	20 lux	53 lux	7 lux	0.35
Unit 1-2 Service Road	+	19 lux	43 lux	7 lux	0.37
Unit 1 Car Park	+	36 lux	93 lux	15 lux	0.42
Unit 1 Entrance	+	77 lux	92 lux	65 lux	0.84
Unit 1 Entrance Stairs	+	66 lux	73 lux	56 lux	0.85
Unit 1 Loading Bay	+	56 lux	72 lux	46 lux	0.82
Unit 1 Rear Car Park	+	24 lux	40 lux	12 lux	0.50
Unit 1 Service Yard	+	45 lux	71 lux	18 lux	0.40
Unit 1 Steps	+	66 lux	66 lux	66 lux	1.00
Unit 2 Car Park	+	37 lux	86 lux	20 lux	0.54
Unit 2 Entrance	+	76 lux	83 lux	69 lux	0.91
Unit 2 Entrance Stairs	+	67 lux	73 lux	57 lux	0.85
Unit 2 Loading Bay	+	55 lux	71 lux	46 lux	0.84
Unit 2 Service Yard	+	45 lux	71 lux	19 lux	0.42
Unit 2 Steps	+	64 lux	64 lux	64 lux	1.00
Unit 3-7 Entrances	+	55 lux	61 lux	45 lux	0.82
Unit 3-7 Loading Bays	+	75 lux	85 lux	70 lux	0.93
Unit 3-7 Loading Bays	+	56 lux	77 lux	33 lux	0.59
Unit 3-7 Loading Bays	+	78 lux	93 lux	72 lux	0.92
Unit 3-7 Parking	+	48 lux	110 lux	12 lux	0.25
Unit 3-7 Perimeter	+	16 lux	72 lux	6 lux	0.38
Unit 3-12 Service Road	+	16 lux	22 lux	7 lux	0.44
Unit 8-12 Bike Racks	+	30 lux	30 lux	29 lux	0.97
Unit 8-12 Car Park	+	31 lux	77 lux	12 lux	0.39
Unit 8-12 Car Park	+	41 lux	88 lux	21 lux	0.51
Unit 8-12 Car Park	+	45 lux	96 lux	15 lux	0.33
Unit 8-12 Entrances	+	60 lux	69 lux	40 lux	0.67
Unit 8-12 Service Yard	+	38 lux	74 lux	19 lux	0.50
Unit 8-12 Service Yard	+	35 lux	76 lux	15 lux	0.43
Unit 8-12 Service Yard	+	24 lux	62 lux	10 lux	0.42
Units 3-7 Service Yard	+	27 lux	58 lux	11 lux	0.41
Units 3-7 Service Yard	+	38 lux	70 lux	17 lux	0.45
Units 3-7 Service Yard	+	40 lux	68 lux	21 lux	0.53
Units 8-12 Perimeter	+	7 lux	32 lux	2 lux	0.29
Units 8-12 Loading Bays	+	75 lux	89 lux	68 lux	0.91
Units 8-12 Loading Bays	+	82 lux	93 lux	76 lux	0.93
Units 8-12 Loading Bays	+	62 lux	87 lux	37 lux	0.60
Spill	+	0 lux	19 lux	0 lux	N/A

Note
Holophane Europe Ltd offer a Lighting Design Service in good faith and without charge, every effort is made to ensure we interpret the design specification accurately. All illuminance values shown are the result of theoretical computer calculations; summated by luminaires positioned in a fixed relationship to each other and the statistical zone. In practice the values may vary due to tolerances in column installation, luminaire orientation, surface reflectance and fluctuations in power supply (voltage).Results provided within this design are derived from product specific photometry, the substitution of alternative luminaires will not produce comparable results.

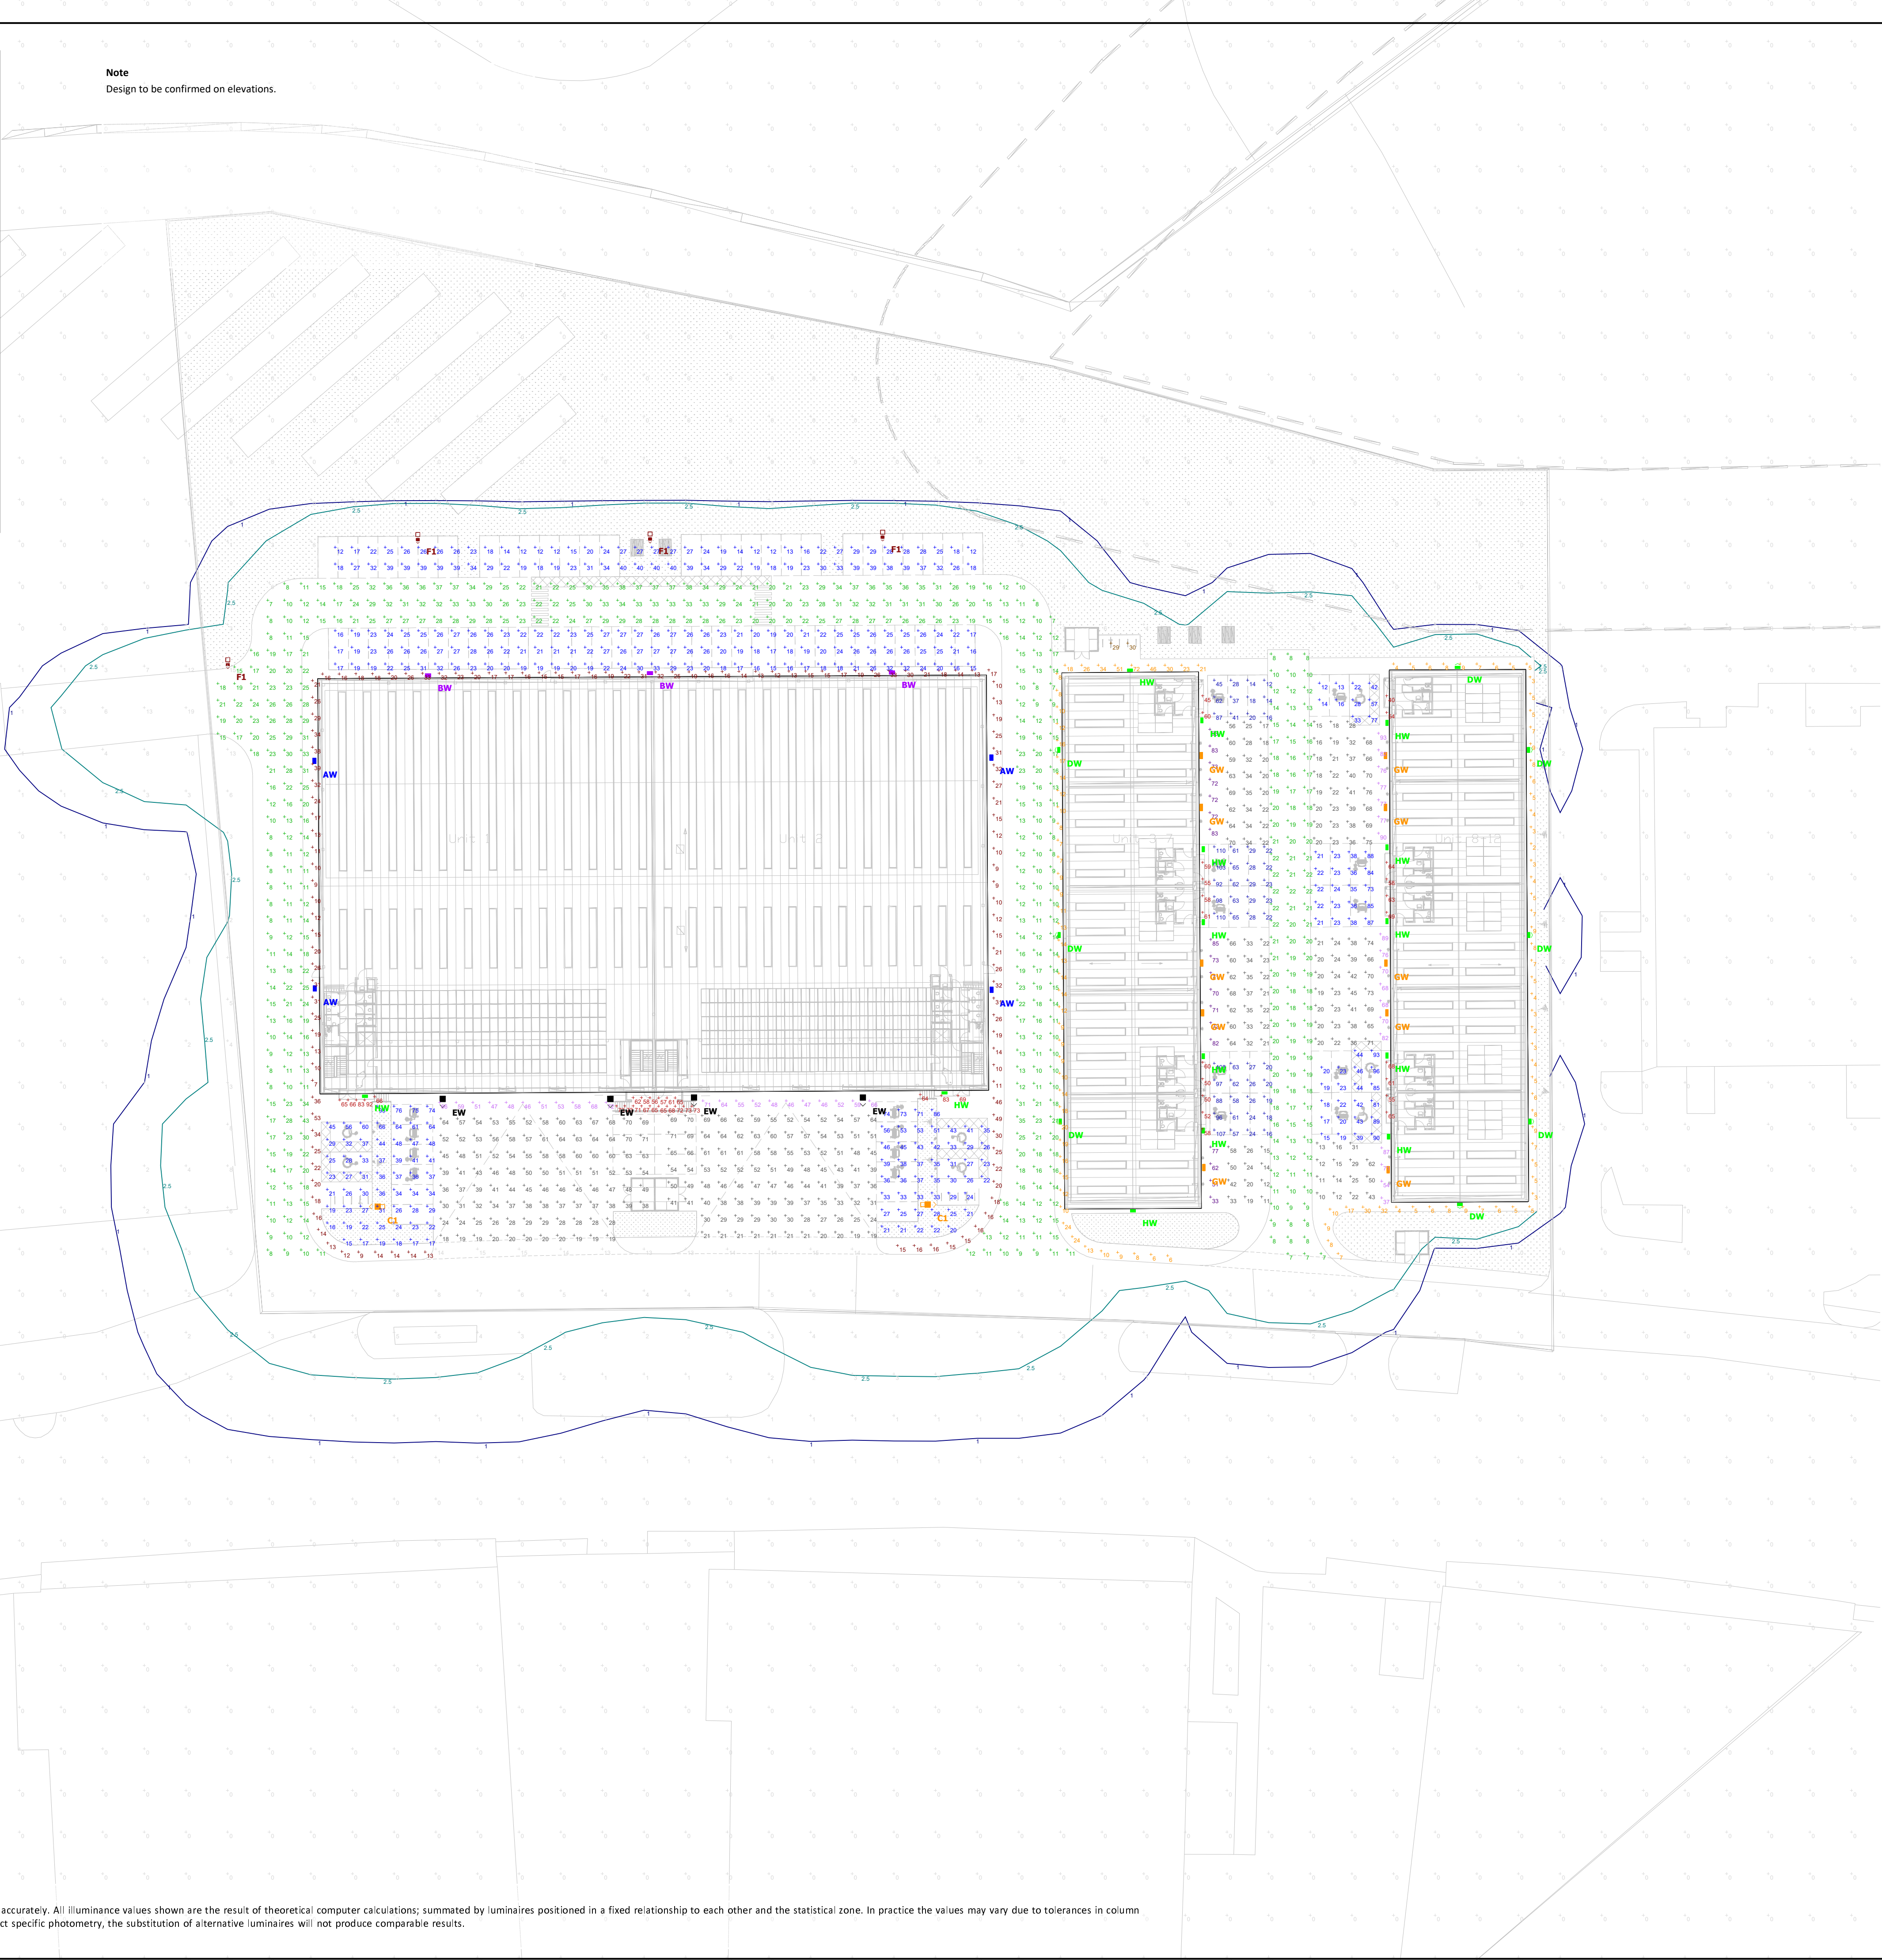


Schedule						
Symbol	Label	Quantity	Catalog Number	Description	Lumens Per Lamp	Wattage
	AW	4	DSX0.1.LA063.NR	Wall Mounted @ 6m 0" Tilt	5529	45
	BW	3	DSX0.1.LA103.AY	Wall Mounted @ 6m 0" Tilt	8732	81
	C1	2	DSX0.1.LA133.SY	Column Mounted @8m 0" Tilt	12802	107
	DW	8	DWL.1.LA013.HN.W007	Wall Mounted @ 3.5m	840	6.5
	EW	4	DSX1.2.LA223.AY	Wall Mounted @ 8m 0" Tilt	21869	200
	F1	4	DSX0.1.LA103.BLC	Column Mounted @ 6m 0" Tilt, with Shield	7366	81
	GW	10	WAP.1.LA063.AY	Wall Mounted @ 6m	5244	50
	HW	14	DWL.1.LA043.NR.W025	Wall Mounted @ 3.5m	3645	25

Note
Design to be confirmed on elevations.

Statistics						
Description	Symbol	Avg	Max	Min	Min/Avg	
Unit 1-2 Perimeter	+	20 lux	53 lux	7 lux	0.35	
Unit 1-2 Service Road	+	19 lux	43 lux	7 lux	0.37	
Unit 1 Car Park	+	36 lux	93 lux	15 lux	0.42	
Unit 1 Entrance	+	77 lux	92 lux	65 lux	0.84	
Unit 1 Entrance Stairs	+	66 lux	73 lux	56 lux	0.85	
Unit 1 Loading Bay	+	56 lux	72 lux	46 lux	0.82	
Unit 1 Rear Car Park	+	24 lux	40 lux	12 lux	0.50	
Unit 1 Service Yard	+	45 lux	71 lux	18 lux	0.40	
Unit 1 Steps	+	66 lux	66 lux	66 lux	1.00	
Unit 2 Car Park	+	37 lux	86 lux	20 lux	0.54	
Unit 2 Entrance	+	76 lux	83 lux	69 lux	0.91	
Unit 2 Entrance Stairs	+	67 lux	73 lux	57 lux	0.85	
Unit 2 Loading Bay	+	55 lux	71 lux	46 lux	0.84	
Unit 2 Service Yard	+	45 lux	71 lux	19 lux	0.42	
Unit 2 Steps	+	64 lux	64 lux	64 lux	1.00	
Unit 3-7 Entrances	+	55 lux	61 lux	45 lux	0.82	
Unit 3-7 Loading Bays	+	75 lux	85 lux	70 lux	0.93	
Unit 3-7 Loading Bays	+	56 lux	77 lux	33 lux	0.59	
Unit 3-7 Loading Bays	+	78 lux	93 lux	72 lux	0.92	
Unit 3-7 Parking	+	48 lux	110 lux	12 lux	0.25	
Unit 3-7 Perimeter	+	16 lux	72 lux	6 lux	0.38	
Unit 3-12 Service Road	+	16 lux	22 lux	7 lux	0.44	
Unit 8-12 Bike Racks	+	30 lux	30 lux	29 lux	0.97	
Unit 8-12 Car Park	+	31 lux	77 lux	12 lux	0.39	
Unit 8-12 Car Park	+	41 lux	88 lux	21 lux	0.51	
Unit 8-12 Car Park	+	45 lux	96 lux	15 lux	0.33	
Unit 8-12 Entrances	+	60 lux	69 lux	40 lux	0.67	
Unit 8-12 Service Yard	+	38 lux	74 lux	19 lux	0.50	
Unit 8-12 Service Yard	+	35 lux	76 lux	15 lux	0.43	
Unit 8-12 Service Yard	+	24 lux	62 lux	10 lux	0.42	
Units 3-7 Service Yard	+	27 lux	58 lux	11 lux	0.41	
Units 3-7 Service Yard	+	38 lux	70 lux	17 lux	0.45	
Units 3-7 Service Yard	+	40 lux	68 lux	21 lux	0.53	
Units 8-12 Perimeter	+	7 lux	32 lux	2 lux	0.29	
Units 8-12 Loading Bays	+	75 lux	89 lux	68 lux	0.91	
Units 8-12 Loading Bays	+	82 lux	93 lux	76 lux	0.93	
Units 8-12 Loading Bays	+	62 lux	87 lux	37 lux	0.60	
Spill	+	0 lux	19 lux	0 lux	N/A	

Note
Holophane Europe Ltd offer a Lighting Design Service in good faith and without charge, every effort is made to ensure we interpret the design specification accurately. All illuminance values shown are the result of theoretical computer calculations; summated by luminaires positioned in a fixed relationship to each other and the statistical zone. In practice the values may vary due to tolerances in column installation, luminaire orientation, surface reflectance and fluctuations in power supply (voltage).Results provided within this design are derived from product specific photometry, the substitution of alternative luminaires will not produce comparable results.

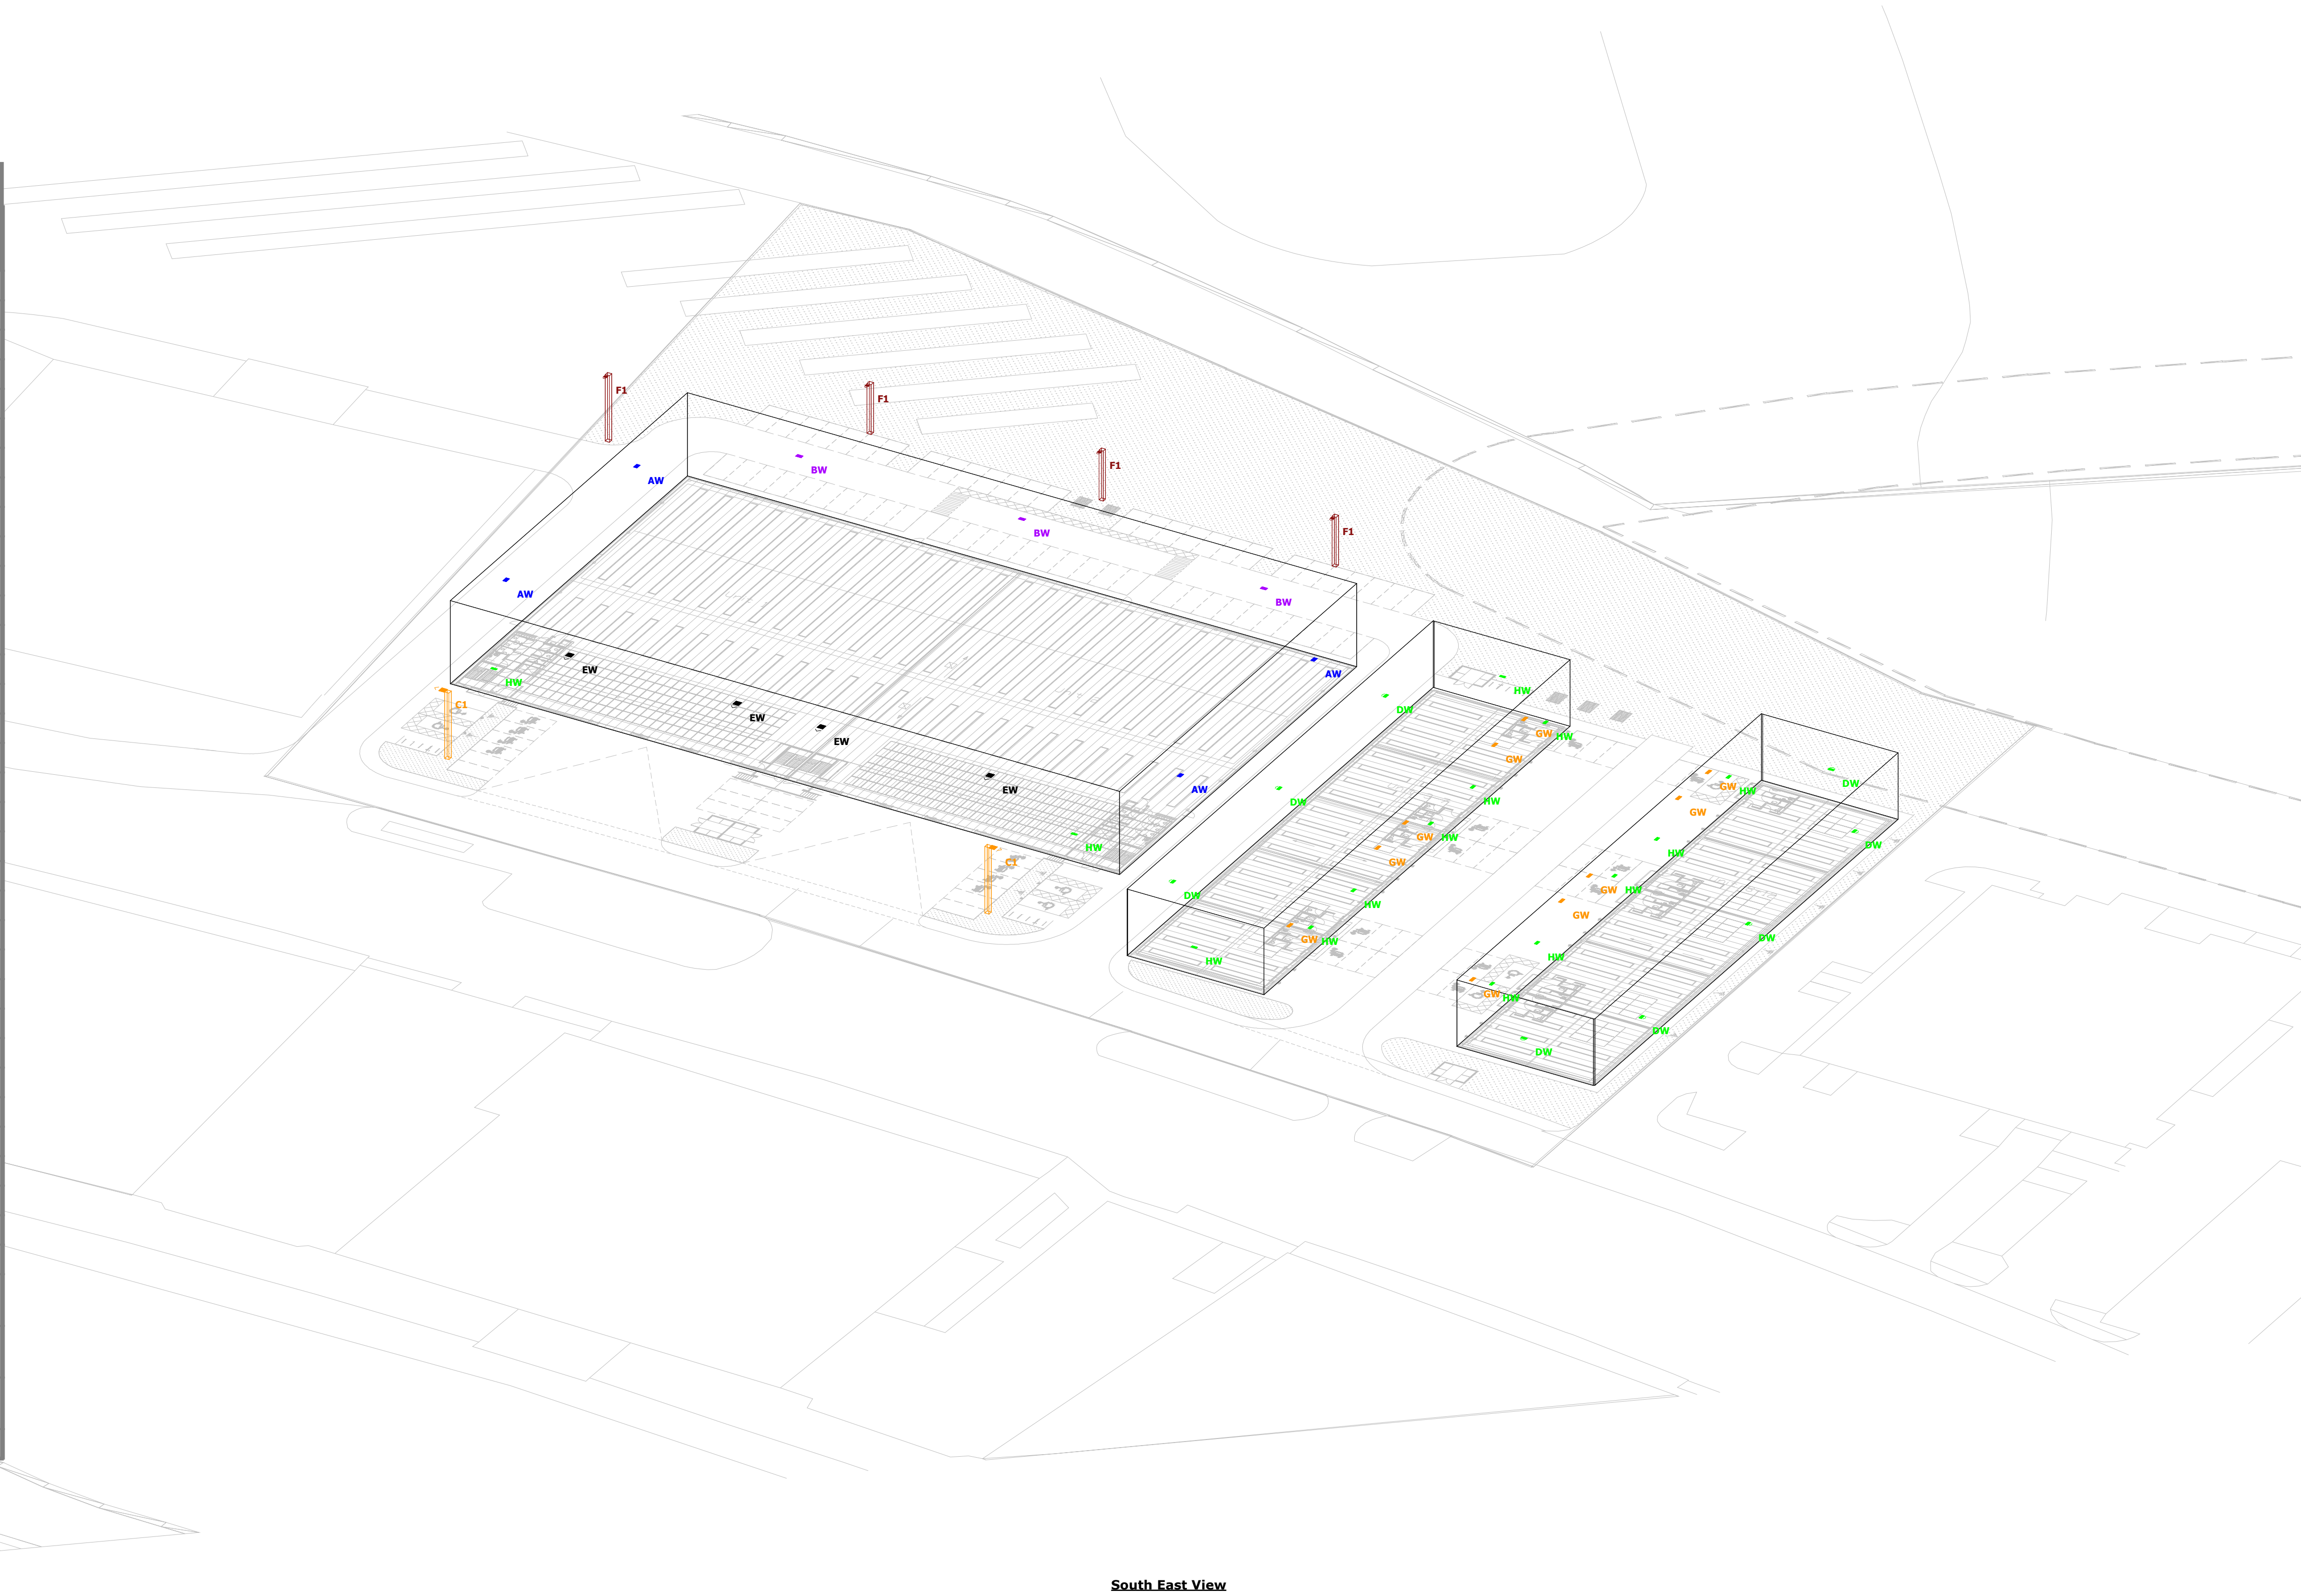

South East View