


Schedule						
Symbol	Label	Image	Quantity	Catalog Number	Description	Lumens Per Lamp Wattage
	AW		6	DSX0.1.LA063.NR	Wall Mounted @ 6m 0° Tilt	5529 45
	B1		3	DSX0.1.LA113.FW	Column Mounted @ 8m 0°Tilt	10809 88
	BW		4	DSX0.1.LA113.FW	Wall Mounted @ 6m 0°Tilt	10809 88
	B2		1	DSX0.1.LA113.FW	Twin Column Mounted @ 8m 0°Tilt	10809 176
	CW		5	DWL1.LA013.HN.W007	Wall Mounted @ 4m	840 6.5
	D1		2	DSX0.1.LA083.FW	Column Mounted @ 8m 0°Tilt	7448 64
	E		4	DBD.1.LA013.SU.NR.LS.W006	Bollard@1m	414 6
	FW		4	DSX0.1.LA153.AY	Wall Mounted @6m 0° Tilt	14366 133
	GW		3	DSX0.1.LA083.AY	Wall Mounted @ 6m 0° Tilt	7242 64

Statistics					
Description	Symbol	Avg	Max	Min	Min/Avg
Unit 1 Car Park		24 lux	46 lux	6 lux	0.25
Unit 1 Circulation Area		32 lux	50 lux	21 lux	0.66
Unit 1 Entrance		71 lux	87 lux	61 lux	0.86
Unit 1 Loading Bay		52 lux	75 lux	41 lux	0.79
Unit 1 Pedestrian Path		25 lux	43 lux	13 lux	0.52
Unit 1 Perimeter		19 lux	35 lux	7 lux	0.37
Unit 1 Service Road		15 lux	33 lux	4 lux	0.27
Unit 1 Service Yard		25 lux	62 lux	11 lux	0.44
Unit 2 Car Park		23 lux	64 lux	6 lux	0.26
Unit 2 Entrance		57 lux	70 lux	47 lux	0.82
Unit 2 Loading Bay		50 lux	63 lux	33 lux	0.66
Unit 2 Perimeter Path		11 lux	36 lux	3 lux	0.27
Unit 2 Service Yard		20 lux	53 lux	8 lux	0.40
Unit 2 West Parking		19 lux	34 lux	8 lux	0.42
Horizontal outer spill		2 lux	12 lux	0 lux	0.00

Note
Design to be confirmed on elevations.

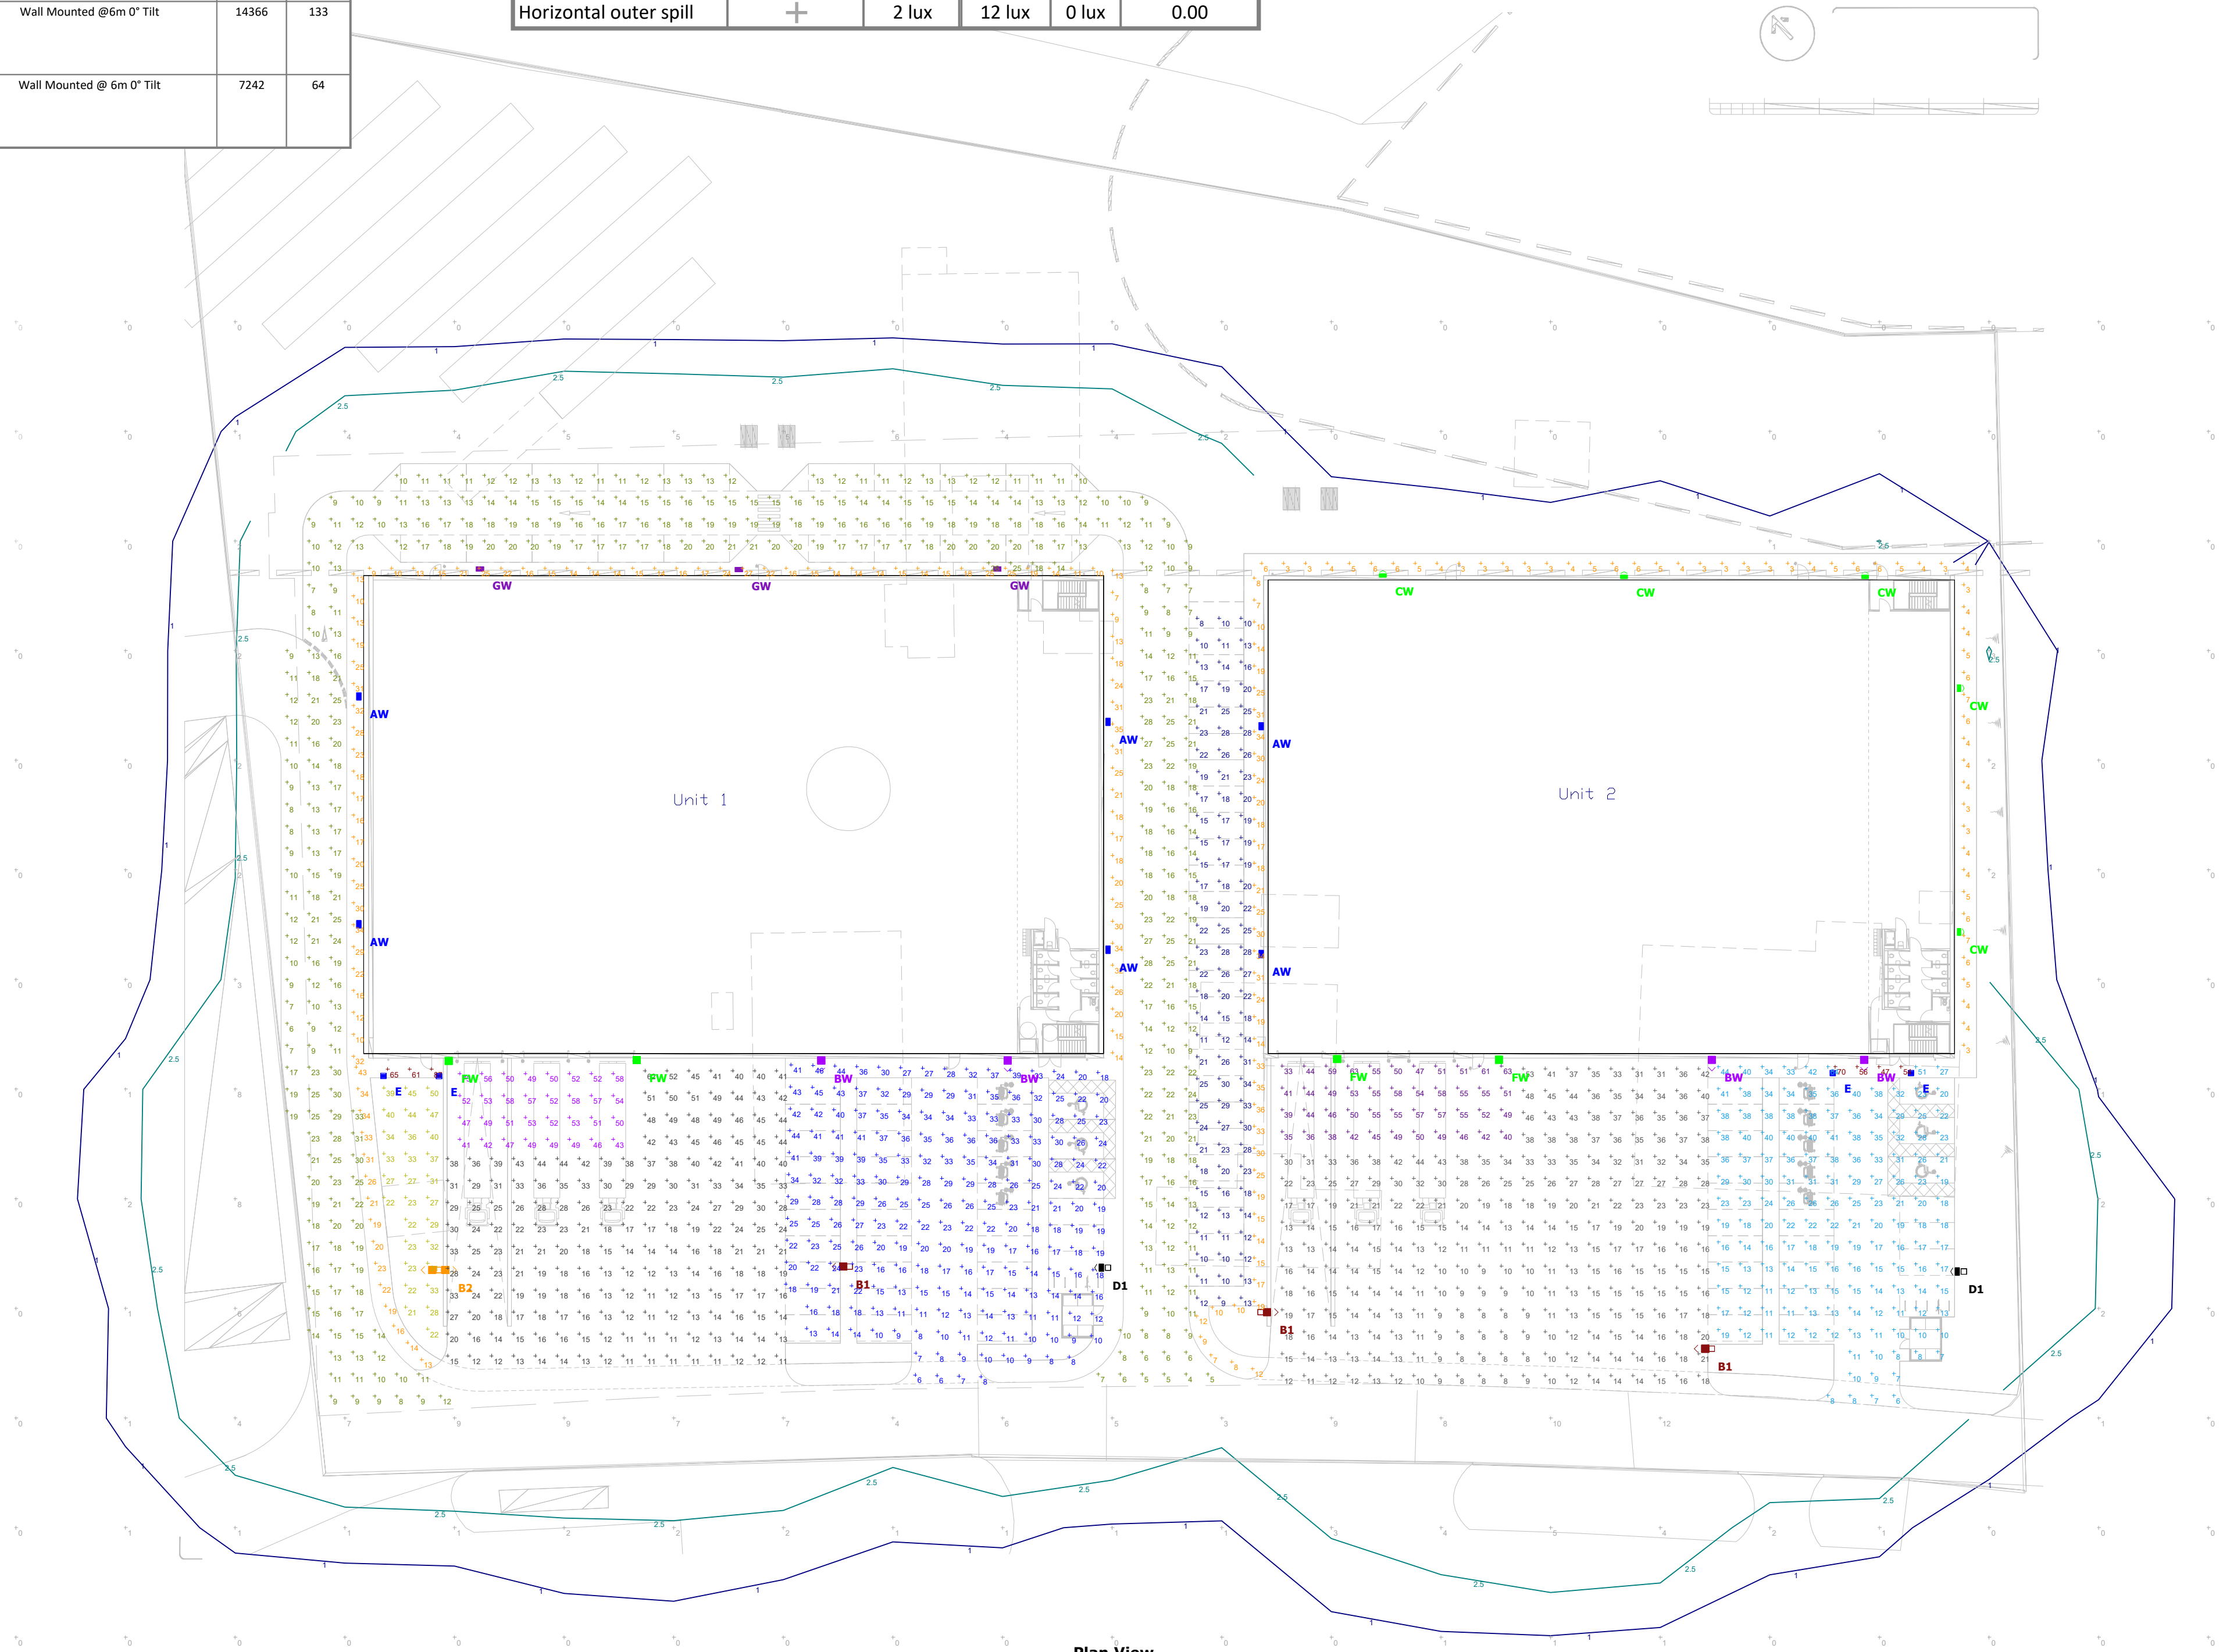


Plan View
Scale - 1 : 400

Note
Holophane Europe Ltd offer a Lighting Design Service in good faith and without charge, every effort is made to ensure we interpret the design specification accurately. All illuminance values shown are the result of theoretical computer calculations; summated by luminaires positioned in a fixed relationship to each other and the statistical zone. In practice the values may vary due to tolerances in column installation, luminaire orientation, surface reflectance and fluctuations in power supply (voltage).Results provided within this design are derived from product specific photometry, the substitution of alternative luminaires will not produce comparable results.

Schedule						
Symbol	Label	Quantity	Catalog Number	Description	Lumens Per Lamp	Wattage
	AW	6	DSX0.1.LA063.NR	Wall Mounted @ 6m 0° Tilt	5529	45
	B1	3	DSX0.1.LA113.FW	Column Mounted @ 8m 0°Tilt	10809	88
	BW	4	DSX0.1.LA113.FW	Wall Mounted @ 6m 0°Tilt	10809	88
	B2	1	DSX0.1.LA113.FW	Twin Column Mounted @ 8m 0°Tilt	10809	176
	CW	5	DWL1.LA013.HN.W007	Wall Mounted @ 4m	840	6.5
	D1	2	DSX0.1.LA083.FW	Column Mounted @ 8m 0°Tilt	7448	64
	E	4	DBD.1.LA013.SU.NR.LS.W006	Bollard@1m	414	6
	FW	4	DSX0.1.LA153.AY	Wall Mounted @6m 0° Tilt	14366	133
	GW	3	DSX0.1.LA083.AY	Wall Mounted @ 6m 0° Tilt	7242	64

Statistics						
Description	Symbol	Avg	Max	Min	Min/Avg	
Unit 1 Car Park		24 lux	46 lux	6 lux	0.25	
Unit 1 Circulation Area		32 lux	50 lux	21 lux	0.66	
Unit 1 Entrance		71 lux	87 lux	61 lux	0.86	
Unit 1 Loading Bay		52 lux	75 lux	41 lux	0.79	
Unit 1 Pedestrian Path		25 lux	43 lux	13 lux	0.52	
Unit 1 Perimeter		19 lux	35 lux	7 lux	0.37	
Unit 1 Service Road		15 lux	33 lux	4 lux	0.27	
Unit 1 Service Yard		25 lux	62 lux	11 lux	0.44	
Unit 2 Car Park		23 lux	64 lux	6 lux	0.26	
Unit 2 Entrance		57 lux	70 lux	47 lux	0.82	
Unit 2 Loading Bay		50 lux	63 lux	33 lux	0.66	
Unit 2 Perimeter Path		11 lux	36 lux	3 lux	0.27	
Unit 2 Service Yard		20 lux	53 lux	8 lux	0.40	
Unit 2 West Parking		19 lux	34 lux	8 lux	0.42	
Horizontal outer spill		2 lux	12 lux	0 lux	0.00	

Note
Design to be confirmed on elevations.

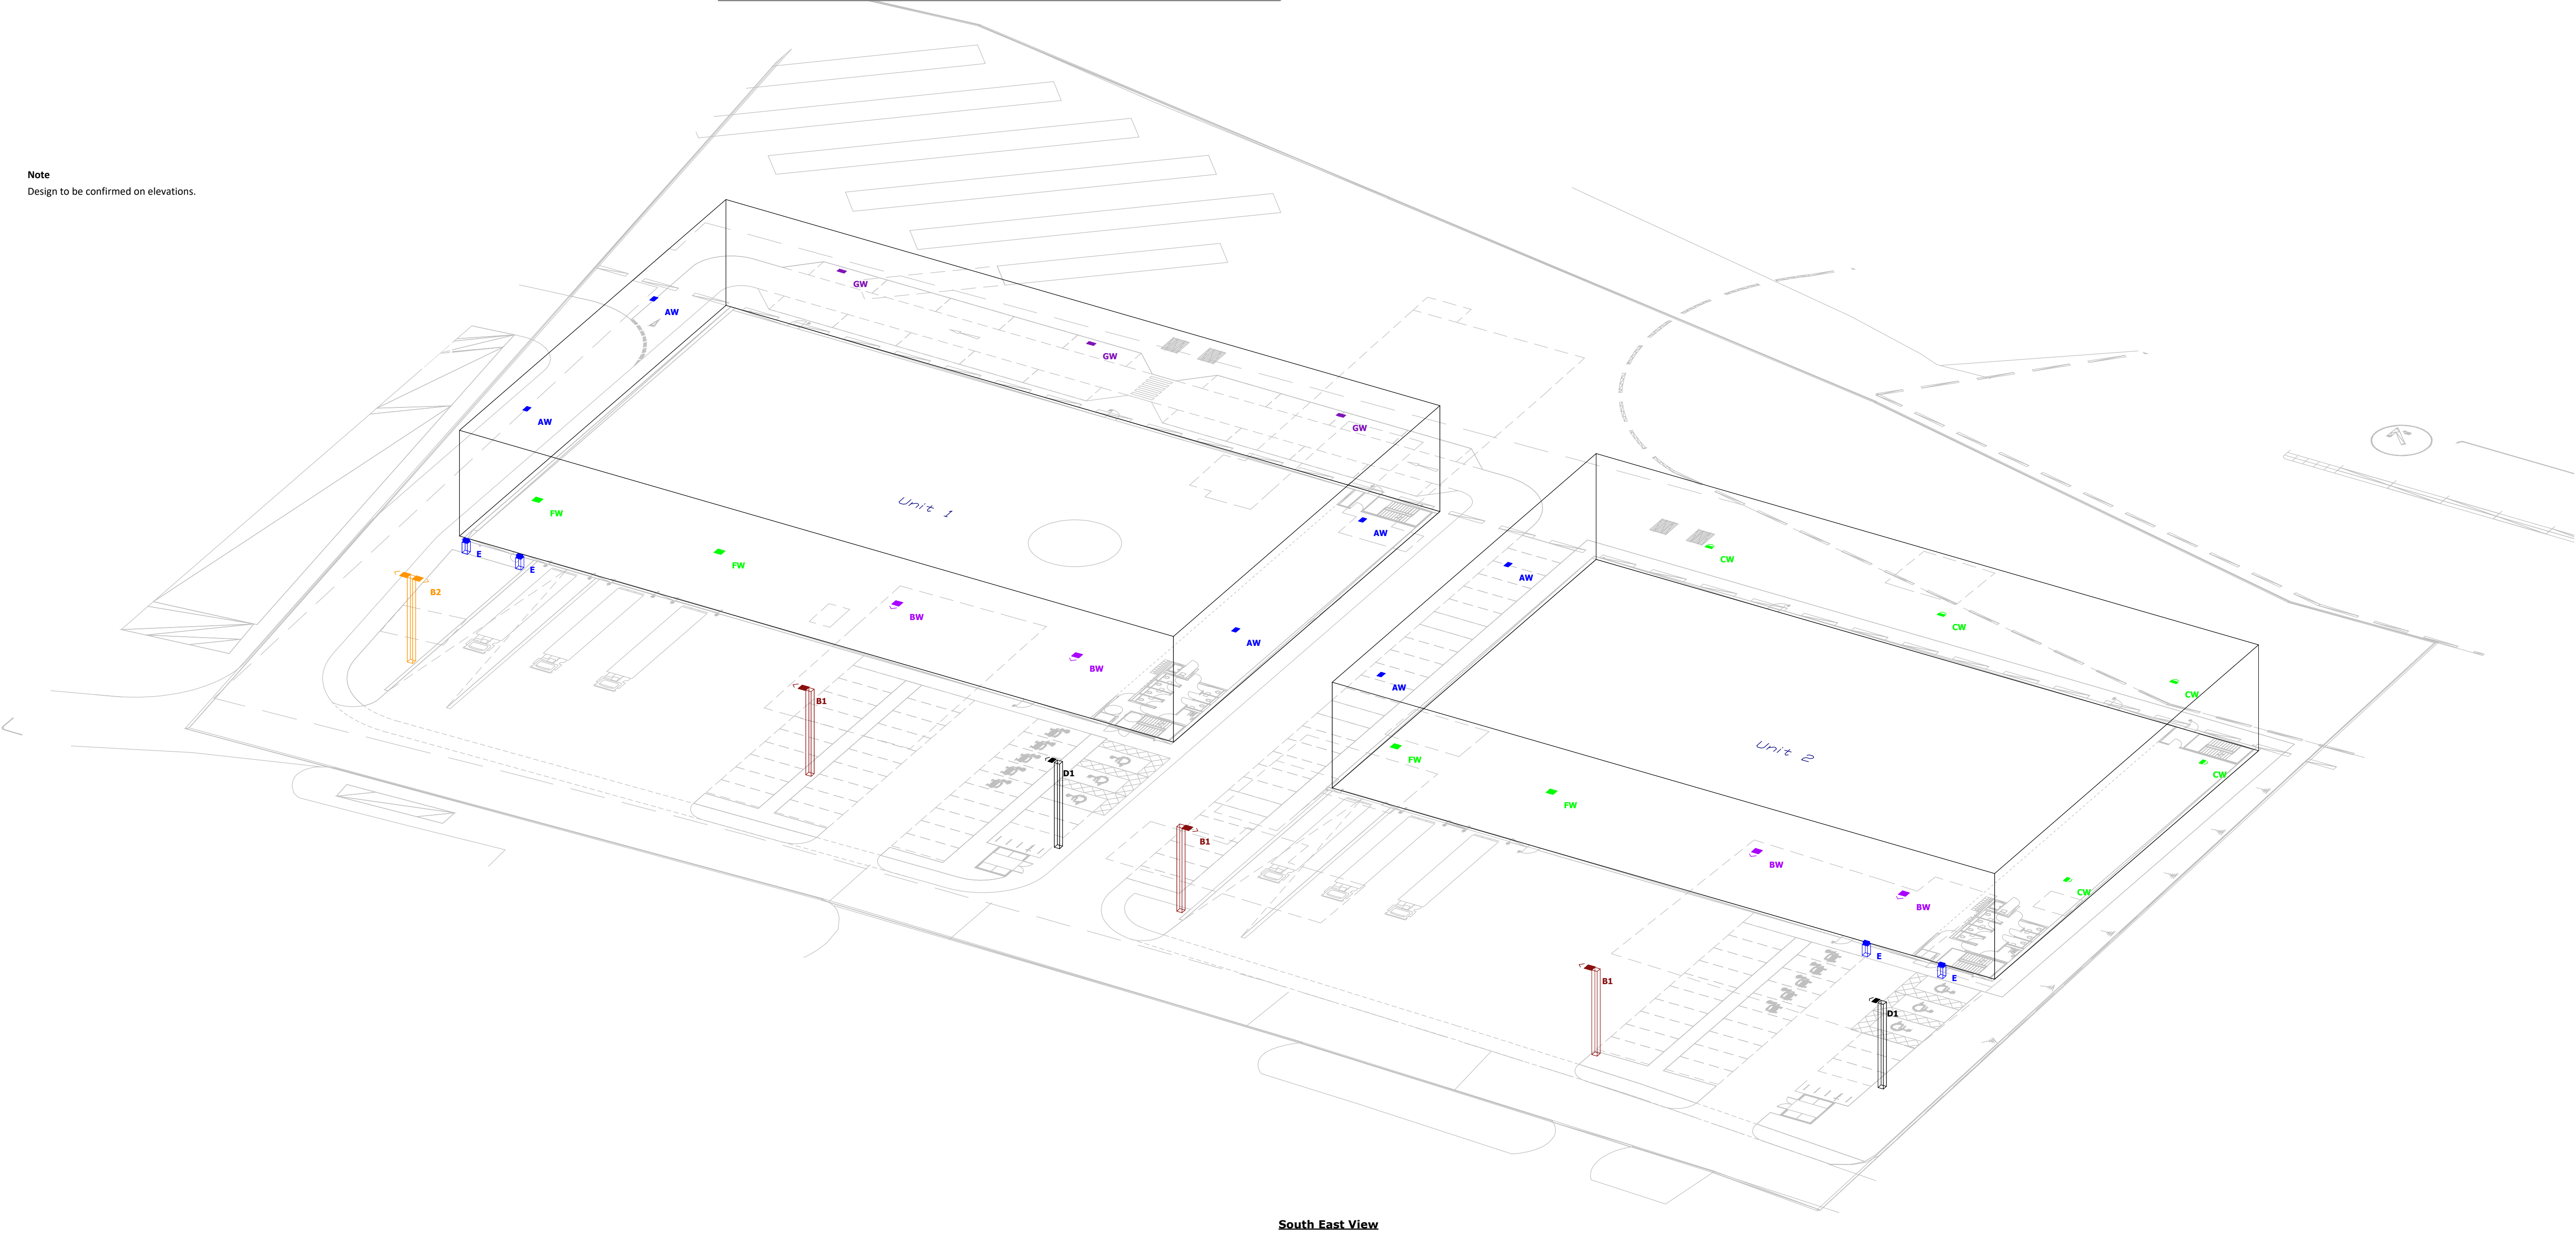

South East View

Note
Holophane Europe Ltd offer a Lighting Design Service in good faith and without charge, every effort is made to ensure we interpret the design specification accurately. All illuminance values shown are the result of theoretical computer calculations; summated by luminaires positioned in a fixed relationship to each other and the statistical zone. In practice the values may vary due to tolerances in column installation, luminaire orientation, surface reflectance and fluctuations in power supply (voltage).Results provided within this design are derived from product specific photometry, the substitution of alternative luminaires will not produce comparable results.