


SCALE: H 1:200,V 1:200. DATUM: 10.000



RISING MAIN NOTE:
 RISING MAIN TO BE LAID AT A CONTINUOUS RISE TO THE AIR VENT.
 RISING MAIN TO BE LAID WITH CONCRETE BED AND SURROUND WITH CARE. THE DEPTH IS LESS THAN 0.9m.
 RISING MAINS SHOULD BE LAID IN STRAIGHT LINES, WHERE BENDS ARE USED, THEY SHOULD BE
 PREFORMED AND OF LONG RADIUS TYPE.
 NON-DEGRADABLE MARKER TAPE WITH TRACE WIRE SHOULD BE LAID 300mm ABOVE THE TOP OF THE
 CONCRETE BED AND SURROUND. THE TAPE SHOULD BE 100mm ABOVE THE SEALED DUG, 100mm BELOW
 THE FINISHED PAVED AREA, AND SHOULD BE TERMINATED WITH 1m OF WIRE COILED INSIDE THE
 VALVE CHAMBER.
 POLYETHYLENE PRESSURE PIPES FOR RISING MAINS SHALL COMPLY WITH THE RELEVANT
 PROVISIONS OF BS EN 12201-3. THE COLOUR SHALL BE BLACK.
 POLYETHYLENE FITTINGS, INCLUDING FITTINGS FOR BUTT FUSION AND ELECTROFUSION FITTINGS,
 SHALL COMPLY WITH THE RELEVANT PROVISIONS OF BS EN 12201-3.
 JOINTS AND ELBOWS SHALL BE CAST IN SILENT BLOCKS. JOINTS AND ELBOWS AND BRANCHES IN
 RISING MAINS SHALL BE RESISTED BY GEN3 CONCRETE THRUST BLOCKS, CAST IN CONTACT WITH
 UNDISTURBED GROUND.
 RISING MAINS SHALL BE TESTED AFTER THEY ARE JOINTED AND BEFORE ANY CONCRETING OR
 BACKFILLING IS COMPLETED. OTHER THAN SUCH AS MAY BE NECESSARY FOR STRUCTURAL
 STABILITY WHILST UNDER TEST.


 **ESSO PIPELINES EXTREME CAUTION TO BE TAKEN WHILE WORKING IN THIS AREA.**

SCALE: H 1:200,V 1:200. DATUM: 10.000

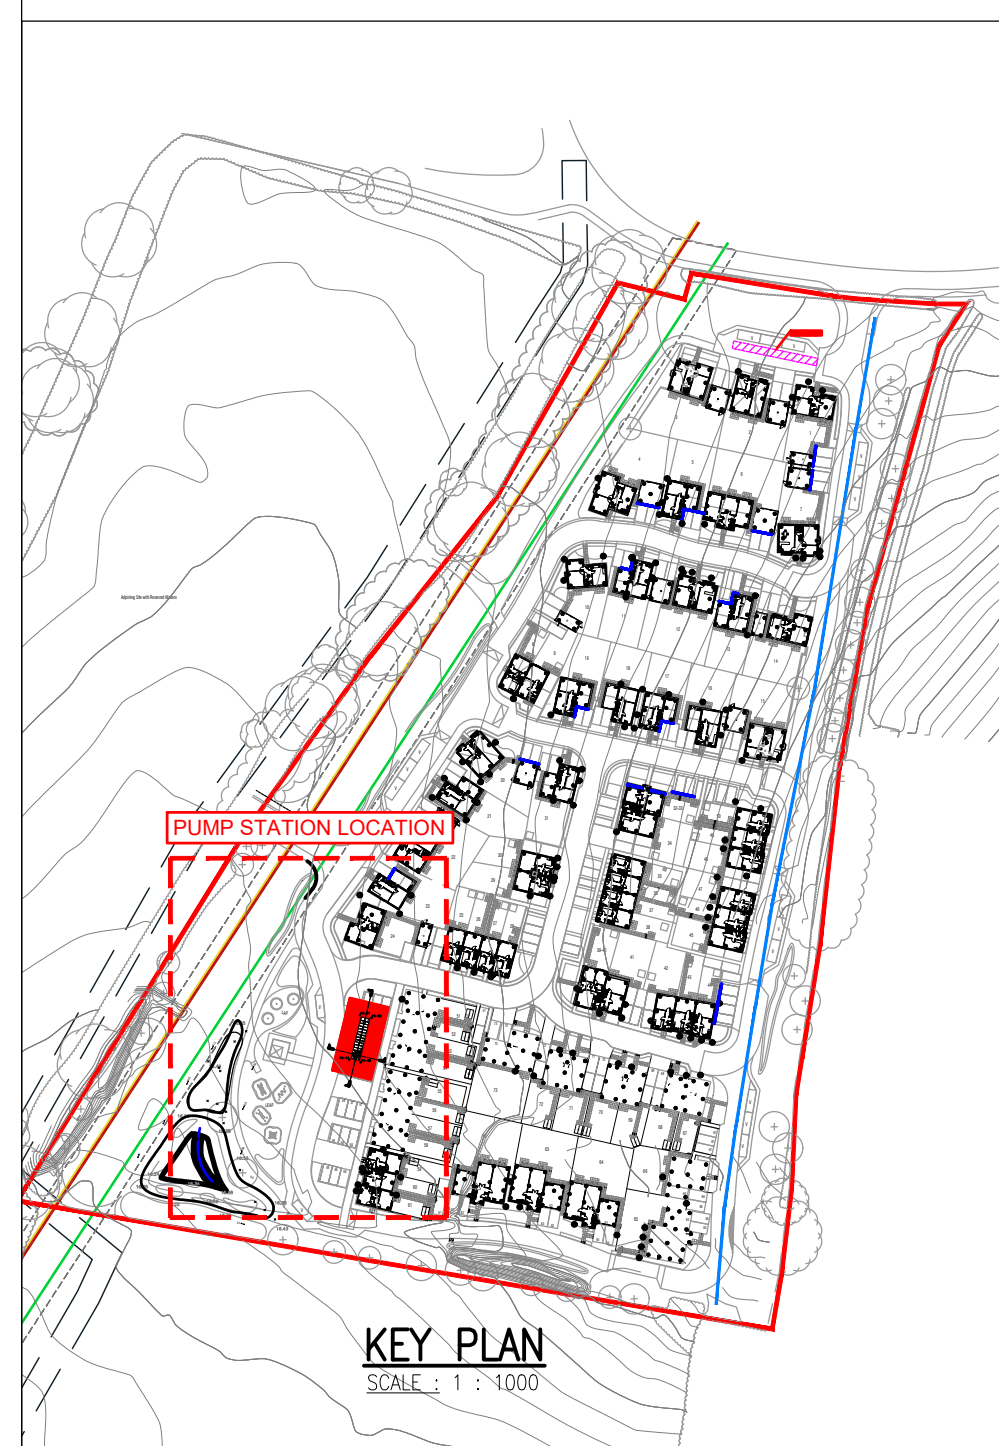

PUMP STATION SETTING OUT		
POINT	Position X	Position Y
PS-01	451126.162	114206.025
PS-02	451129.178	114205.299
PS-03	451126.331	114193.476
PS-04	451123.316	114194.202

 LEVEL OF TRUNK SEWER TO BE ACCURATELY LOCATED USING HAND DIGGING METHOD WITH PERMISSION SOUGHT FROM THE SEWERAGE UNDERTAKER

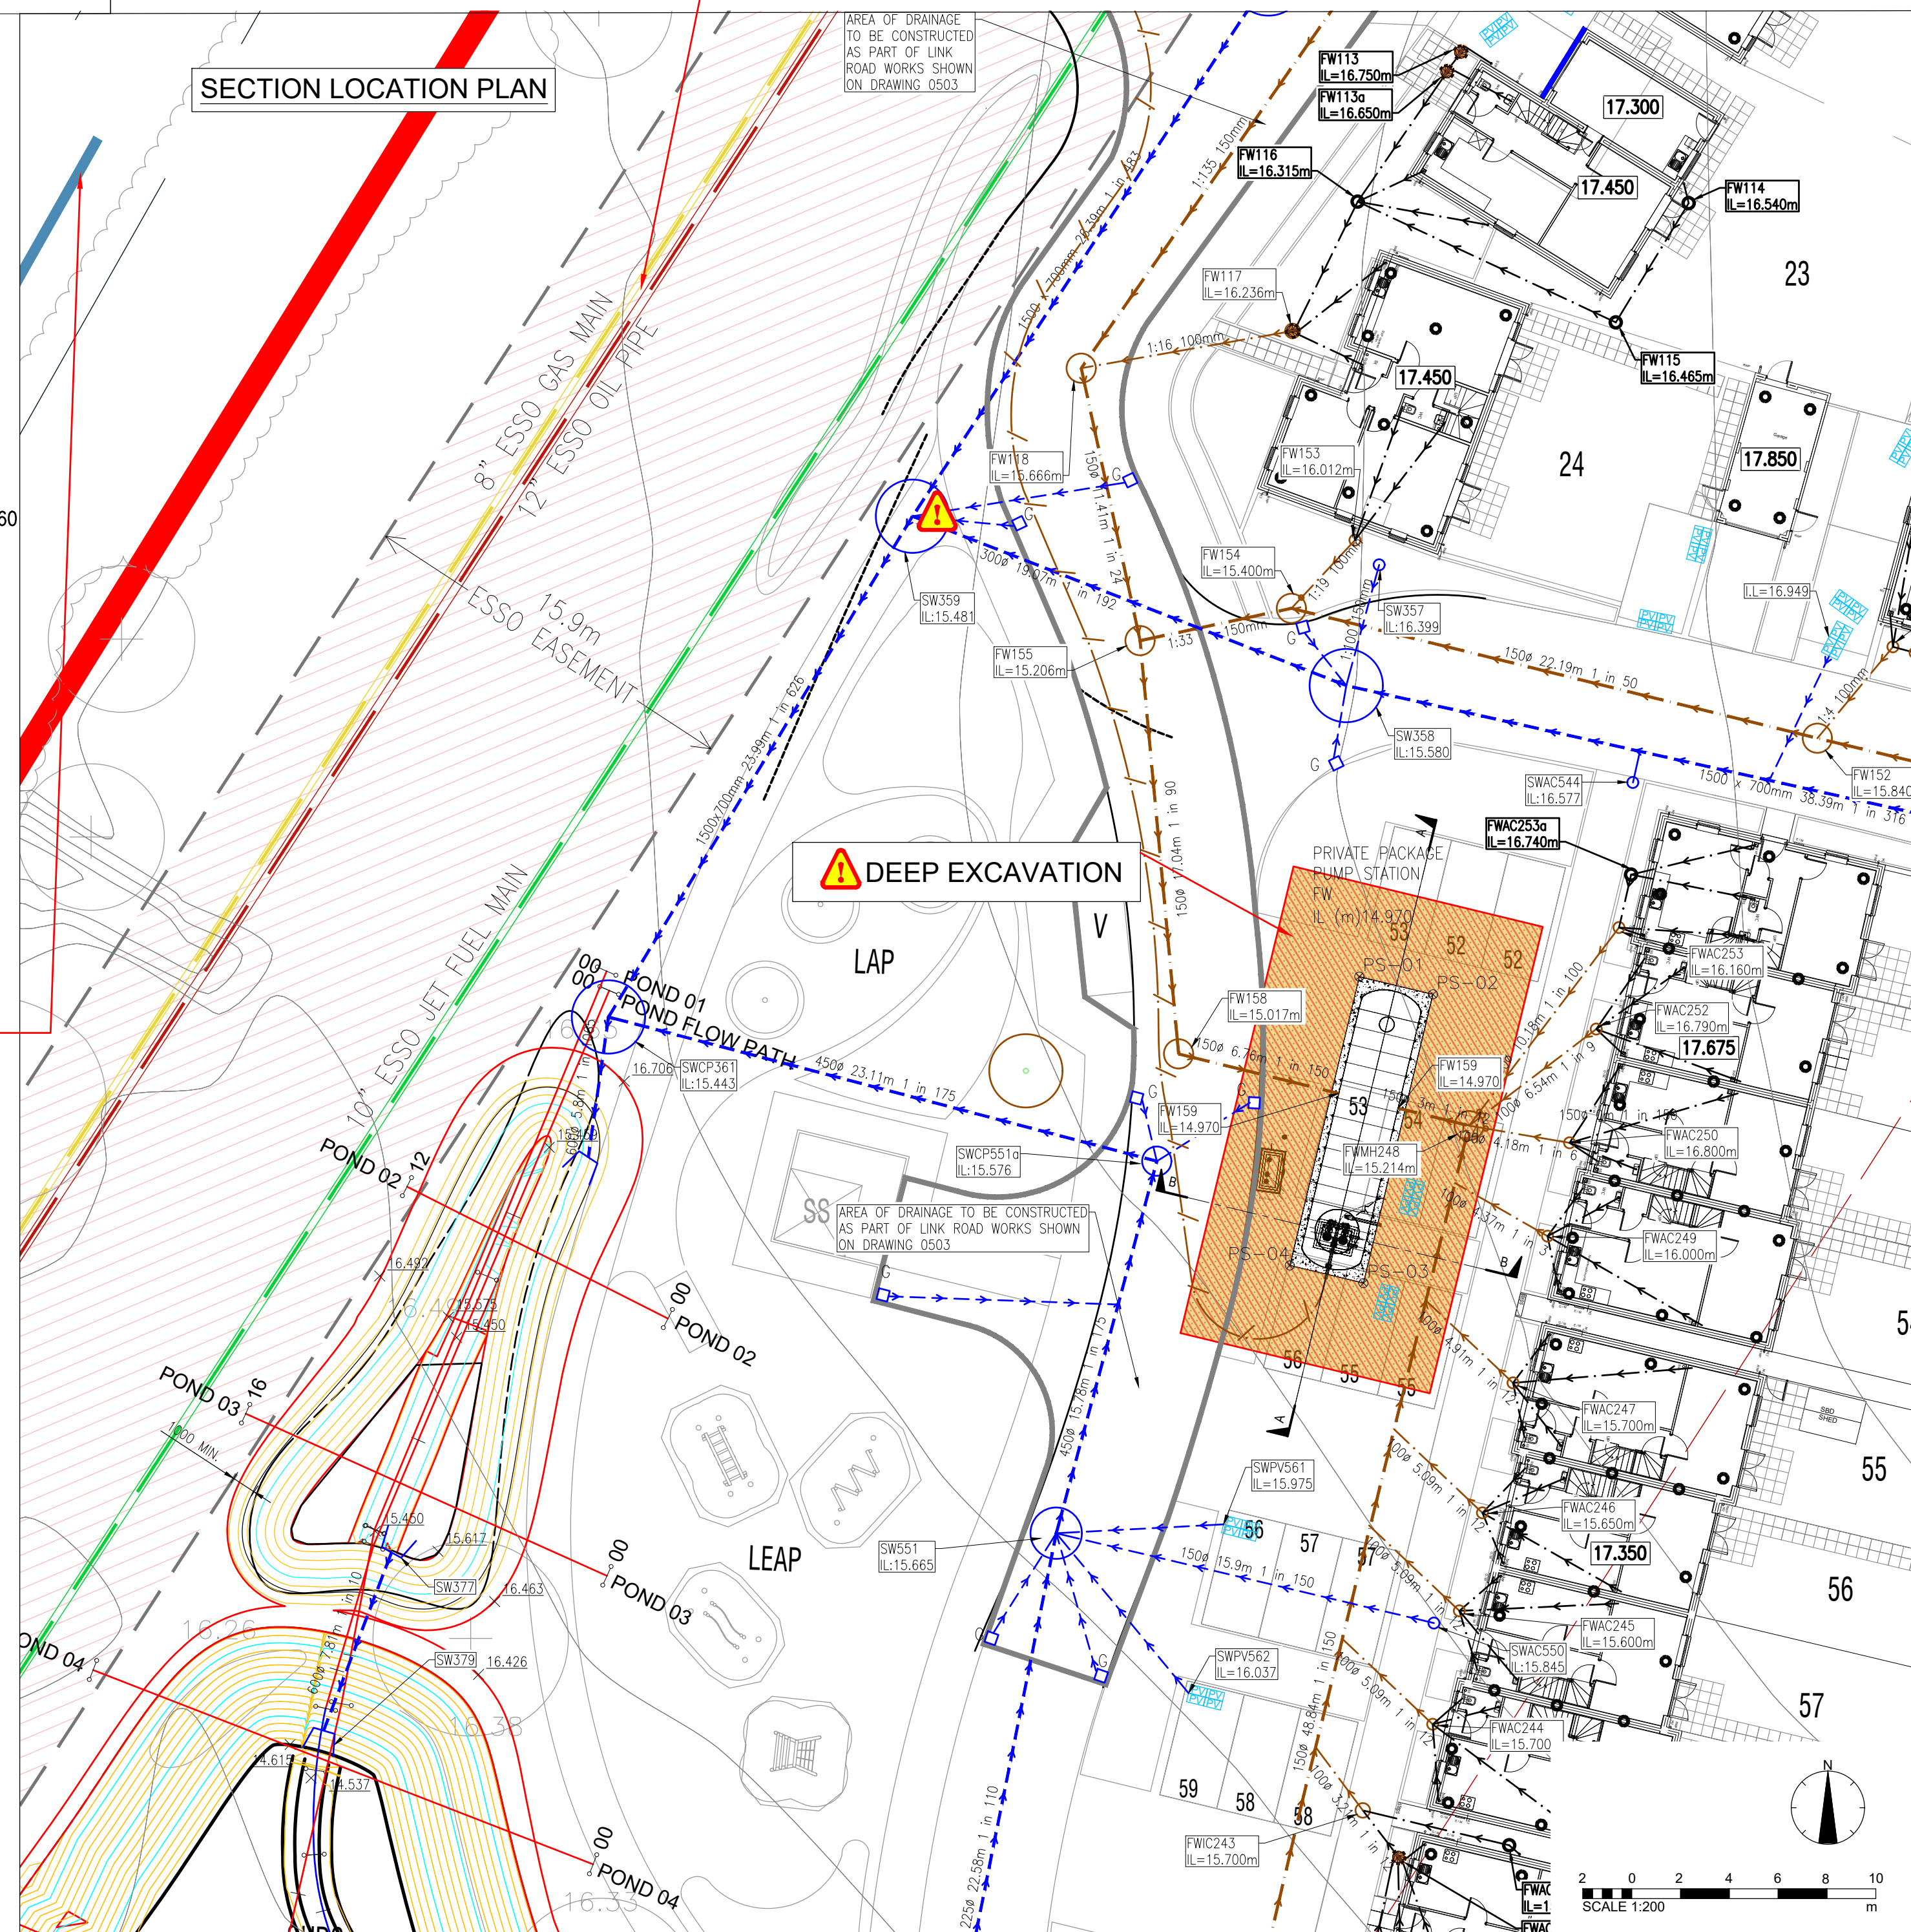

- DISCLAIMER NOTES:
- THIS DOCUMENT IS COPYRIGHT OF THE ORIGINATOR AND MUST BE TREATED AS CONFIDENTIAL.
- THIS DOCUMENT MUST NOT BE ALTERED, REPRODUCED OR DISTRIBUTED WITHOUT PRIOR WRITTEN PERMISSION.
- THIS DOCUMENT MUST NOT BE ALTERED - THE ORIGINATOR ACCEPTS NO RESPONSIBILITY FOR ANY DISCREPANCIES ARISING AS A RESULT OF THE ORIGINATORS INFORMATION BEING ALtered BY OTHERS
- ANY DISCREPANCY MUST BE REPORTED TO THE ORIGINATOR
- DO NOT SCALE THIS DOCUMENT - USE FIGURED DIMENSIONS ONLY
- ALL DIMENSIONS MUST BE CHECKED ON SITE PRIOR TO COMMENCEMENT OF ANY RELATED WORKS
- THIS DOCUMENT MUST BE READ IN CONJUNCTION WITH ALL SUPPORTING DOCUMENTS PRODUCED BY THE ORIGINATOR AND OTHER PROJECT DISCIPLINES
- THE ORIGINATOR ACCEPTS NO RESPONSIBILITY FOR THE ACCURACY OF BACKGROUND INFORMATION PRODUCED BY THIRD PARTIES - THIS MUST BE TREATED AS INDICATIVE ONLY
- USERS OF THIS DOCUMENT ARE RESPONSIBLE FOR CHECKING WHICH REVISION IS CURRENT
- THE DOCUMENT STATUS "INFORMATION" OR "PRELIMINARY" - INDICATES THAT THIS DRAWING IS FOR REFERENCE PURPOSES ONLY. THE ORIGINATOR WILL ACCEPT NO RESPONSIBILITY FOR THE COMPLETENESS OF INFORMATION UNDER THIS STATUS
- THE DOCUMENT STATUS "RECORD" OR "AS BUILT" HAS BEEN PREPARED IN PART, BASED ON THE AVAILABLE FULL INFORMATION. THE ORIGINATOR'S DOCUMENT IS BELIEVED TO BE RELIABLE. THE ORIGINATOR ASSUMES NO RESPONSIBILITY FOR THE ACCURACY OF THIS "RECORD" OR "AS BUILT" DOCUMENT OR FOR ANY ERRORS OR OMISSIONS THAT MAY HAVE BEEN INCORPORATED INTO IT AS A RESULT OF INCORRECT INFORMATION PROVIDED TO THE ORIGINATOR. THOSE RELYING ON THE "RECORD" OR "AS BUILT" DOCUMENT ARE ADVISED TO OBTAIN INDEPENDENT VERIFICATION OF ITS ACCURACY

DRAWING NOTES:

CDM REGULATIONS 2015
SIGNIFICANT OR NON-OBVIOUS RISKS AND RISKS WHICH ARE DIFFICULT TO MANAGE
ARE IDENTIFIED ON THIS DRAWING USING THE FOLLOWING SYMBOL IDENTIFIED TO
THE RIGHT WITH BRIEF ACCOMPANYING TEXT. FOR FURTHER DETAILS OF THE RISKS
IDENTIFIED BY DESIGNERS, REFERENCE SHOULD BE MADE TO CDM HAZARD
REGISTER.



CONSENT AND AGREEMENT TO BE SOUGHT FROM FUEL
LINE ASSET OWNER PRIOR TO ANY INVESTIGATION AND
CONSTRUCTION WORKS COMMENCING

ARCHITECTS LAYOUT:
HGP DRAWING - 18.122.102 REV:-
(INCORPORATING AMENDMENTS, FOREMAN HOMES -22/07/2022)

PIPELINE INFORMATION:
ESSO DRAWING - XXX-XXX-XXX REV:B

NOTE:
LONG SECTION TAKEN THROUGH CENTER OF DRAINAGE RUNS
BETWEEN FOUL WATER PUMP STATION AND EXISTING FOUL WATER
MANHOLE F10 IN PHASE 1 LAND

P01	PUMP STATION CO-ORDINATES ADDED	09/06/2023	JM
-	ISSUED FOR INFORMATION	25/04/2023	PO
REV	DESCRIPTION	DATE	DRAWN

ORIGINATOR:

RIDGE

1 ROYAL COURT
KINGS WORTHY
WINCHESTER
SO23 7TW

TEL: 01962 834400

WWW.RIDGE.CO.UK

CLIENT:
FOREMAN HOMES



FOREMAN
HOMES

PROJECT:
MADDOXFORD LANE
BOORLEY GREEN
PHASE 2

TITLE: PROPOSED FOUL WATER PUMP STATION SECTIONS

TECH: PO	CSE:  Digitally signed by Chris Lind dn: cn=Chris Lind, ou=Engineering, ou=IBM, c=US	ICSE:  Marilyn Eiland 1.001 Approving this document 2025.05.09	SCALE: AS SHOWN @ A1 INITIAL ISSUE: 25/04/2023
-------------	--	--	---

STATUS:	CONSTRUCTION
---------	--------------

DRAWING No:							
PROJECT:	ORG:	ZONE:	LEVEL:	TYPE:	ROLE:	NUMBER:	REV:
5015142	RDG	XX	ST	DR	C	0558	P01