


REVISION

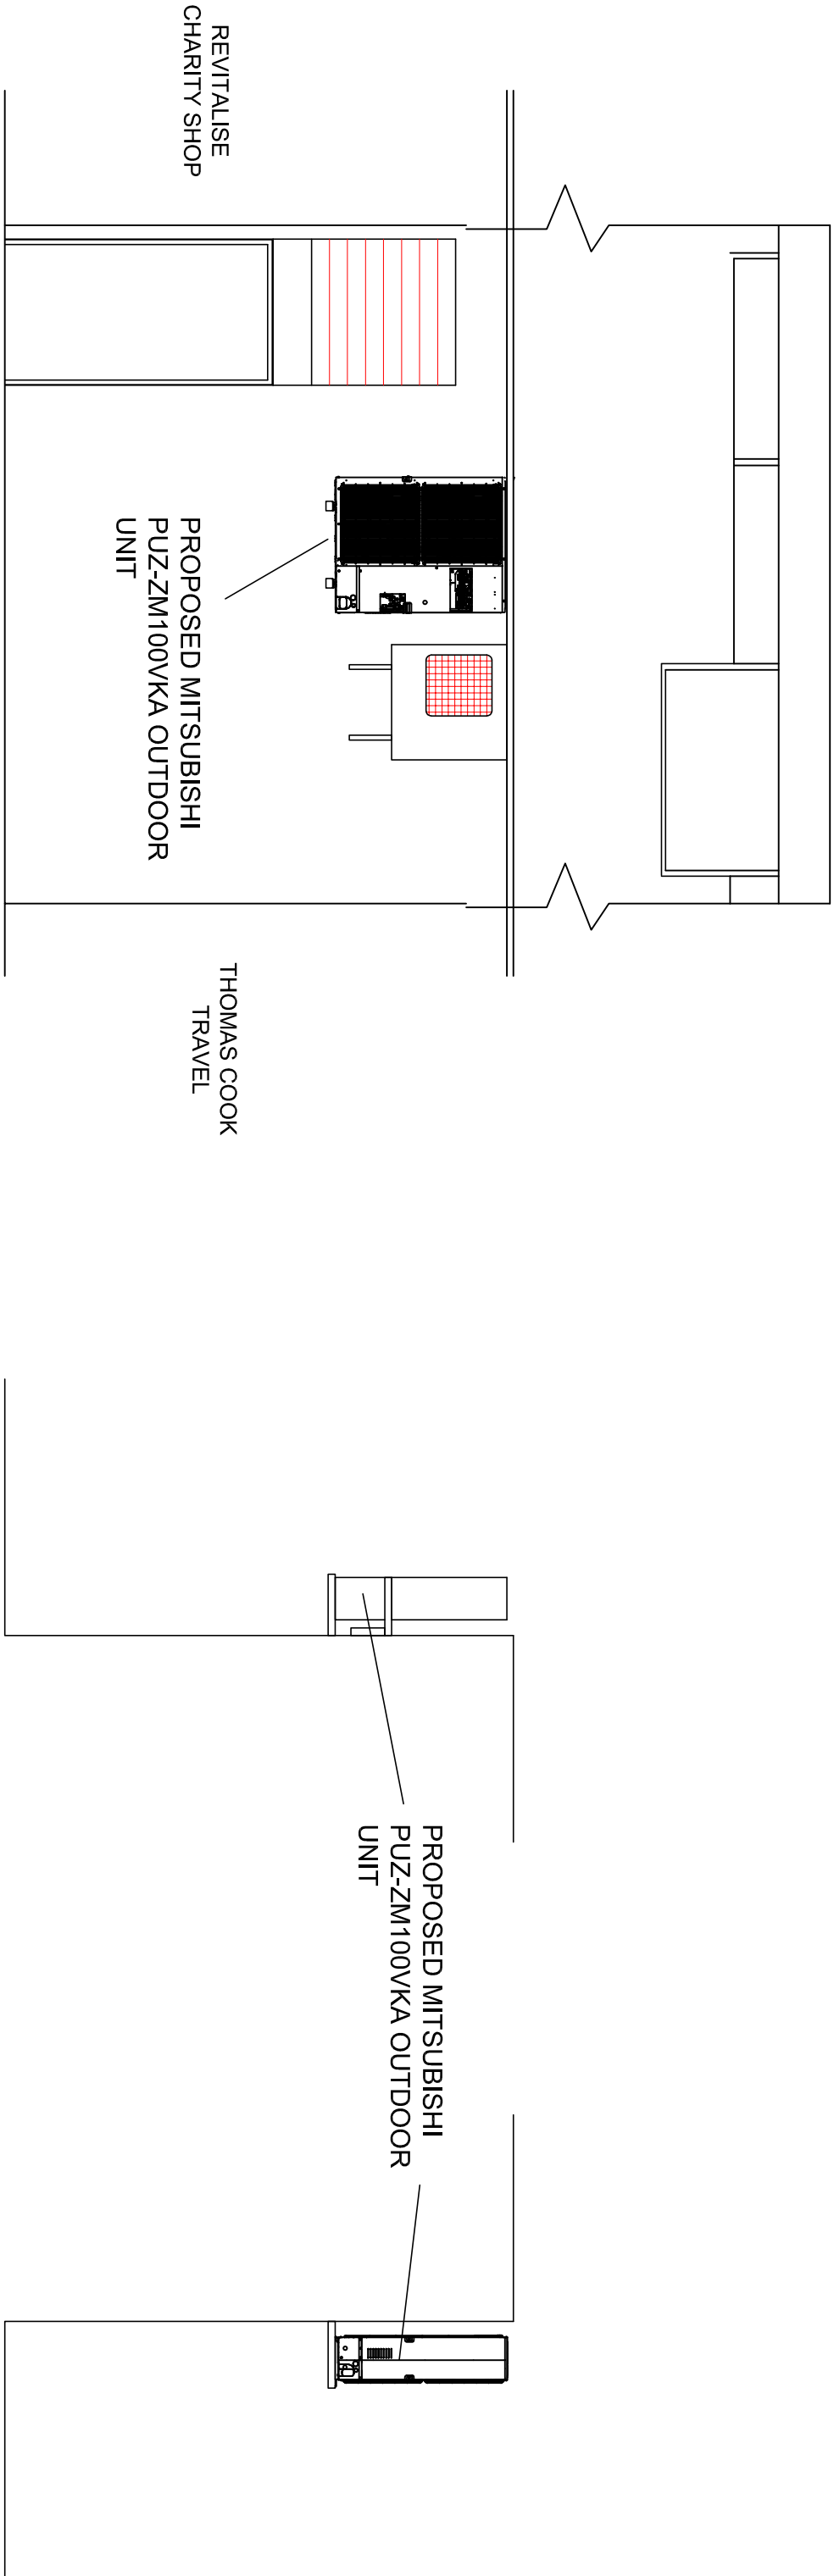


ELEVATION B-B

SIDE ELEVATIONS


DATA SHEET

PUZ-ZM - OUTDOOR UNITS		PUZ-ZM50VKA	PUZ-ZM60VKA	PUZ-ZM70VKA	PUZ-ZM100VKA	PUZ-ZM100VKA ⑤	PUZ-ZM120VKA	PUZ-ZM140VKA	PUZ-ZM140VKA ⑤
SOUND PRESSURE LEVEL (dB)		46/44	48/47	49/47	51/49	51/49	52/50	52/50	52/50
SOUND POWER LEVEL (dB)		65	67	67	69	69	70	70	70
DIMENSIONS (mm)		46	70	70	116	123	116	116	131
WEIGHT (kg)		20	20	20	20	20	20	20	20
REFRIGERANT (kg)		0.90	0.90	0.90	1.00	1.00	1.00	1.00	1.00
SYSTEM POWER INPUT (kW)		1.361/1.25	1.541/1.29	1.561/1.29	3.018/2.317	3.018/2.317	3.561/3.846	4.462/3.941	4.462/3.941
HEATING/Cooling (kW)		1.21/1.06	1.51/1.29	1.52/1.35	2.41/1.99	2.41/1.99	3.51/3.85	3.94/3.35	3.94/3.35
STARTING CURRENT (A)		5.95	5.0	6.0	18.0	18.0	18.0	18.0	18.0
FUSE RATING (BS88 - HRC/A)		16	16	16	32	32	32	32	32
MAX PIPE LENGTH (m)		3	3	3	3	3	3	3	3
MAX CABLE NO. CORES		3	3	3	3	3	3	3	3
CO ₂ EQUIVALENT (R)		2.80/1.89	2.80/1.89	2.80/1.89	4.00/2.70	4.00/2.70	4.00/2.70	4.00/2.70	4.00/2.70
MAX ADDITIONAL REFRIGERANT (kg) / R32 (GWP 675)		0.30/0.20	0.30/0.20	0.30/0.20	2.80/1.89	2.80/1.89	2.80/1.89	2.80/1.89	2.80/1.89

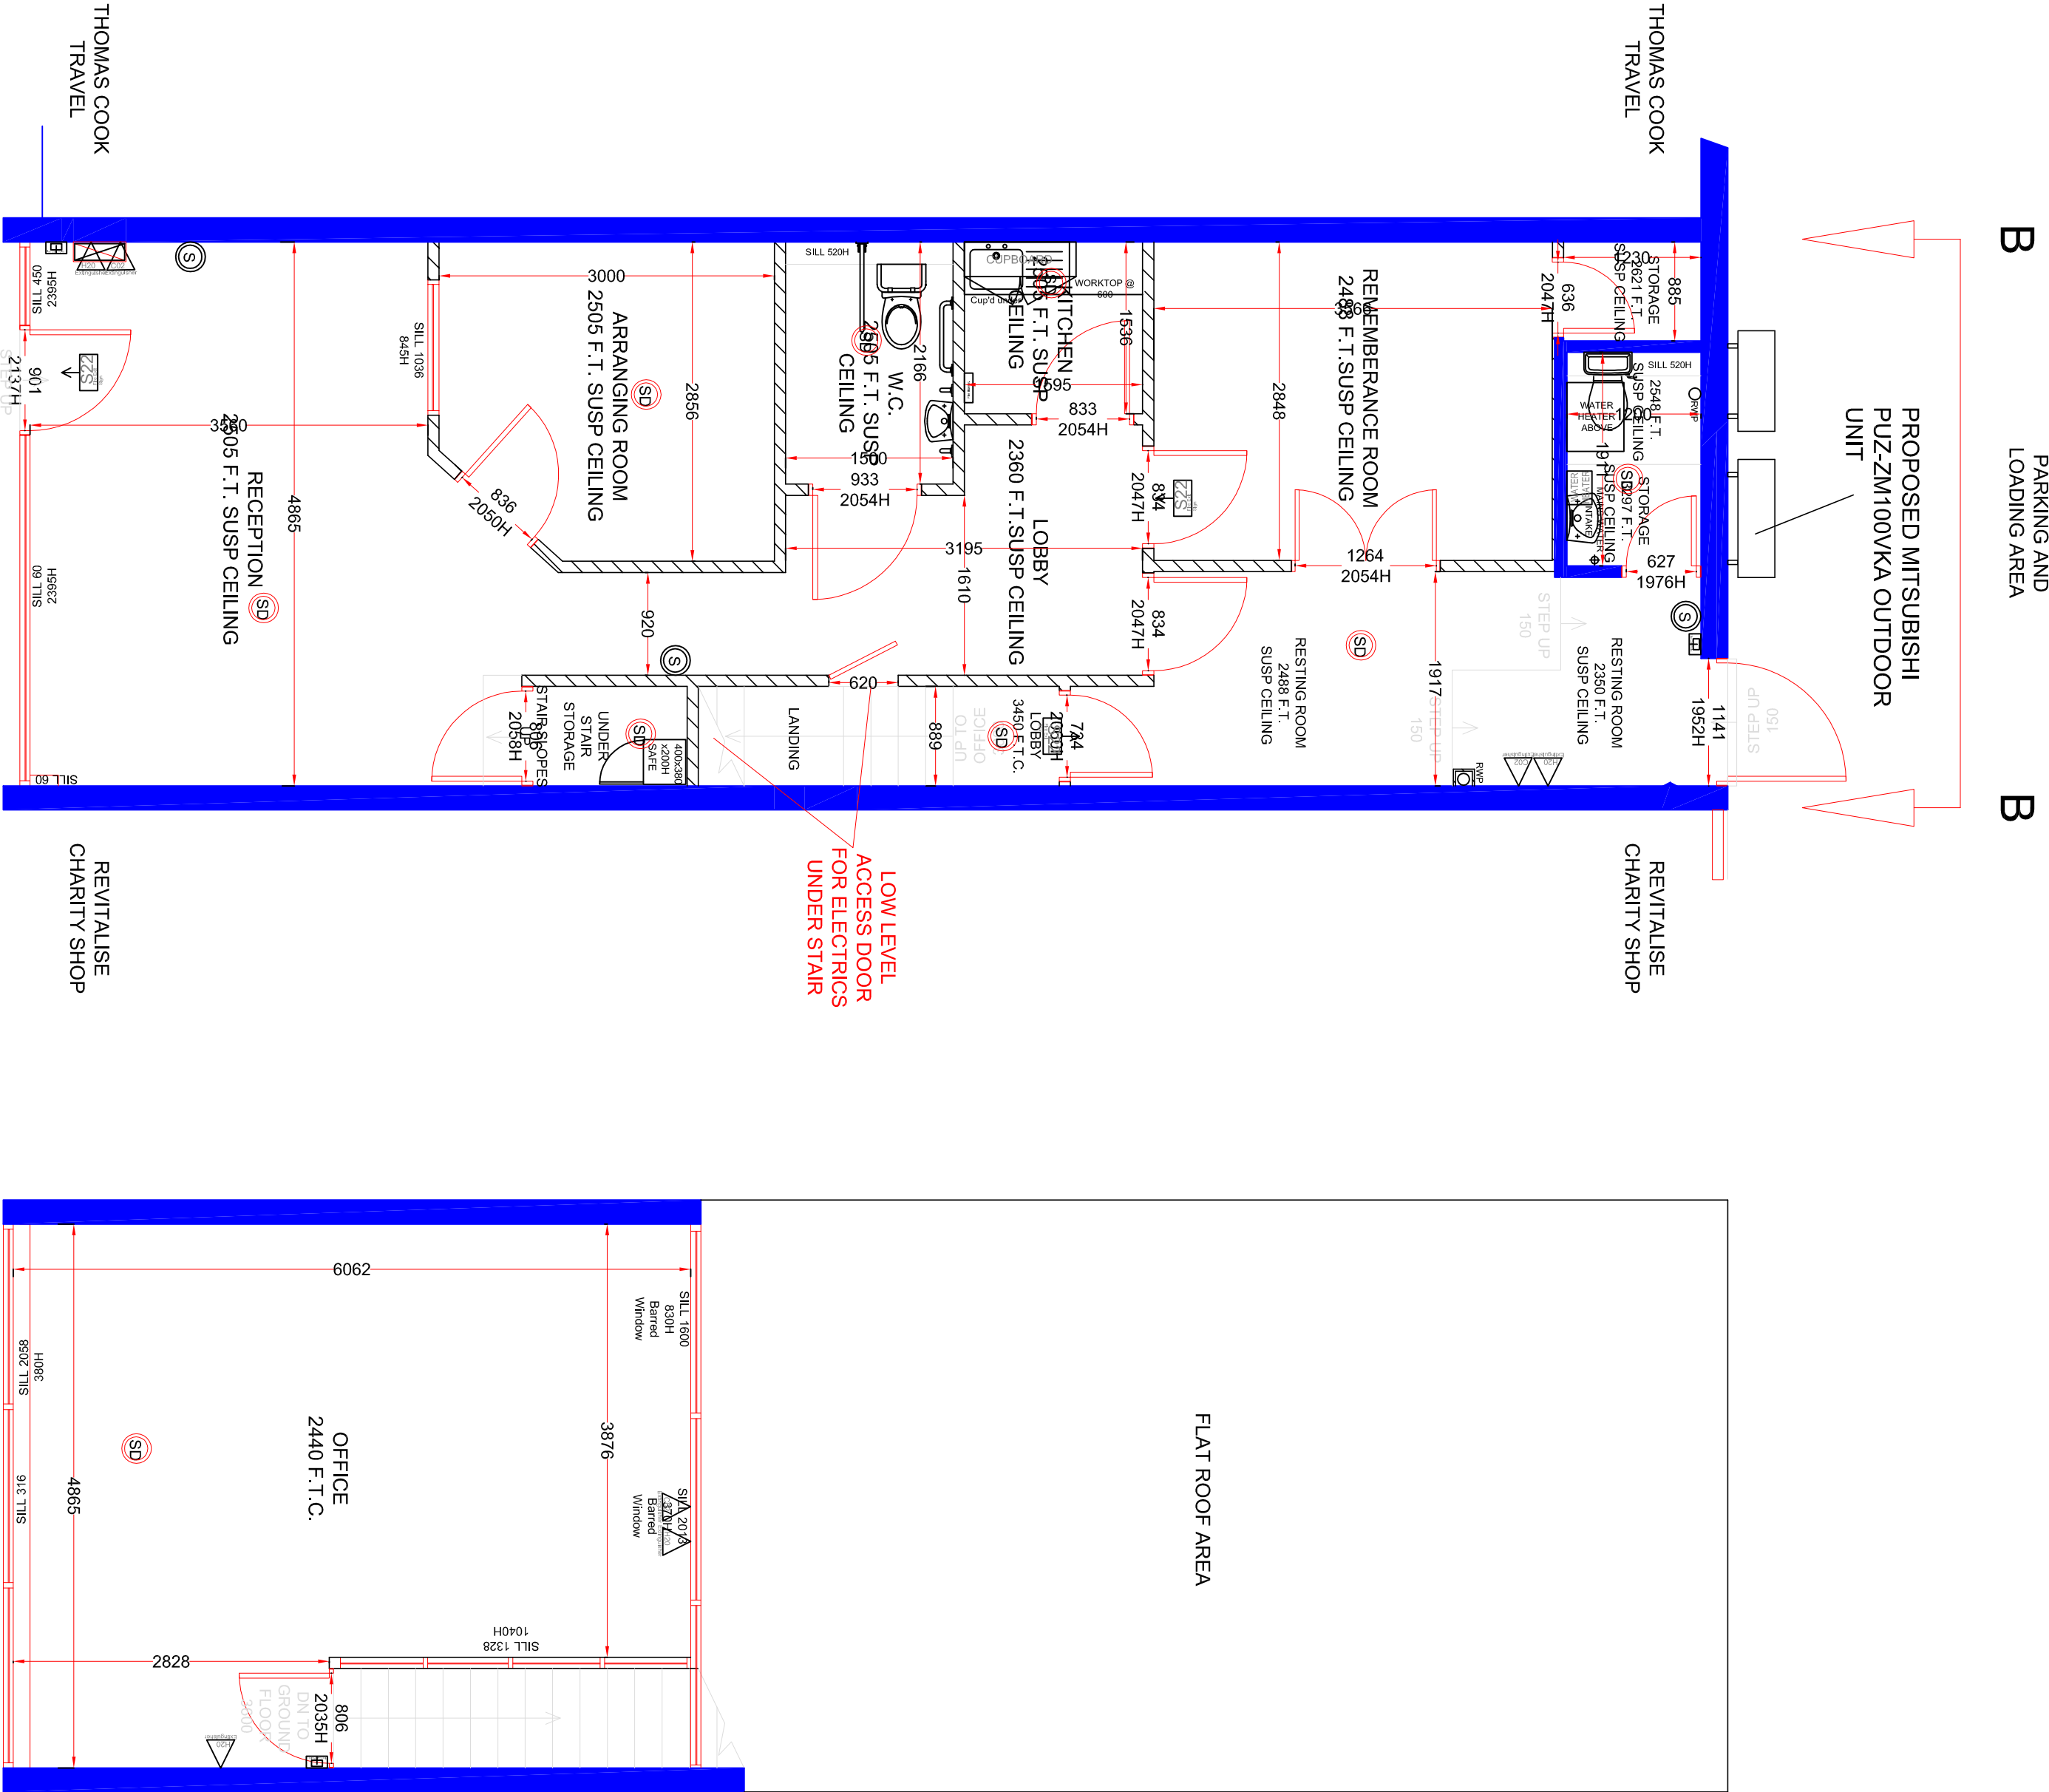


GROUND FLOOR PLAN

FIRST FLOOR PLAN




PROPOSED PLAN 1:50

PROPOSED UNIT NOT TO SCALE

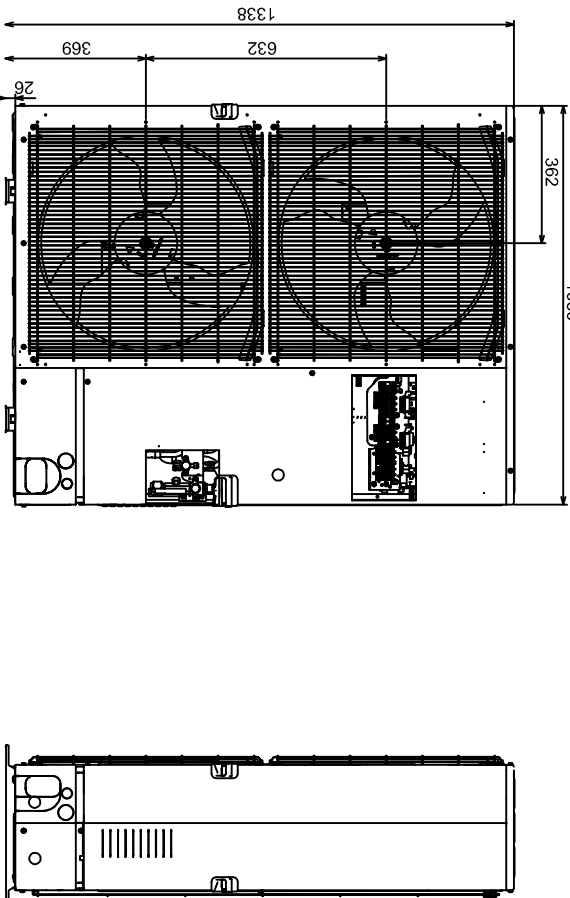

SCALE 1:50



Wellfield Associates

York House
Walsingham Drive
Rushmore, Essex
SS6 7AU
Mob No 07766 221958
chris@wellfieldassociates.co.uk

project
FUNERALCARE HEDGE END
7A LOWER NORTHAM ROAD
HEDGE END
SOUTHAMPTON
SO30 4FN
PROPOSED PLAN

date
JAN 24
drawn
C.J.J.

scale
1:50 @A1
drg no.
3859.11

© THE CONTENTS OF THIS DRAWING REMAIN THE SOLE PROPERTY OF
WELLSFIELD ASSOCIATES AND MUST NOT BE COPIED OR REPRODUCED
WITHOUT PRIOR PERMISSION.

FULL SURVEY NOT CARRIED OUT. DRAWING PRODUCED USING
INFORMATION SUPPLIED BY THE CLIENT