


E12

SA-HOR-FL-48B

146.9 sq. ft

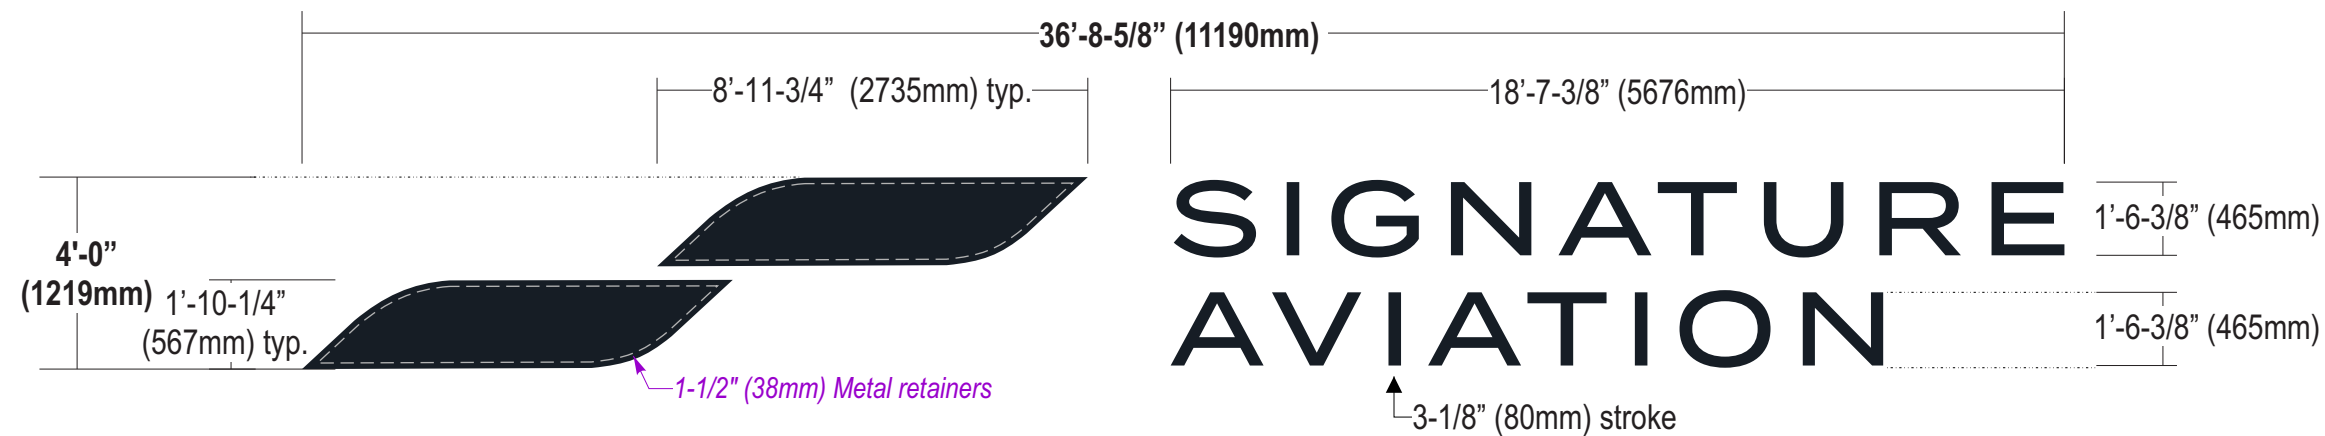

QUANTITY: (2) TWO Required

SIGNATURE
AVIATION

SIGN TO BE U.L. LISTED AND SHALL MEET N.E.C. STANDARDS Underwriters Laboratories Inc. ELECTRIC SIGN	ALL ELECTRICAL COMPONENTS TO BE U.L. LISTED, APPROVED AND MARKED PER N.E.C. 600-4. ALL TO BE ELECTRICALLY GROUNDED PER U.L.C. 250. ALL POWER SUPPLIES TO BE RULSED PER U.L. 48, 282.1 GROUNDING AND BONDING PER N.E.C. 250-90, 92-94, 96. SIGN TO MEET N.E.C. AND U.L. 48 STANDARDS FOR ELECTRICAL GROUNDING & BONDING AS PER N.E.C. 250-90 & NEC 600-7
--	---

15

Rev #	Req #	Date/Artist	Description
-------	-------	-------------	-------------

PRINTS ARE THE EXCLUSIVE PROPERTY OF STRATUS. THIS MATERIAL SHALL NOT BE USED, DUPLICATED, OR OTHERWISE REPRODUCED WITHOUT THE PRIOR WRITTEN CONSENT OF STRATUS.