
© Ashworth Electrical Services Ltd


This drawing is the property of Ashworth Electrical Services Ltd and must not be copied, reproduced or divulged to anyone without prior written permission

NOTES:


1. REFER TO DRAWING 16894-AES-M1-ZZ-D-E-6801 FOR DETAILS ON THE EXTERNAL LIGHTING.
2. THE EXTERNAL LIGHTING IS CONTROLLED VIA A TIMECLOCK AND PHOTOCELL ARRANGEMENT.
3. THE LUMINAIRES WILL ONLY OPERATE DURING THE HOURS TO BE ADVISED BY THE CLIENT SECURITY CONTRACTOR WITH THE PHOTOCELL PREVENTING OPERATION DURING ADEQUATE LEVELS OF DAYLIGHT. THE LUMINAIRES WILL BE SWITCHED OFF DURING THE HOURS OF CURFEW (22:00 TO 06:00).

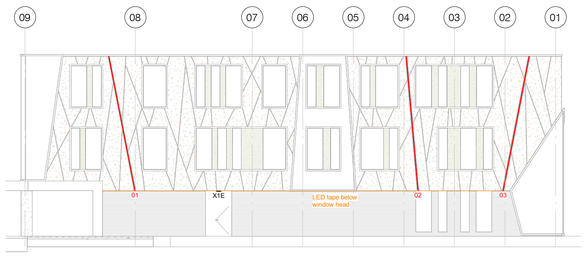


Elevation 1 (NOT ORIENTATED TO PLAN)

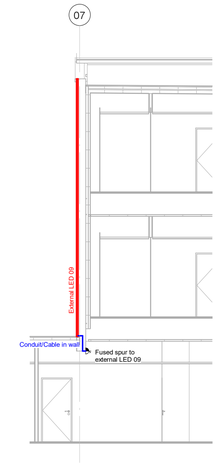

Section 1 through WC Lobby 024 & Above

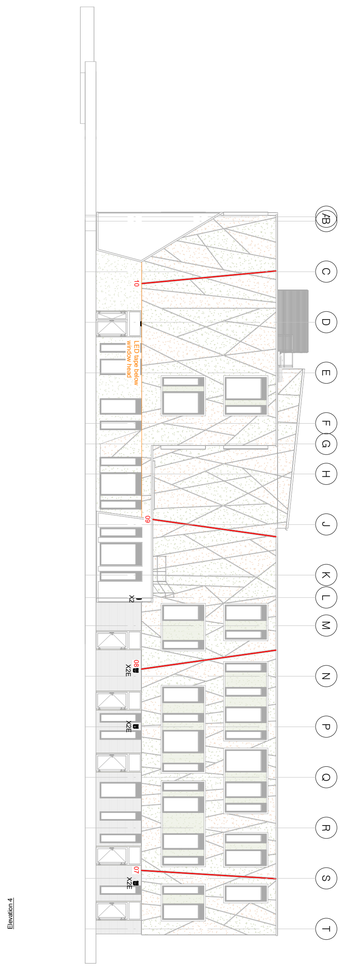


Elevation 4

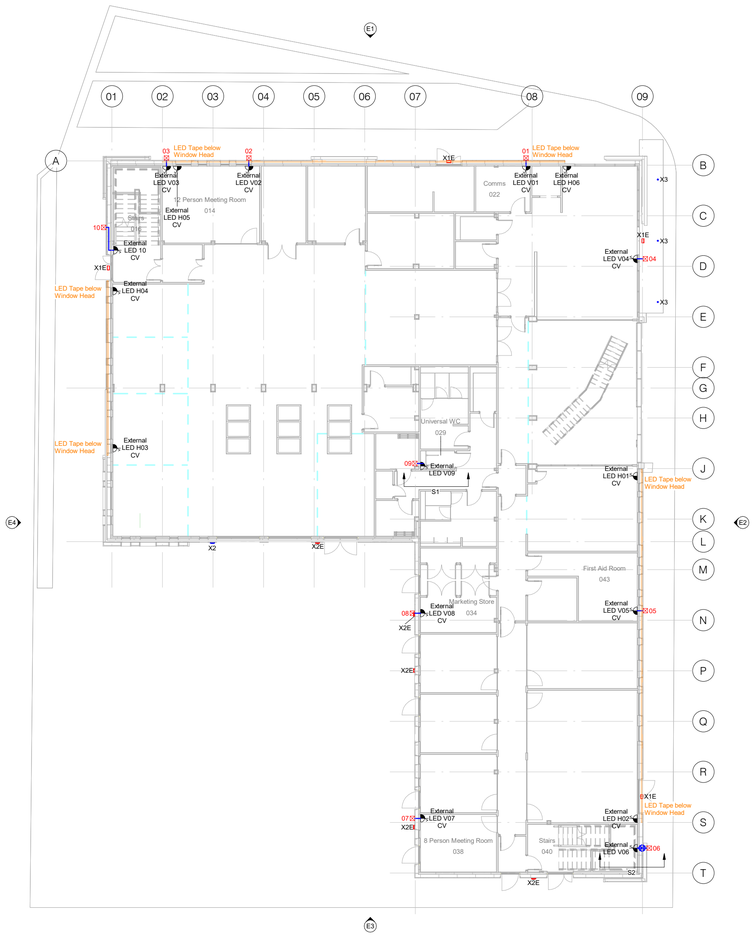




Elevation 2

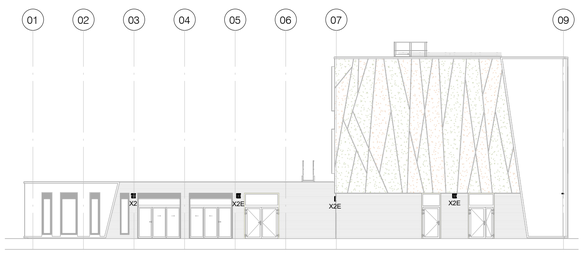

Elevation 3

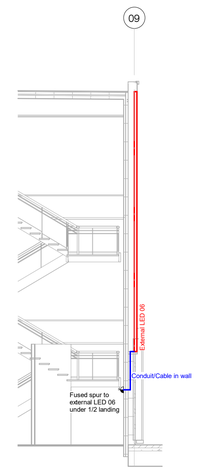

Section 2 through Stairs 040 & Above

P	1	17.06.26	Preliminary Issue
-	REV	DATE	AMENDMENT

Charleson

Charleson Building Services Limited
Unit 8 Easter Court, Europa Boulevard, Westbrook, Warrington, WA5 7ZB
Telephone 01925 655929
Incorporating
Ashworth Electrical Services Ltd
Townfield House
Townfield Street
Oldham OL4 1HE
Tel: 0161 620 2689

CONTRACT

Workdry International Headquarters

DESCRIPTION

External LED Cladding Lighting Supplies

CLIENT

Portakabin
Portakabin Limited New Lane Huntington York YO32 9PT United Kingdom
+44 (0)1904 611655
portakabin.com

S3 - Review & Comment

DATE 29.04.26	SCALE As indicated @ A1	REV P1
DRAWN SR	DRAWING No. 16894-AES-M1-ZZ-D-E-6806	