
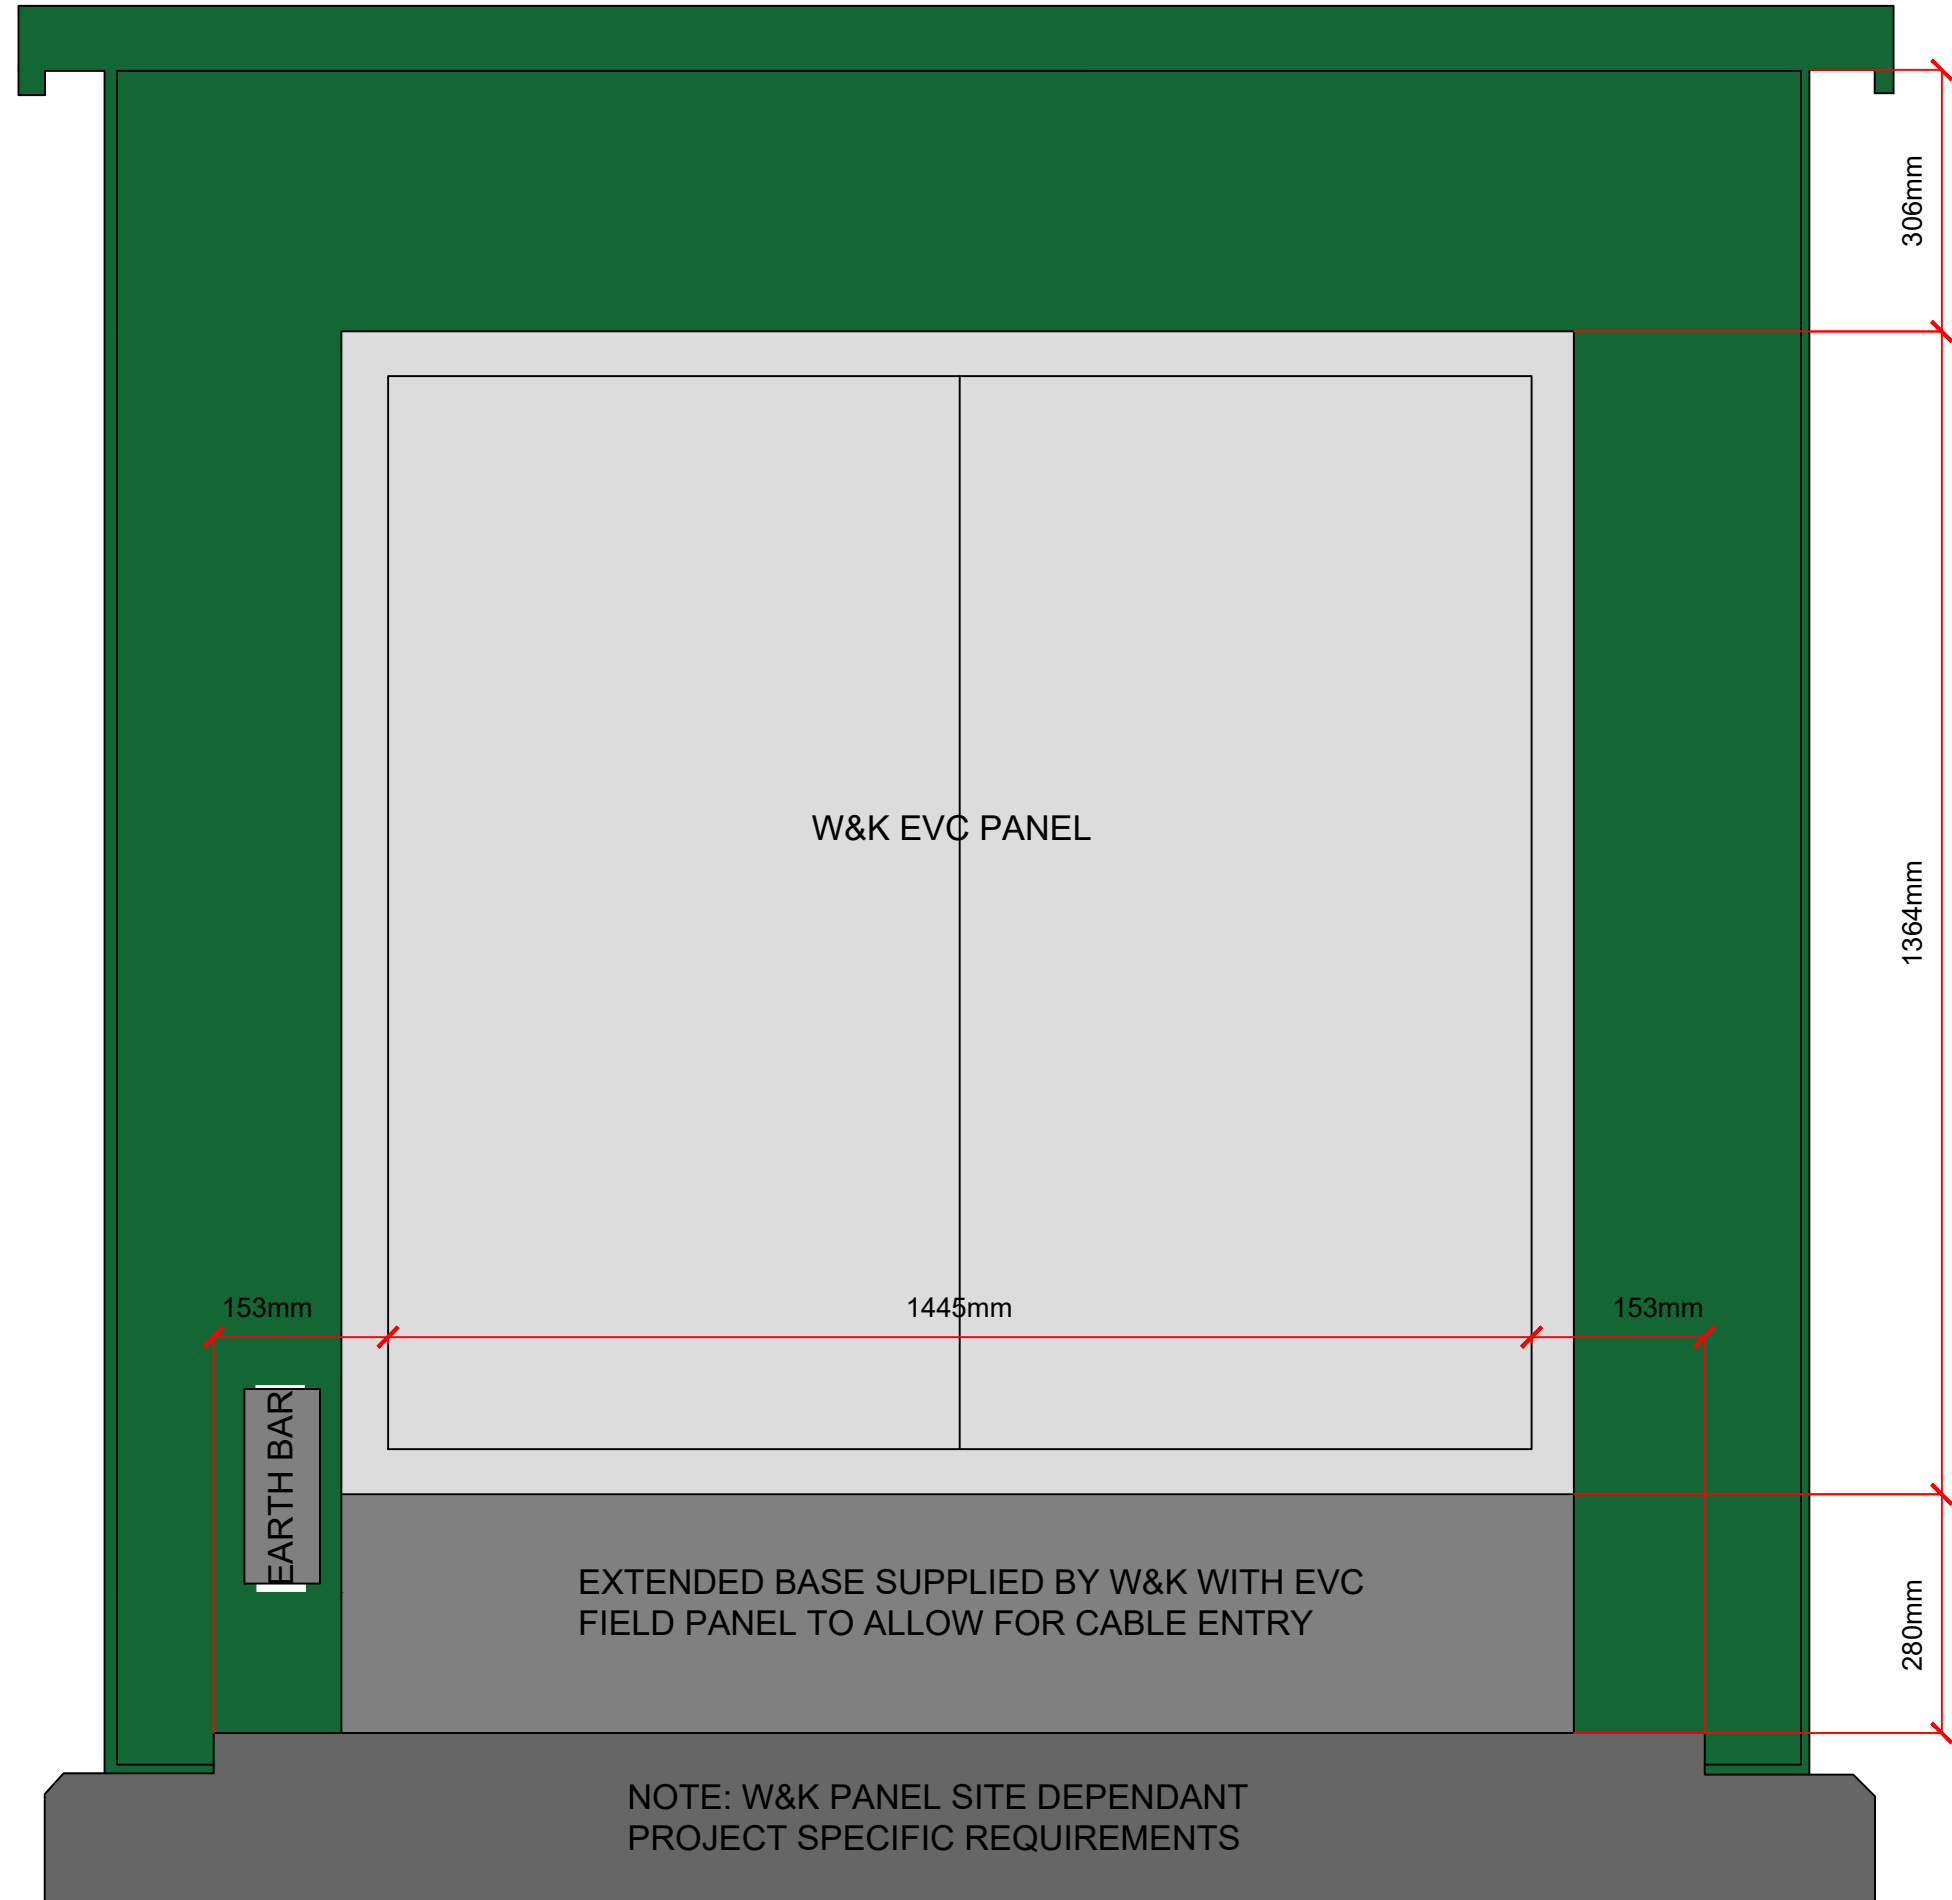


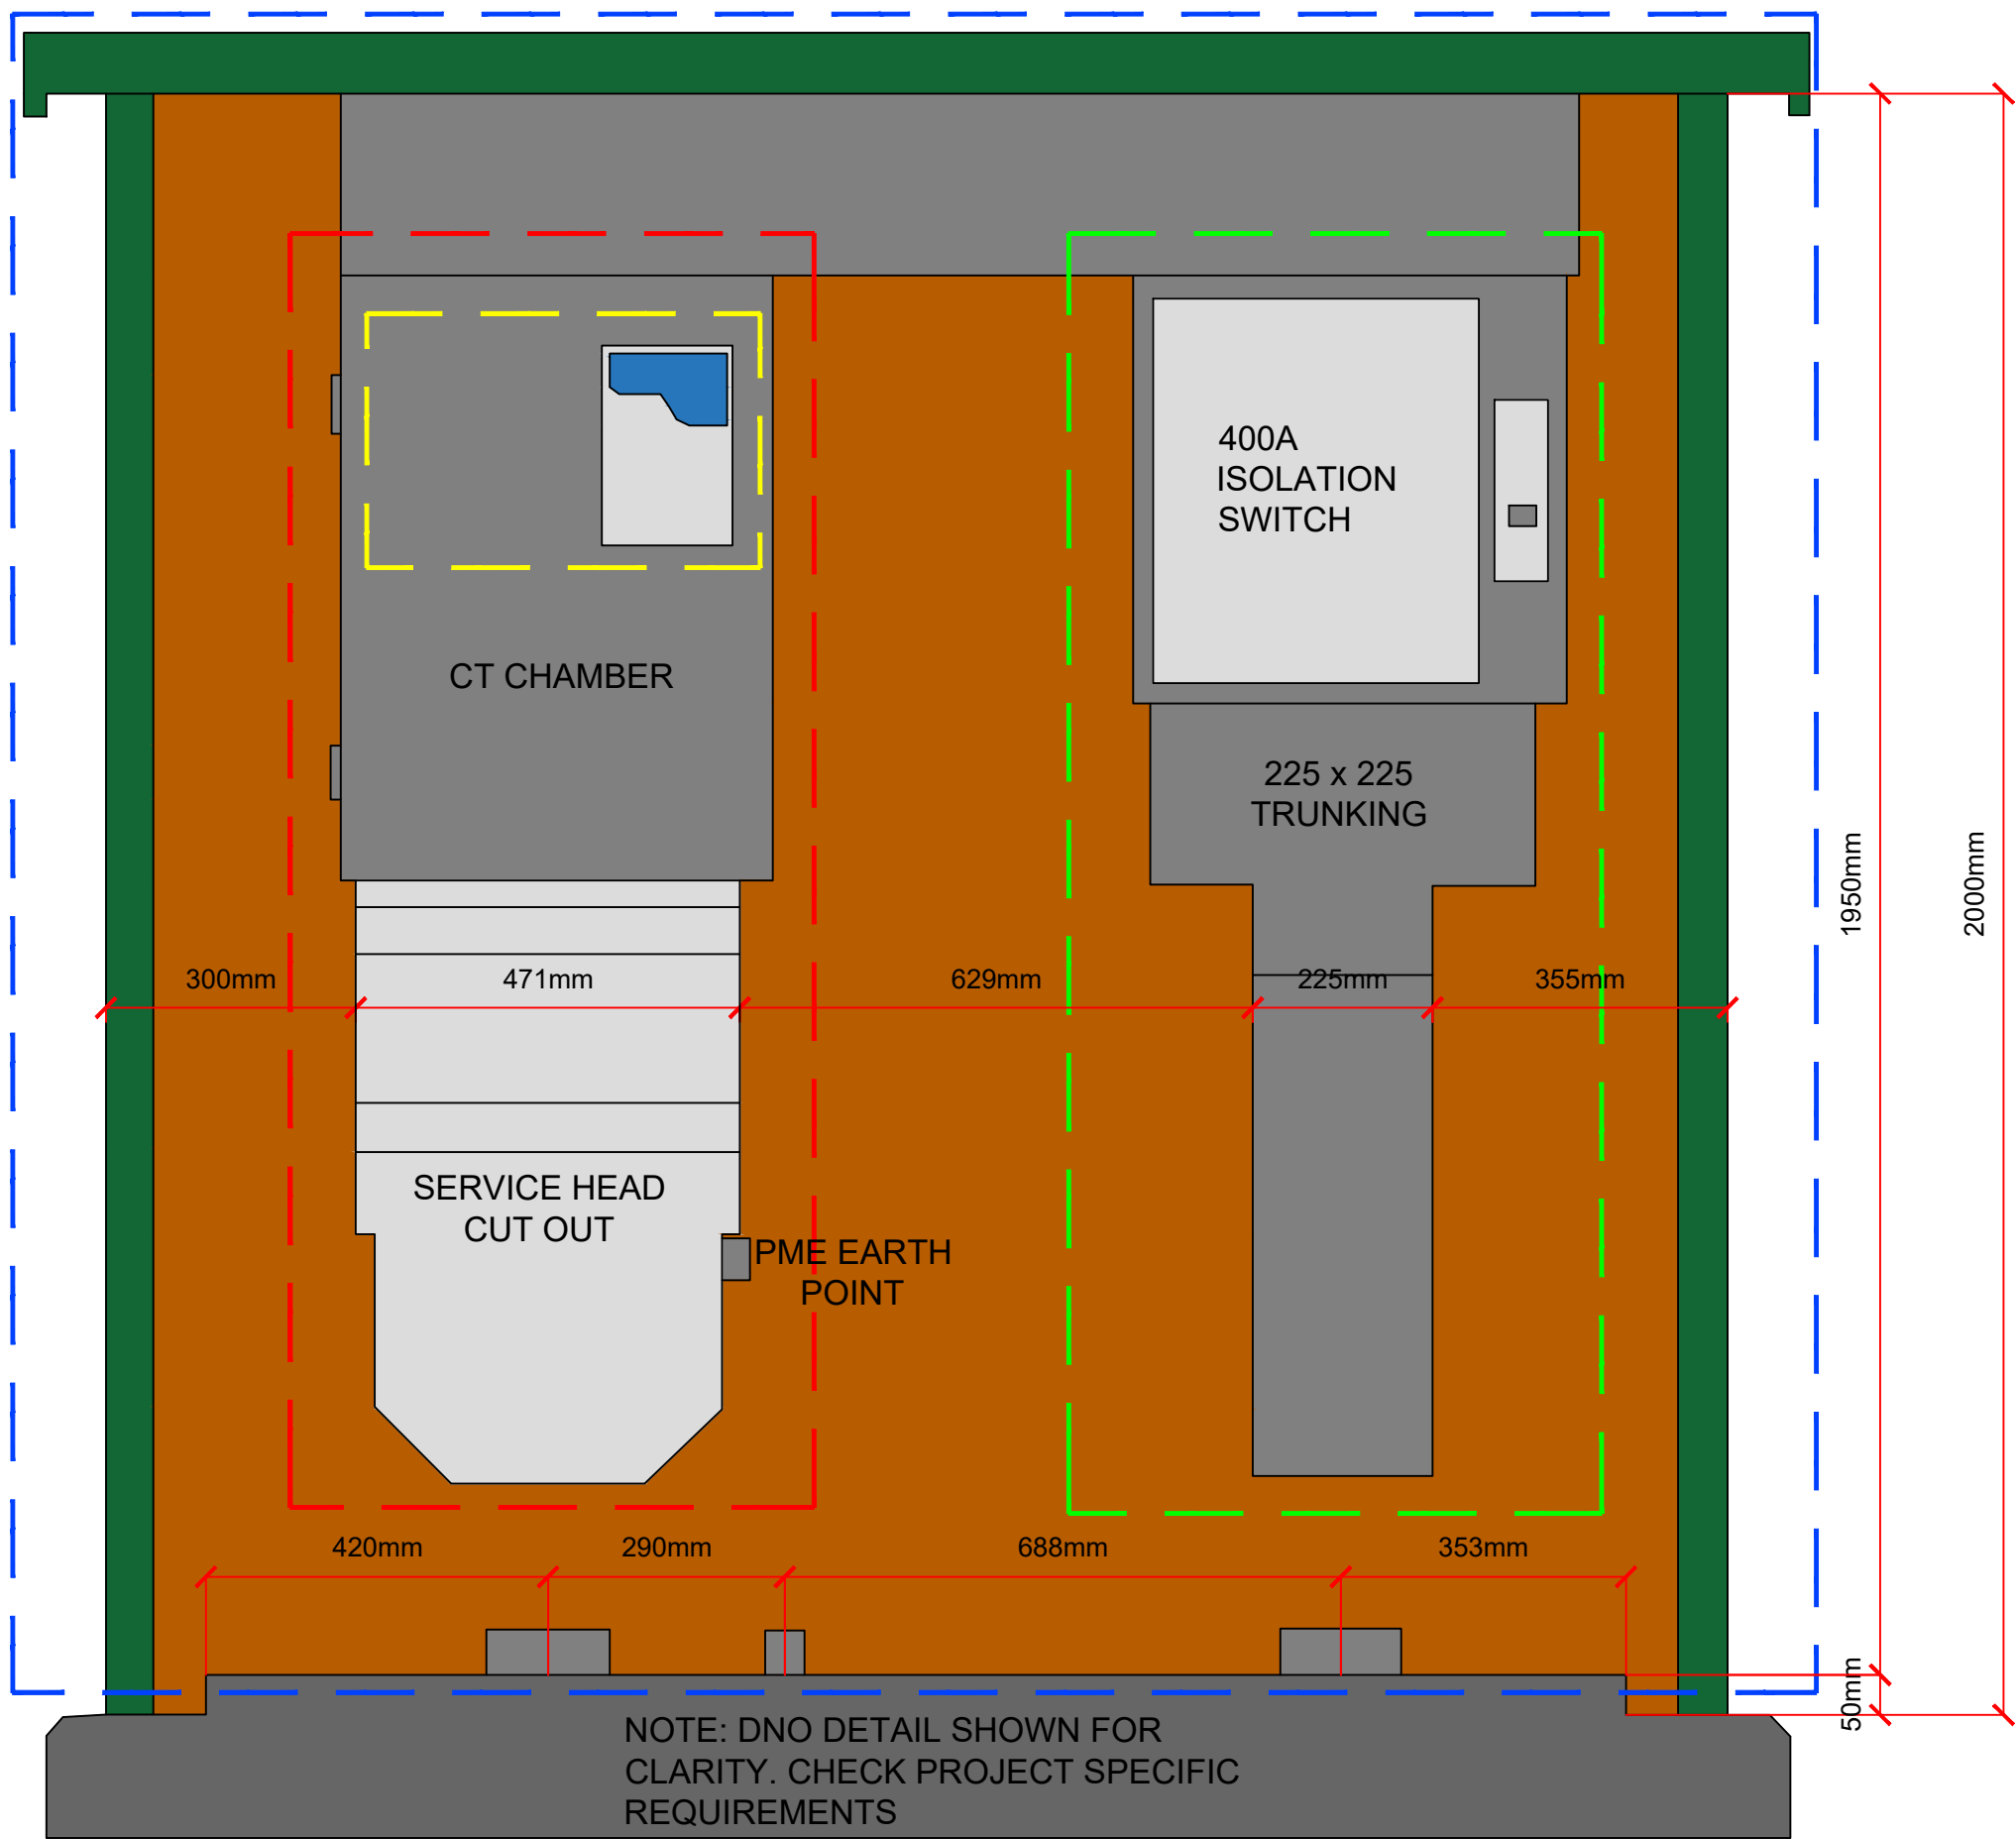

REFERENCING

REF: LIDL GB - INVITATION TO TENDER - 04/04/25- PG 6/12 - FIG.1 EXAMPLE EVC FEEDER PILLAR SETTING OUT.

REF: LIDL GB - ELECTRIC VEHICLE CHARGING - DNO FED - 27/11/24 - EE-20-2 - FIG.10 EVC GRP ENCLOSURE (DNO SUPPLY)

STEP1 -GRP ENCLOSURE BY ELECTRICAL CONTRACTOR. BASE BY MAIN CONTRACTOR.

STEP2 -ELECTRICAL CONTRACTOR TO SUPPLY AND INSTALL THE EVC SUPPLY EQUIPMENT. TAILS TO BE LEFT READY FOR DNO VISIT.

STEP3 -DNO TO SUPPLY AND INSTALL THE SERVICE HEAD/ CUT OUT WITH FUSES AND TERMINATE THE TAILS.

STEP4 -IMSERV -TO SUPPLY AND INSTALL THE METER (THIS INCLUDES THE ISOLATOR AND TAILS CONNECTION ON 69kVA SUPPLIES).

GRP ENCLOSURE RESPONSIBILITIES GENERAL NOTES

1 - GRP HOUSING MUST BE FIXED TO THE GROUND / FOUNDATION

2 - GRP HOUSING MUST BE VENTED AND CONTAIN A KEY LOCK / LOCKBOX.

3 - DUCT RUNS OVER 100 METRES IN LENGTH WILL REQUIRE, MULTIPLE DUCTS AND DRAW PITS TO BE INSTALLED DEPENDANT ON DESIGN, NUMBER OF CHARGERS AND IN THE EVENT OF DAMAGED DUCTS

BE Utility Solutions Ltd
PROFESSIONAL UTILITY CONSULTING

Unit 3, 1 Meridian South, Meridian Business Park, LE19 1WY
e-mail: info@beutilitiesolutions.co.uk

This drawing is the property of BE Utility Solutions Ltd. It must not be reproduced, copied nor its contents divulged without permission.
This drawing is to be read in conjunction with all other engineering drawings, if in doubt - ask, do not scale. The accuracy of information provided on this drawing is believed to be correct at the time of issue but cannot be guaranteed, therefore no liability of any kind is accepted by the company or its agents. The contractor is advised to undertake their own investigation where the presence of existing utilities/apparatus may affect their work.
All work to be carried out in accordance with the relevant British Standards, codes of practice and building practice.

Client **PARCO CIVIL ENGINEERING**

Issue **INFORMATION**

Contract **--**

Title **EVC GRP ENCLOSURE SET OUT**

Designed By	Drawn By	Checked By	Approved By
PM	PM	EW	BJG

Date	31/10/2025	Scale	NOT TO SCALE
------	-------------------	-------	---------------------

Drawing Number	LIDL-CON-I-003	Revision	0
----------------	-----------------------	----------	----------