



ELEVATION - Extract and toilet termination

Scale 1:50

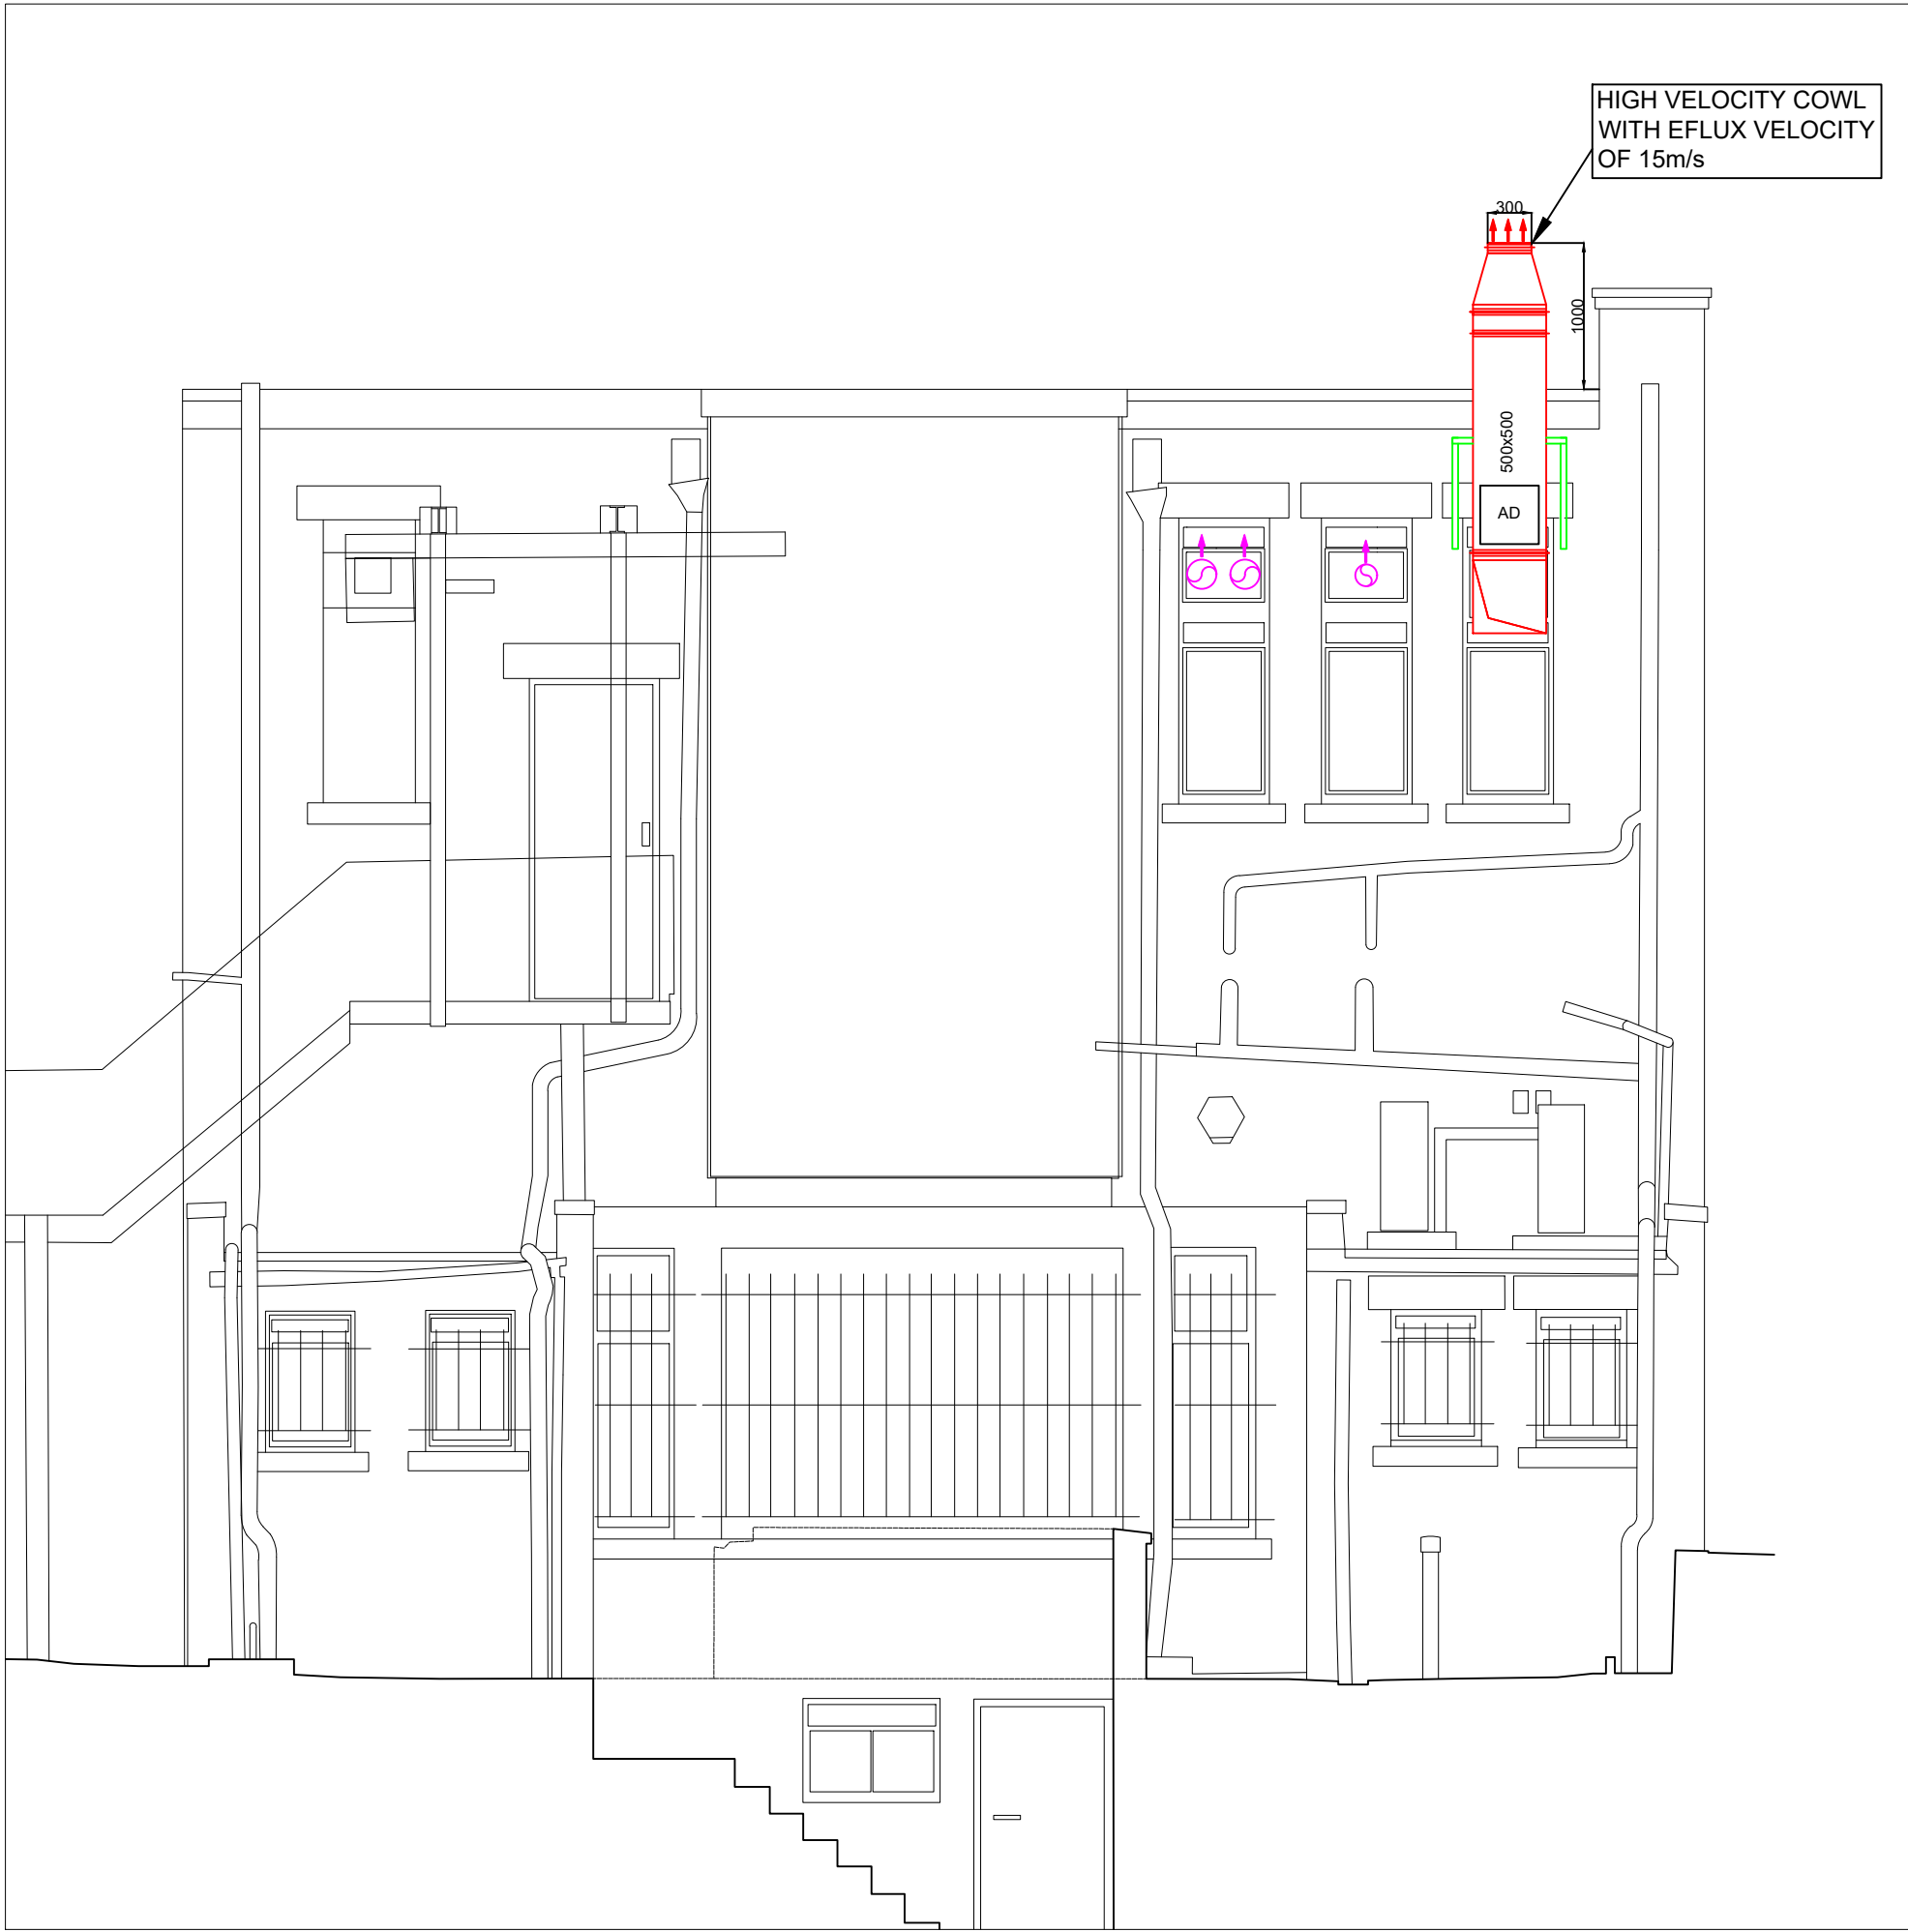


ELEVATION - South Side

Scale 1:50

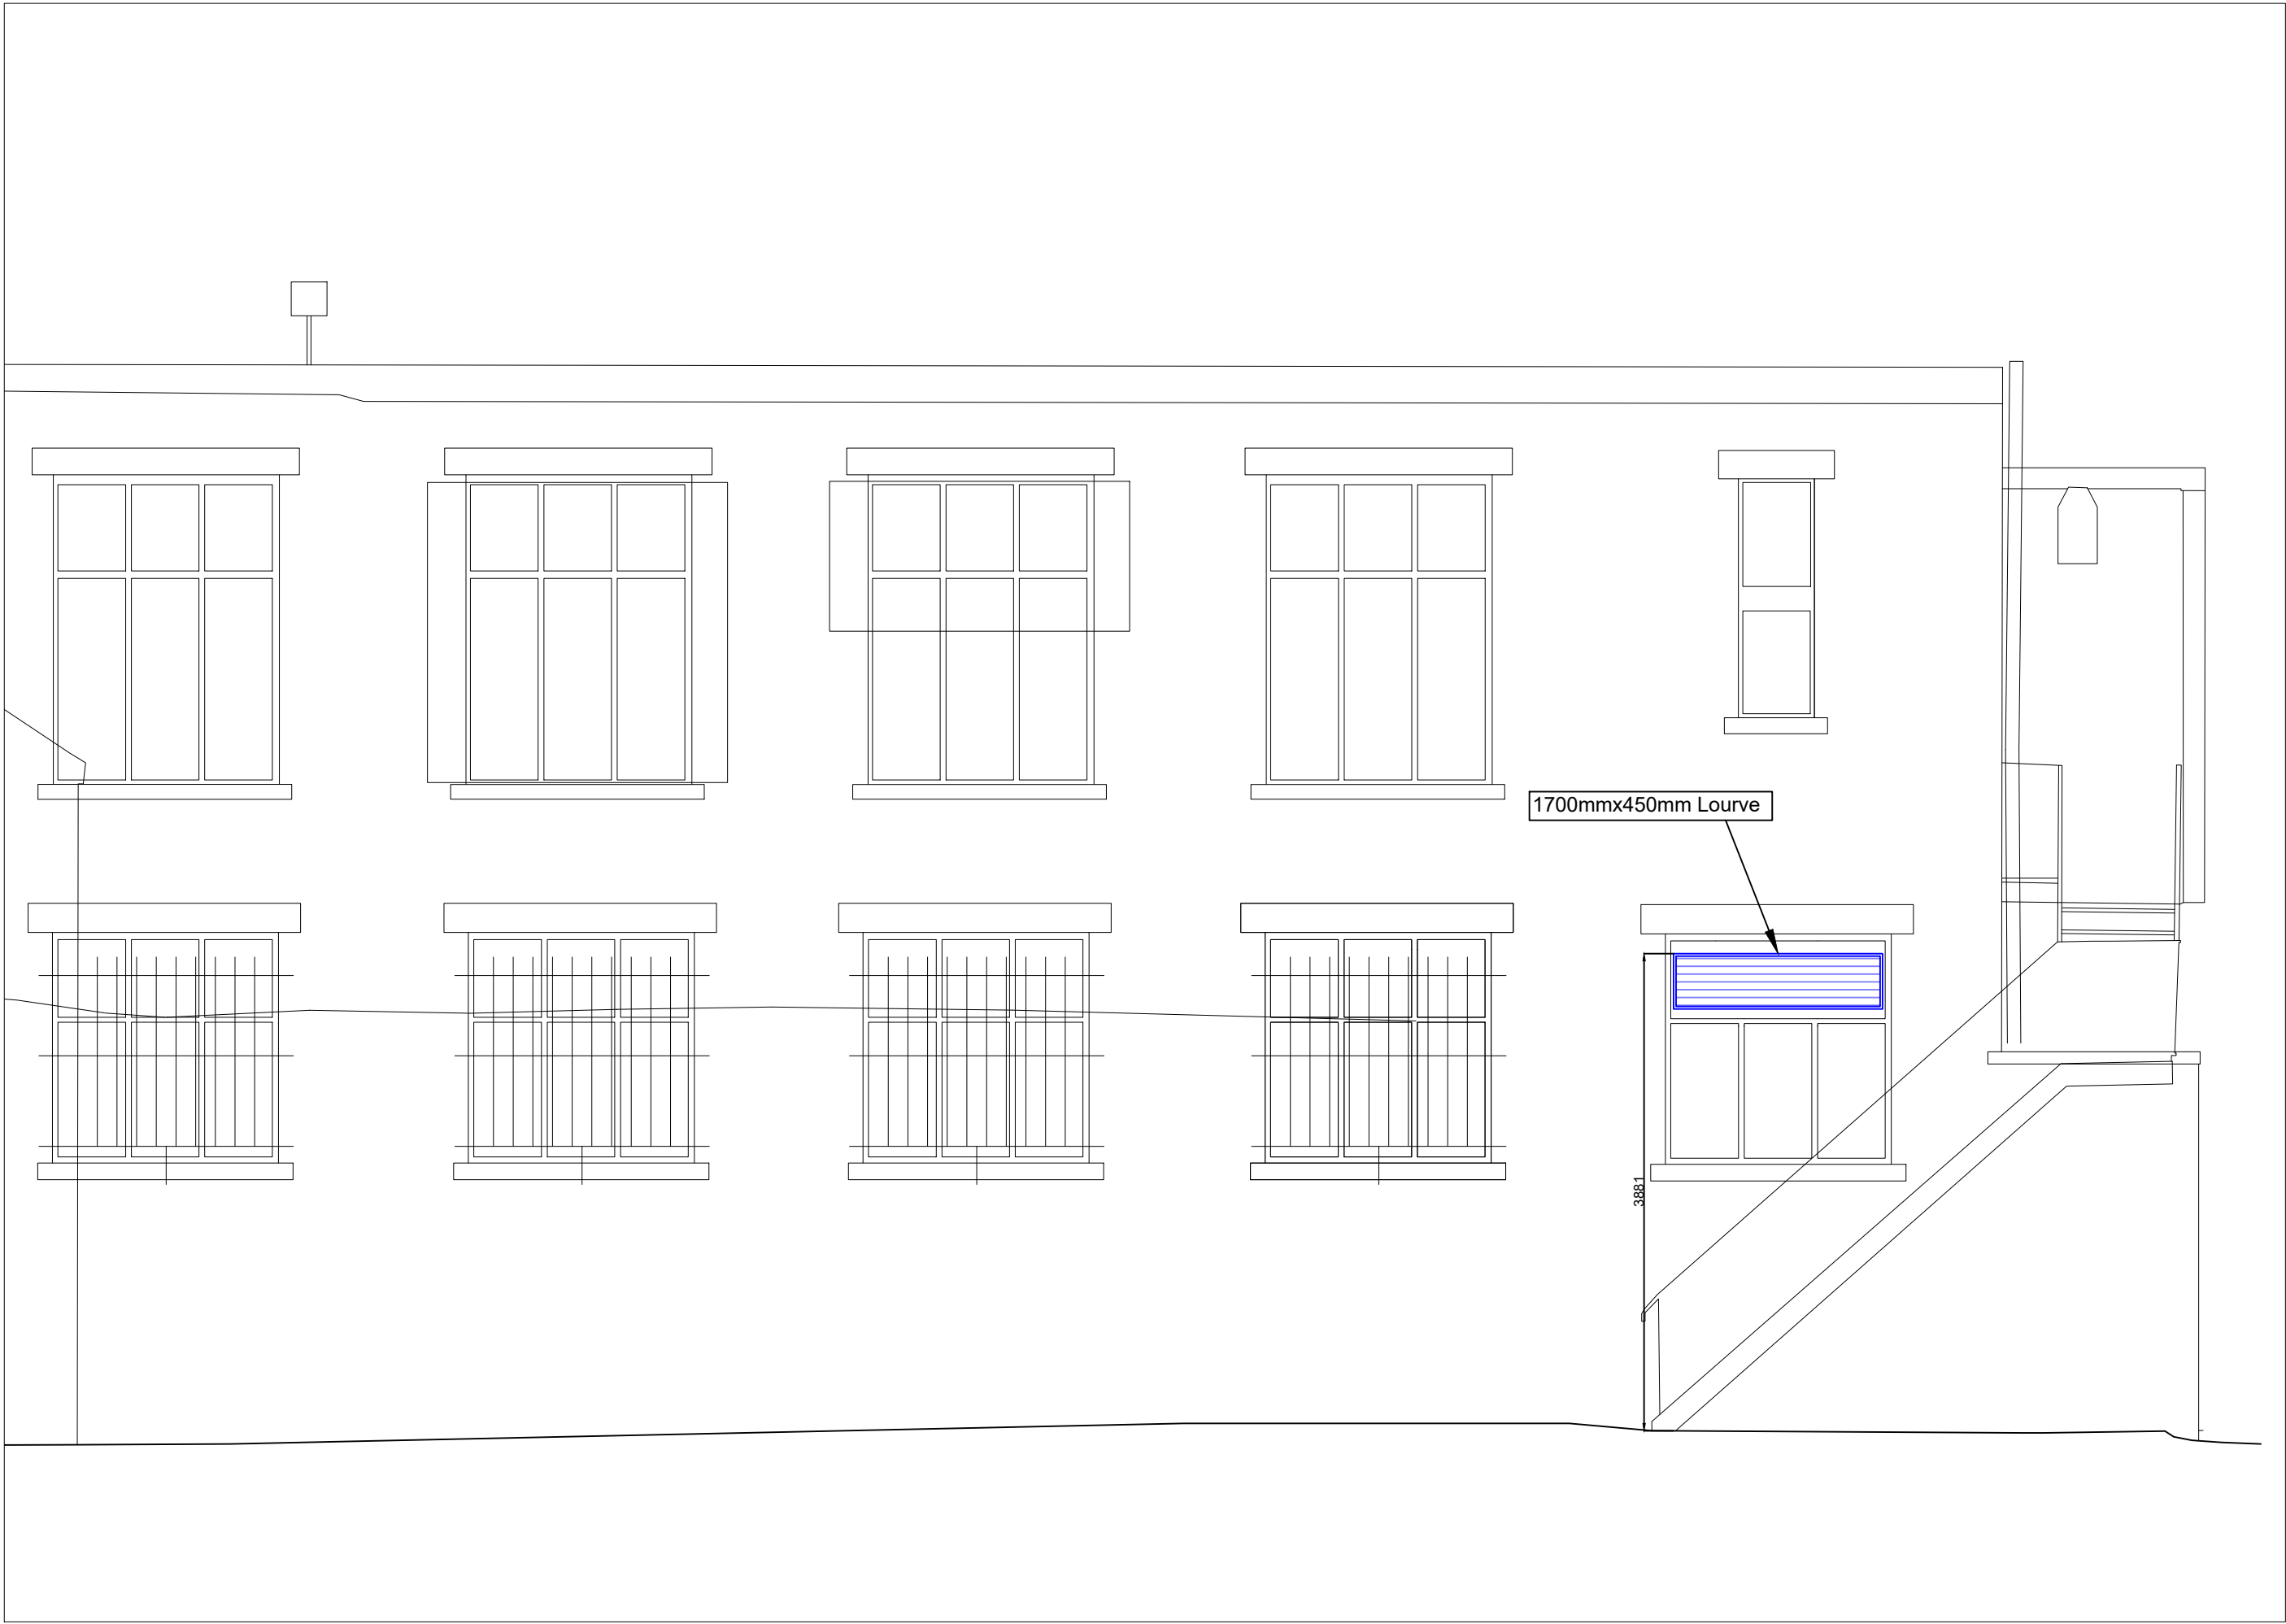


SECTION A-A - Supply run

Scale 1:25

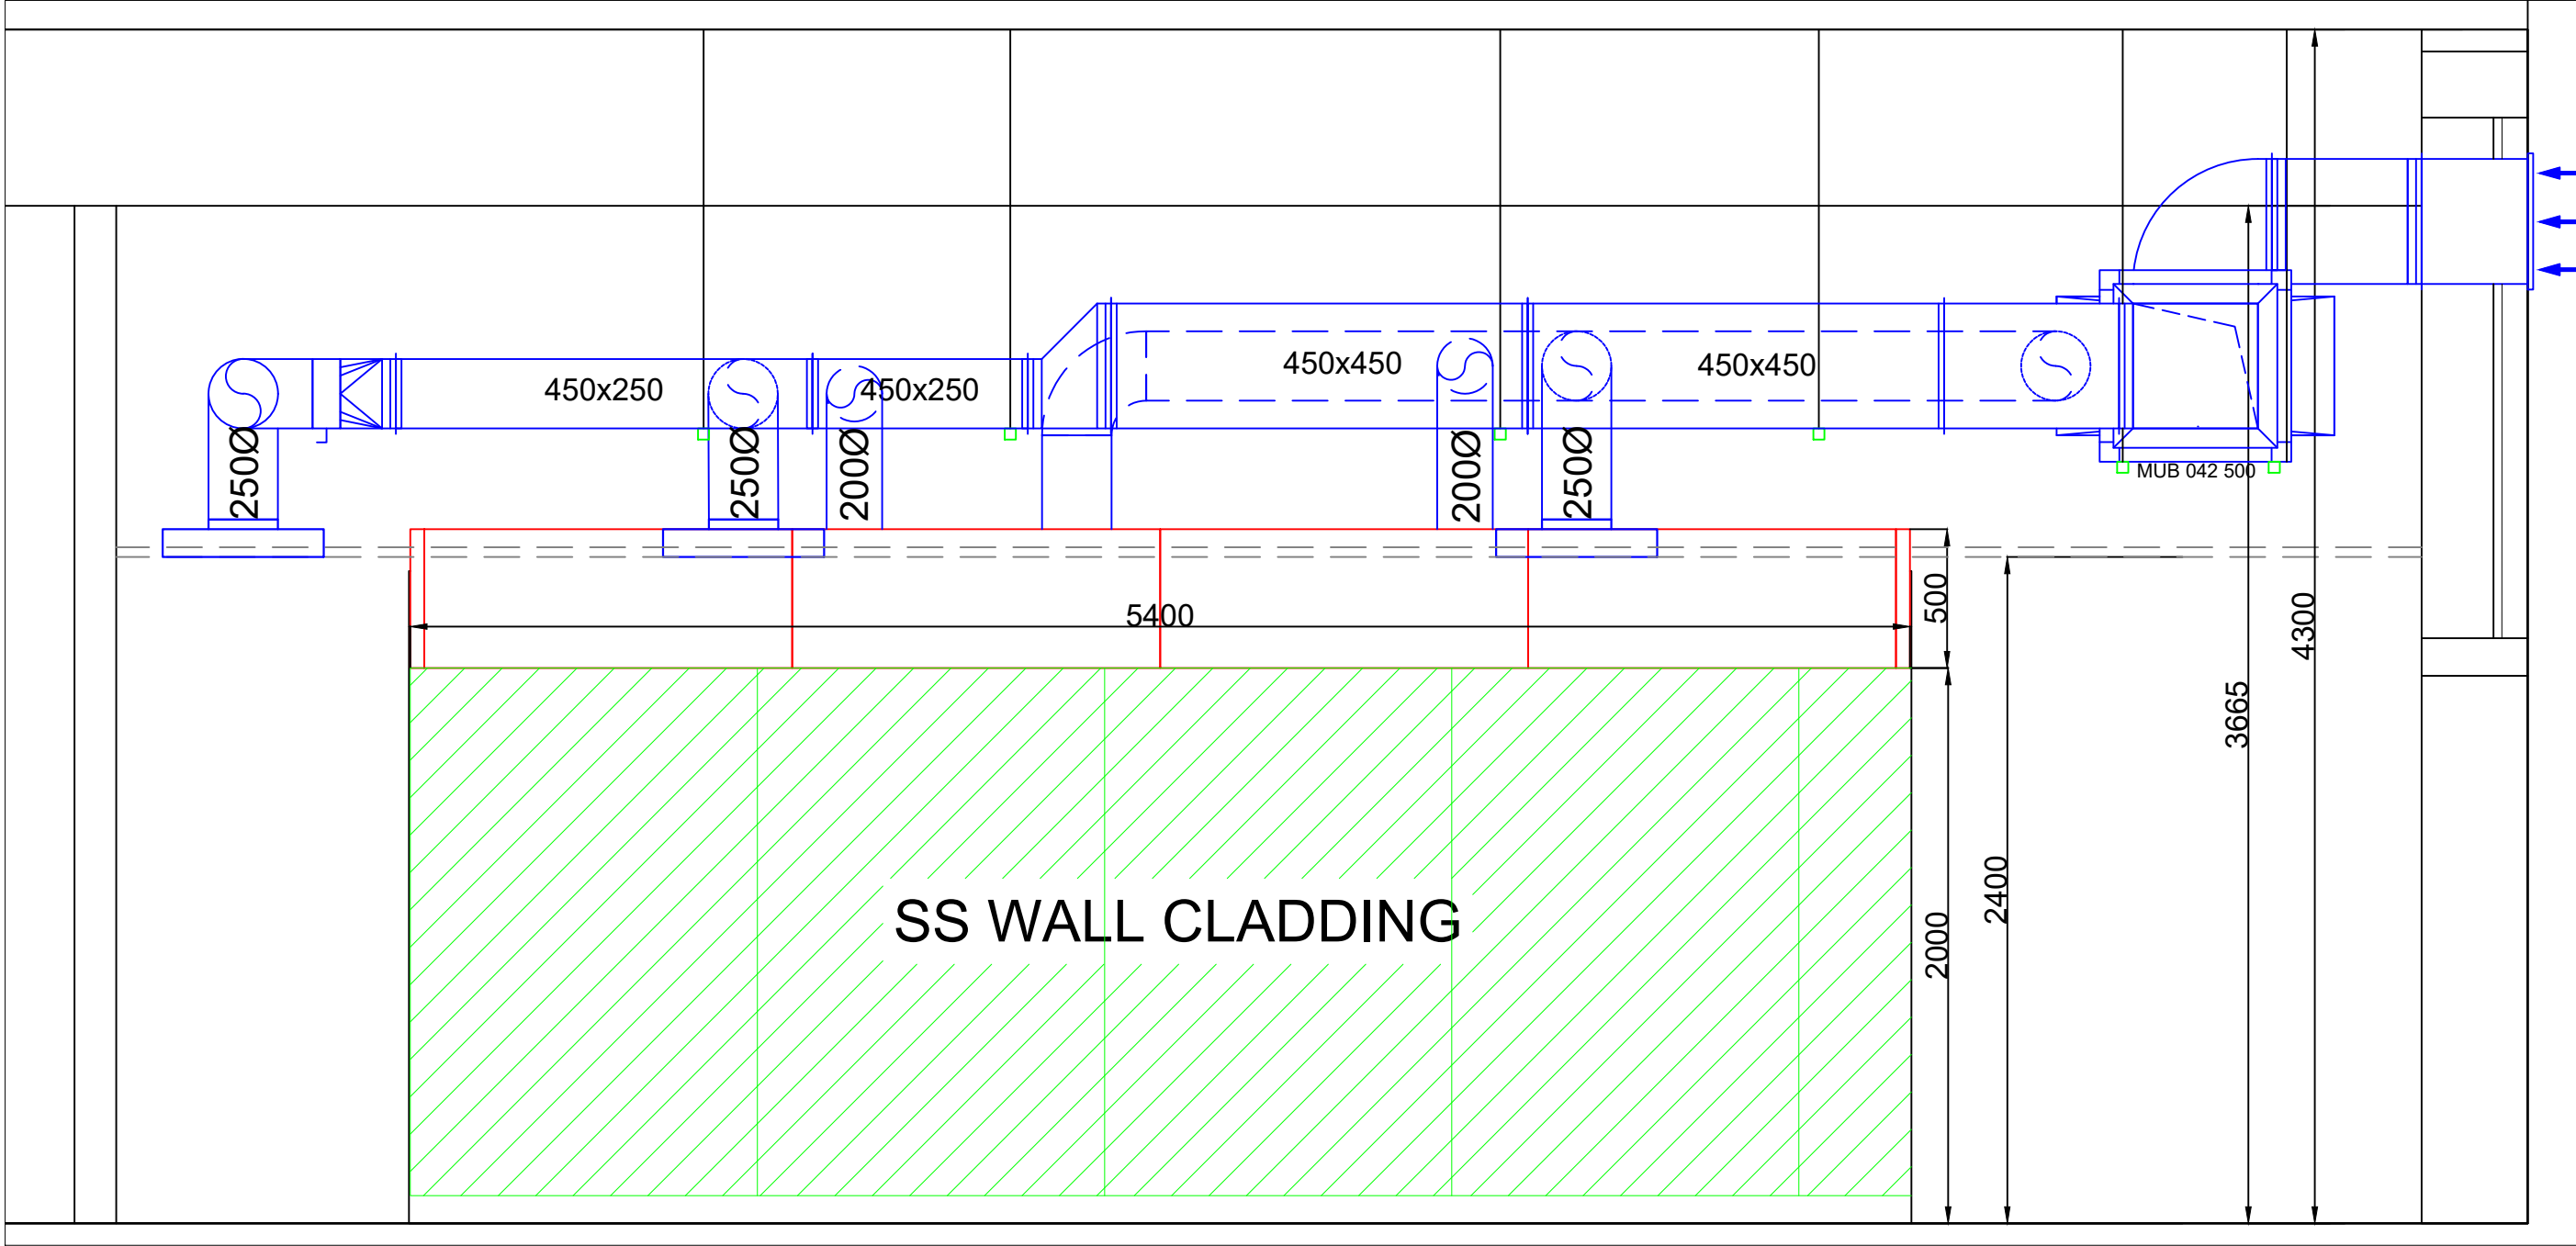

SECTION A-A - Extract run

Scale 1:25

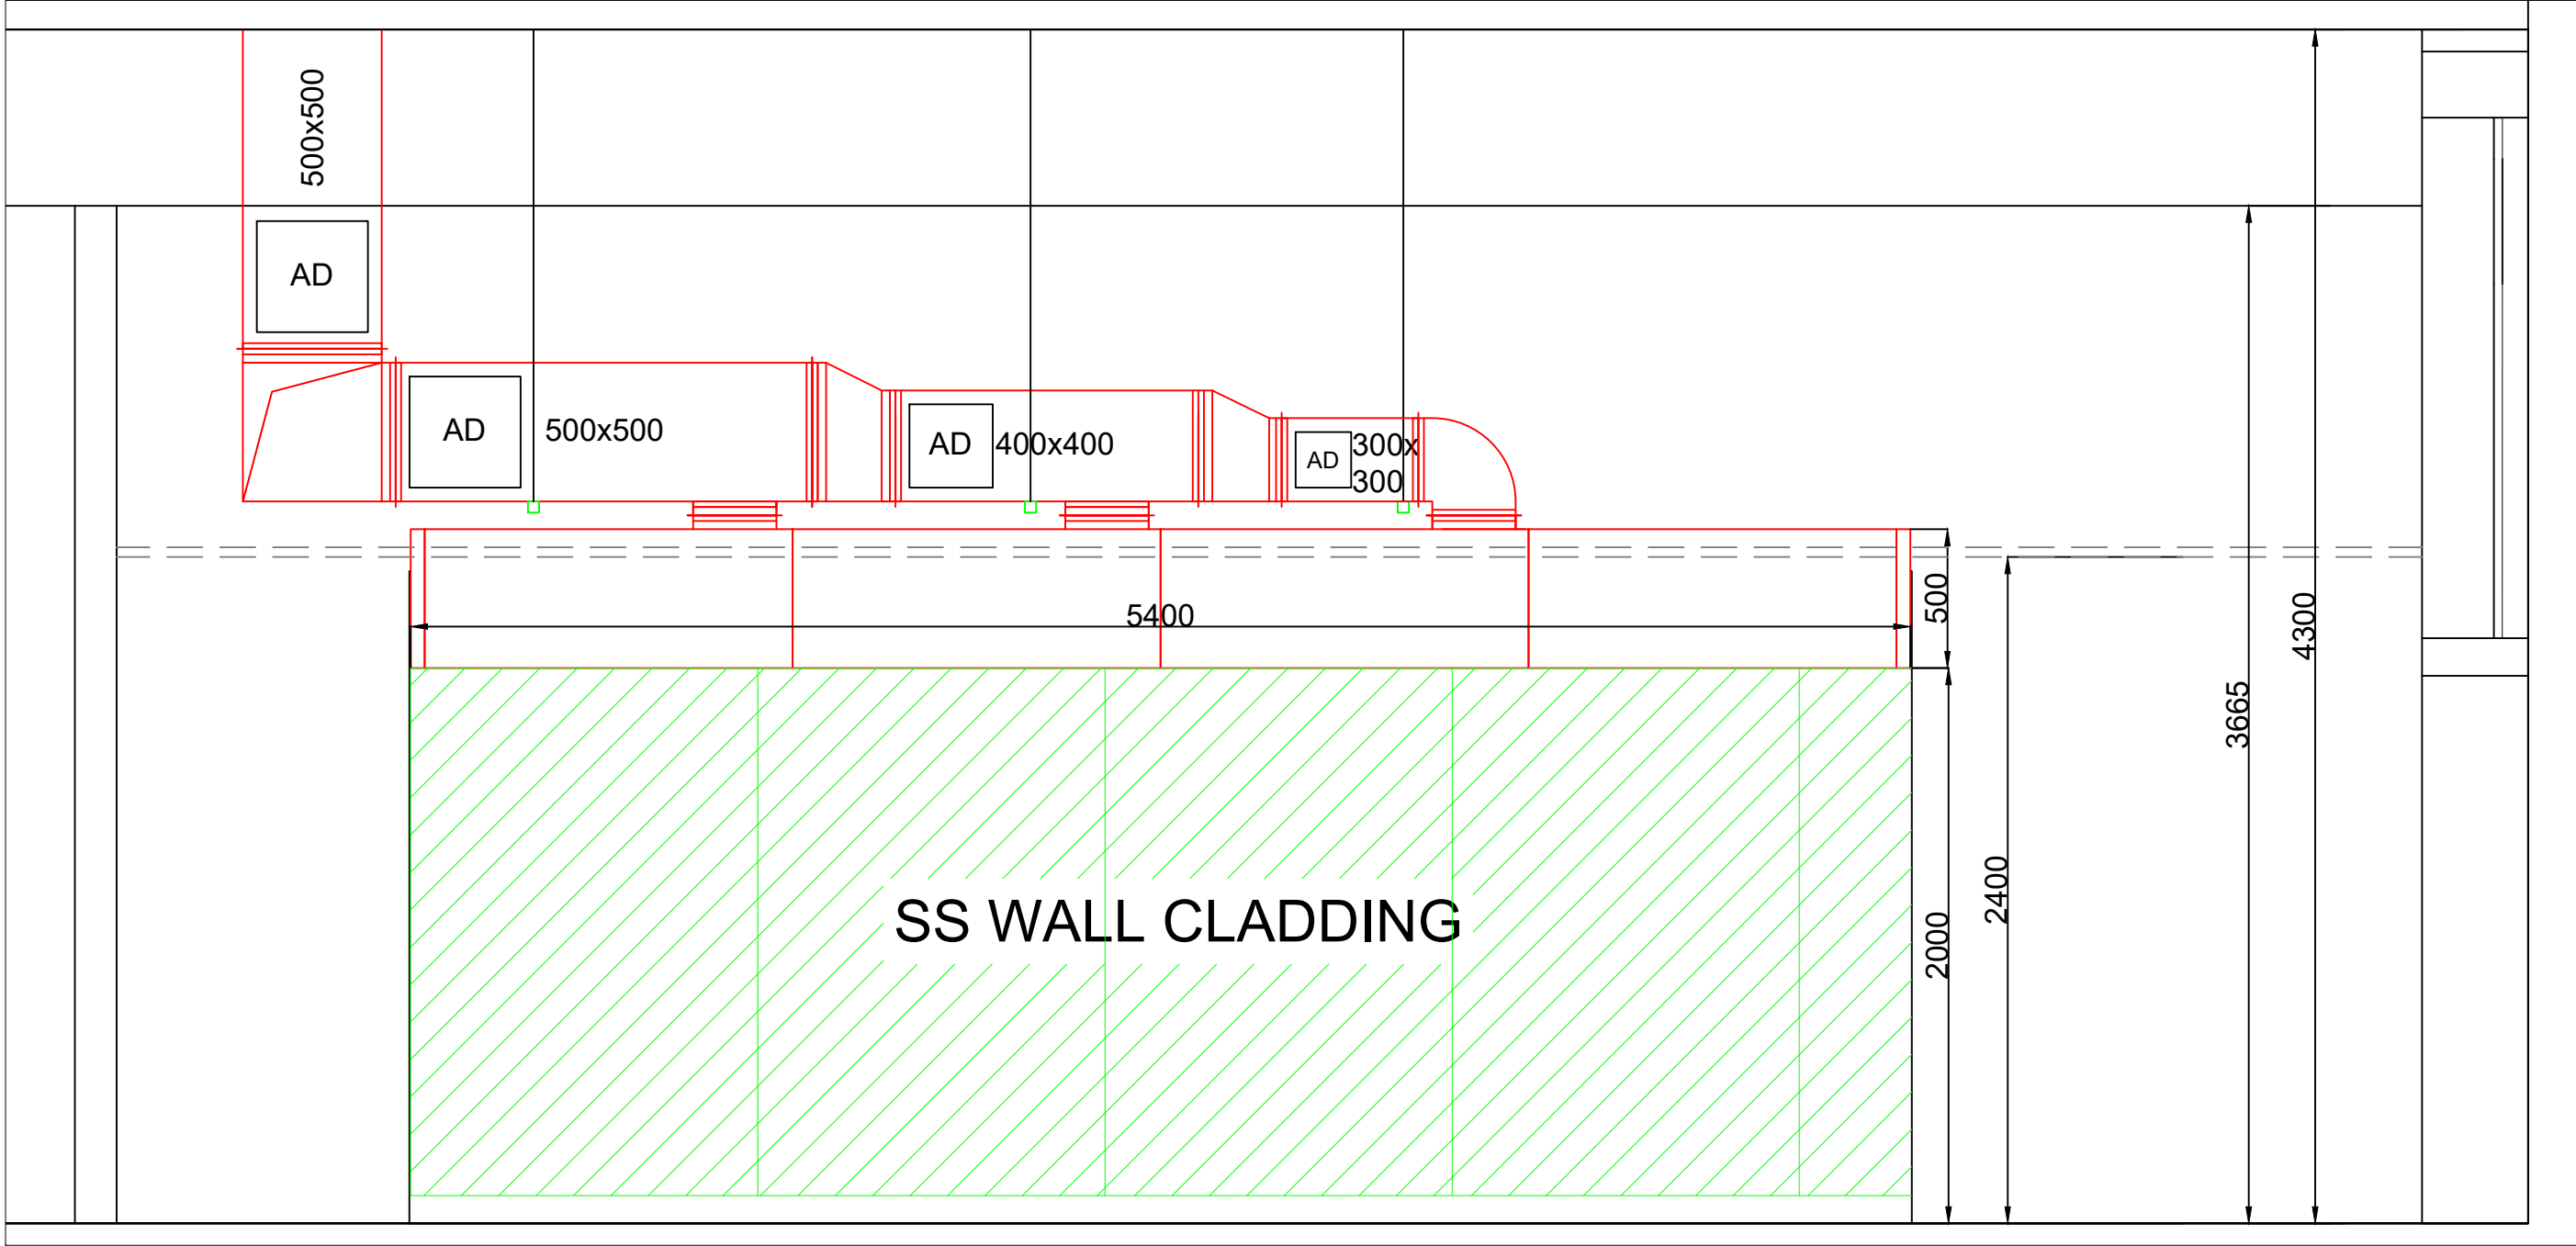

DO NOT SCALE FROM THIS DRAWING!
All measurements in mm with a tolerance +/- 1mm
All power & services installation by client/M&E Contractor
Ceiling grid for illustration purposes only. To be fitted by others.
Drawing to be printed in colour
ALL FIRE RATED DUCT MANUFACTURED TO BS479-24 RATED TO 120 MINUTES

Approximate canopy weight:	285kg
Approximate condensate weight:	40kg
Drawing to be used in conjunction with:	
Architect:	RPCA LNS061.02
Kitchen:	Tailormade (New Lounge) Proposed REV-1
Landlord:	-

Odour Control Checklist	
Pre-Filter	600x600x1200
Carbon	600x600x1200
Bag Filter	-
HEPA	-
ESP	ESP 4500
UV Ozone	-

Extract	VCD	Pre-filter	Double deflection grille	Canopy LED light
Extract fire rated	Carbon	Toilet Valve	Eggcrate grille	Flex
Supply	Cladding	Fire & smoke damper	Pump house anti vibration foot	Access door
Toilet extract	Brackery			
Ceiling grid				

Extract Fan Information:
Fan Model: MUB/T 062 630
Input Current: 8.08A 3ph
Airflow: 1.55m³/s @95SPa
Sound Level: 58dB at 3m sabine
Weight: 112.5kg
Controller: FC102-5.5kW

Supply Fan Information:
Fan Model: MUB 042 500
Input Current: 2.07A 3ph
Airflow: 1.32m³/s @500Pa
Sound Level: 52dB at 3m sabine
Weight: 53kg
Controller: FC102-2.2kW

Ancillary Fan Information:
Fan Model: KVK 200 SILENT
Input Current: 0.21A 1ph
Airflow: -
Sound Level: 33dB at 3m sabine
Weight: 17.2kg
Controller: -

Ancillary Fan Information:
Fan Model: KVK 160 SILENT
Input Current: 0.4A 1ph
Airflow: -
Sound Level: 37dB at 3m sabine
Weight: 17.2kg
Controller: -

Project:	Eastleigh Lounge
Client:	Loungers
Drawing No:	-02
Drawn By:	LW
Drawing view:	ELEVATION & SECTION
Status:	FOR APPROVAL
Site Address:	7-9, Market Street, Eastleigh, Hampshire SO50 5RH
Date:	15/09/2026
Revision:	-
Paper Size:	A1