



PLAN - Kitchen GF

Scale 1:50

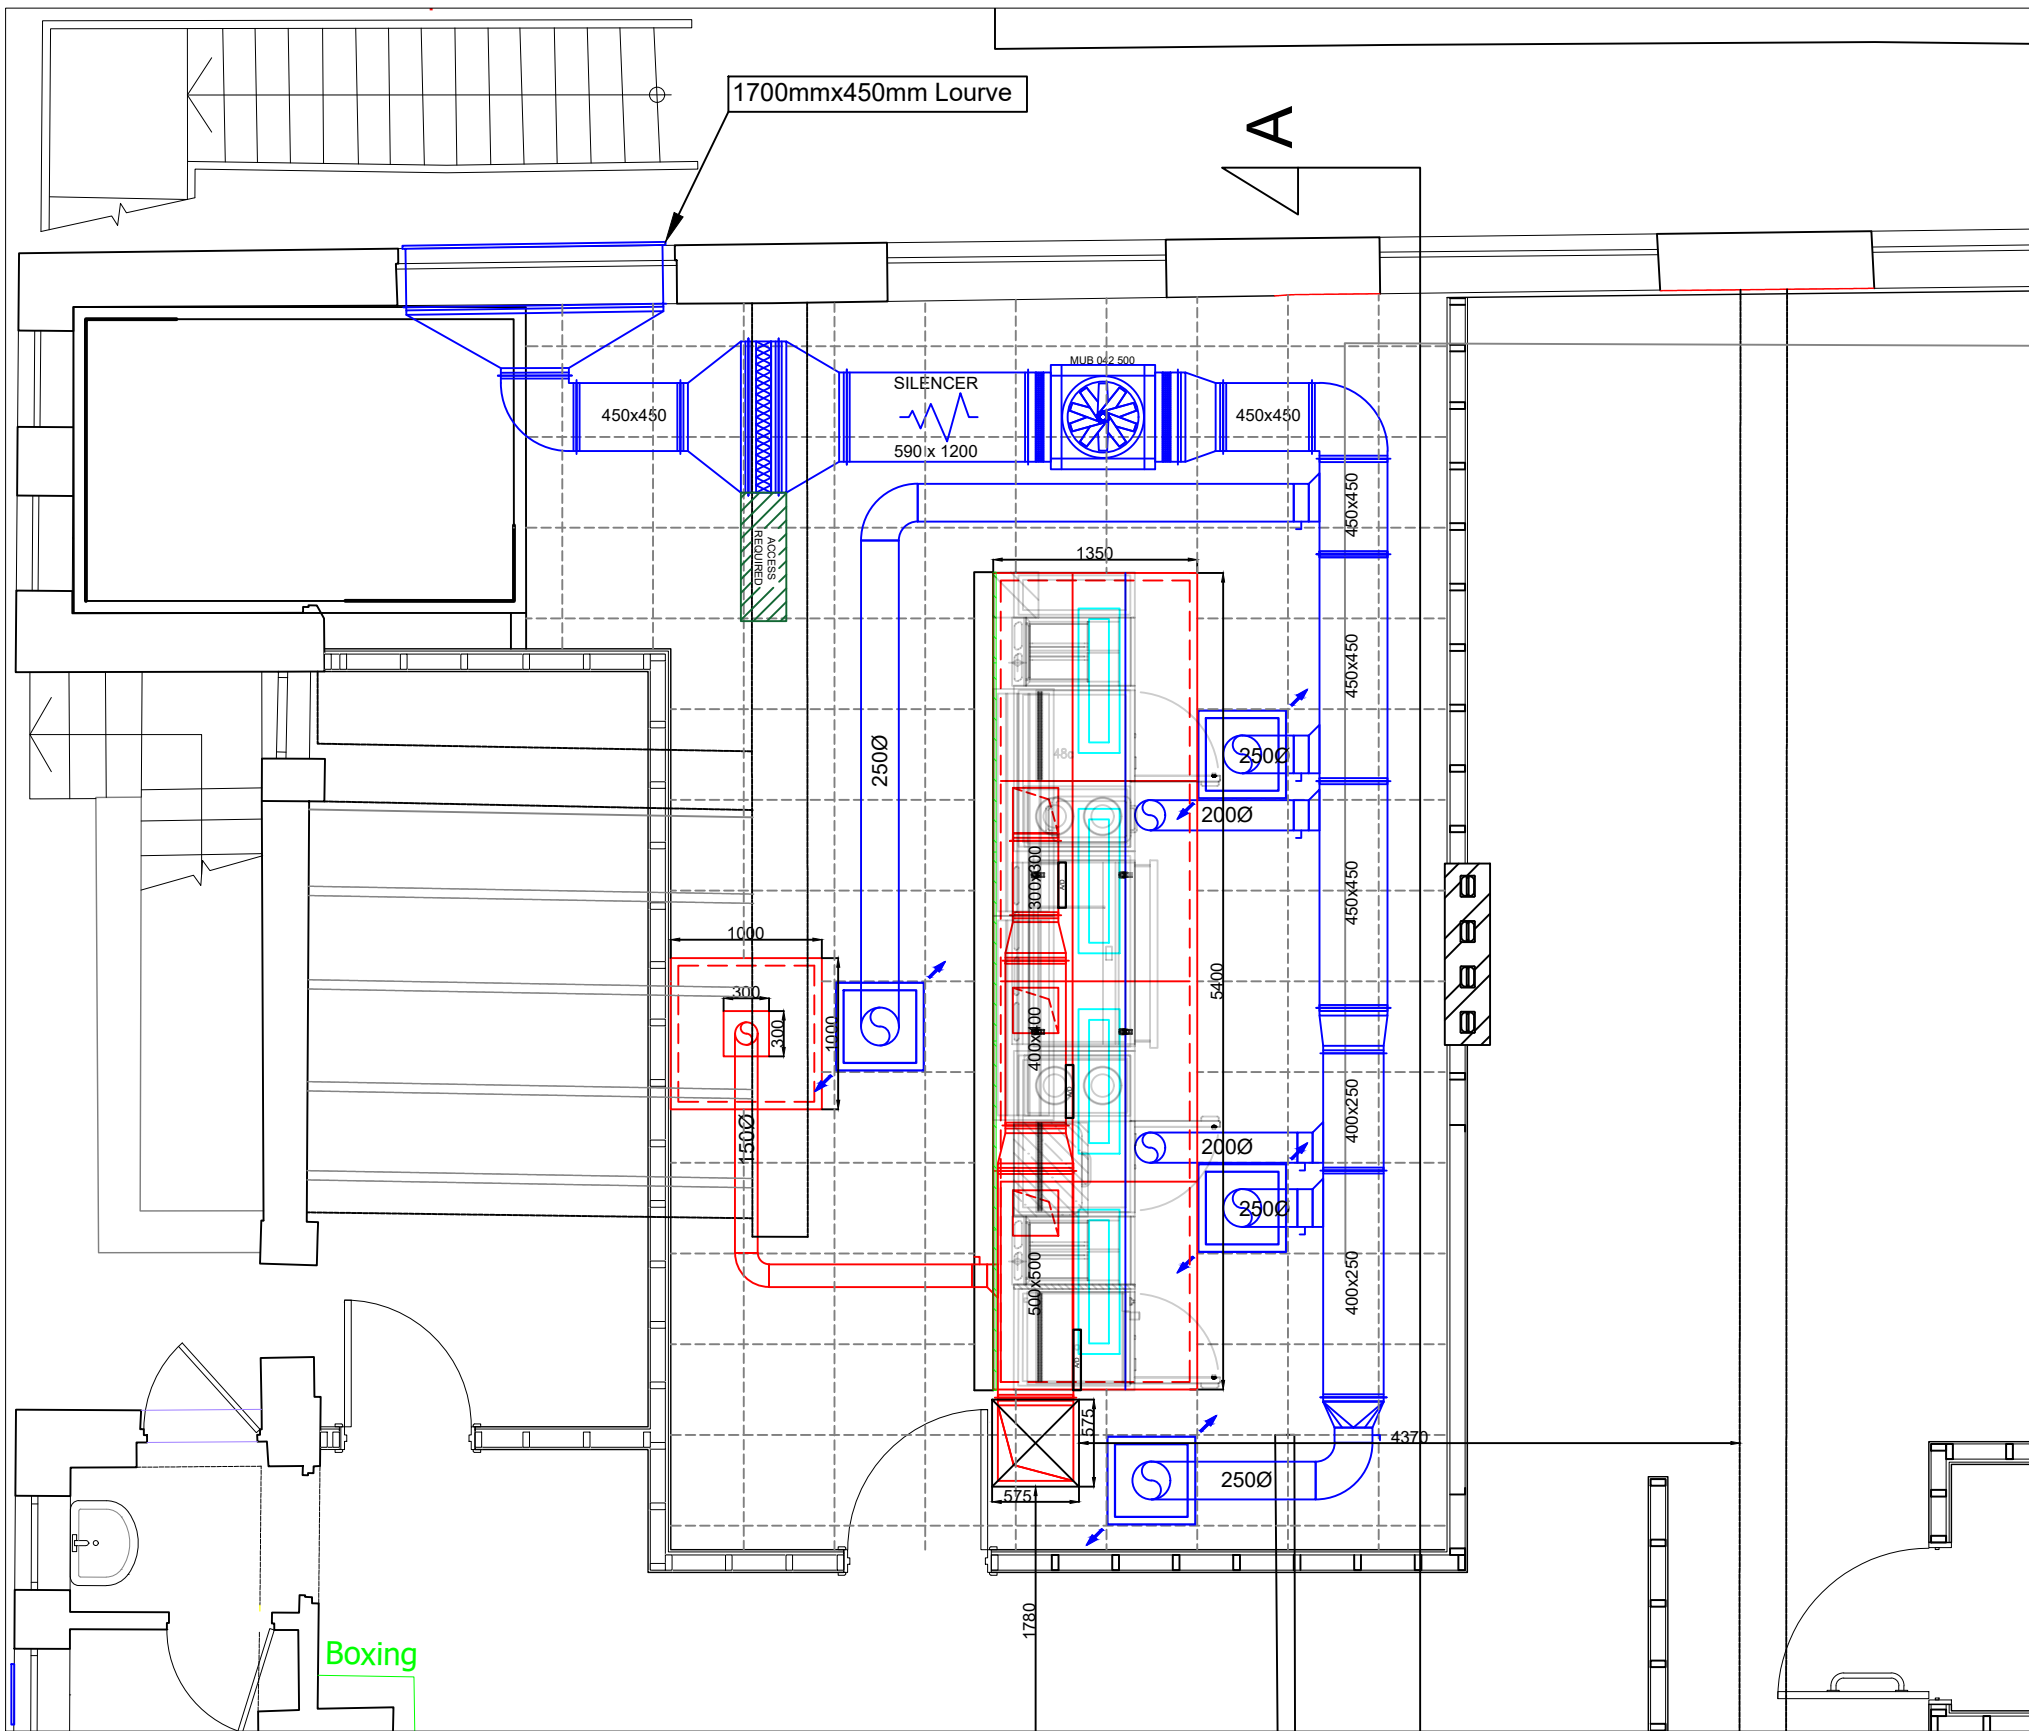


SECTION B-B- Extract run

Scale 1:25

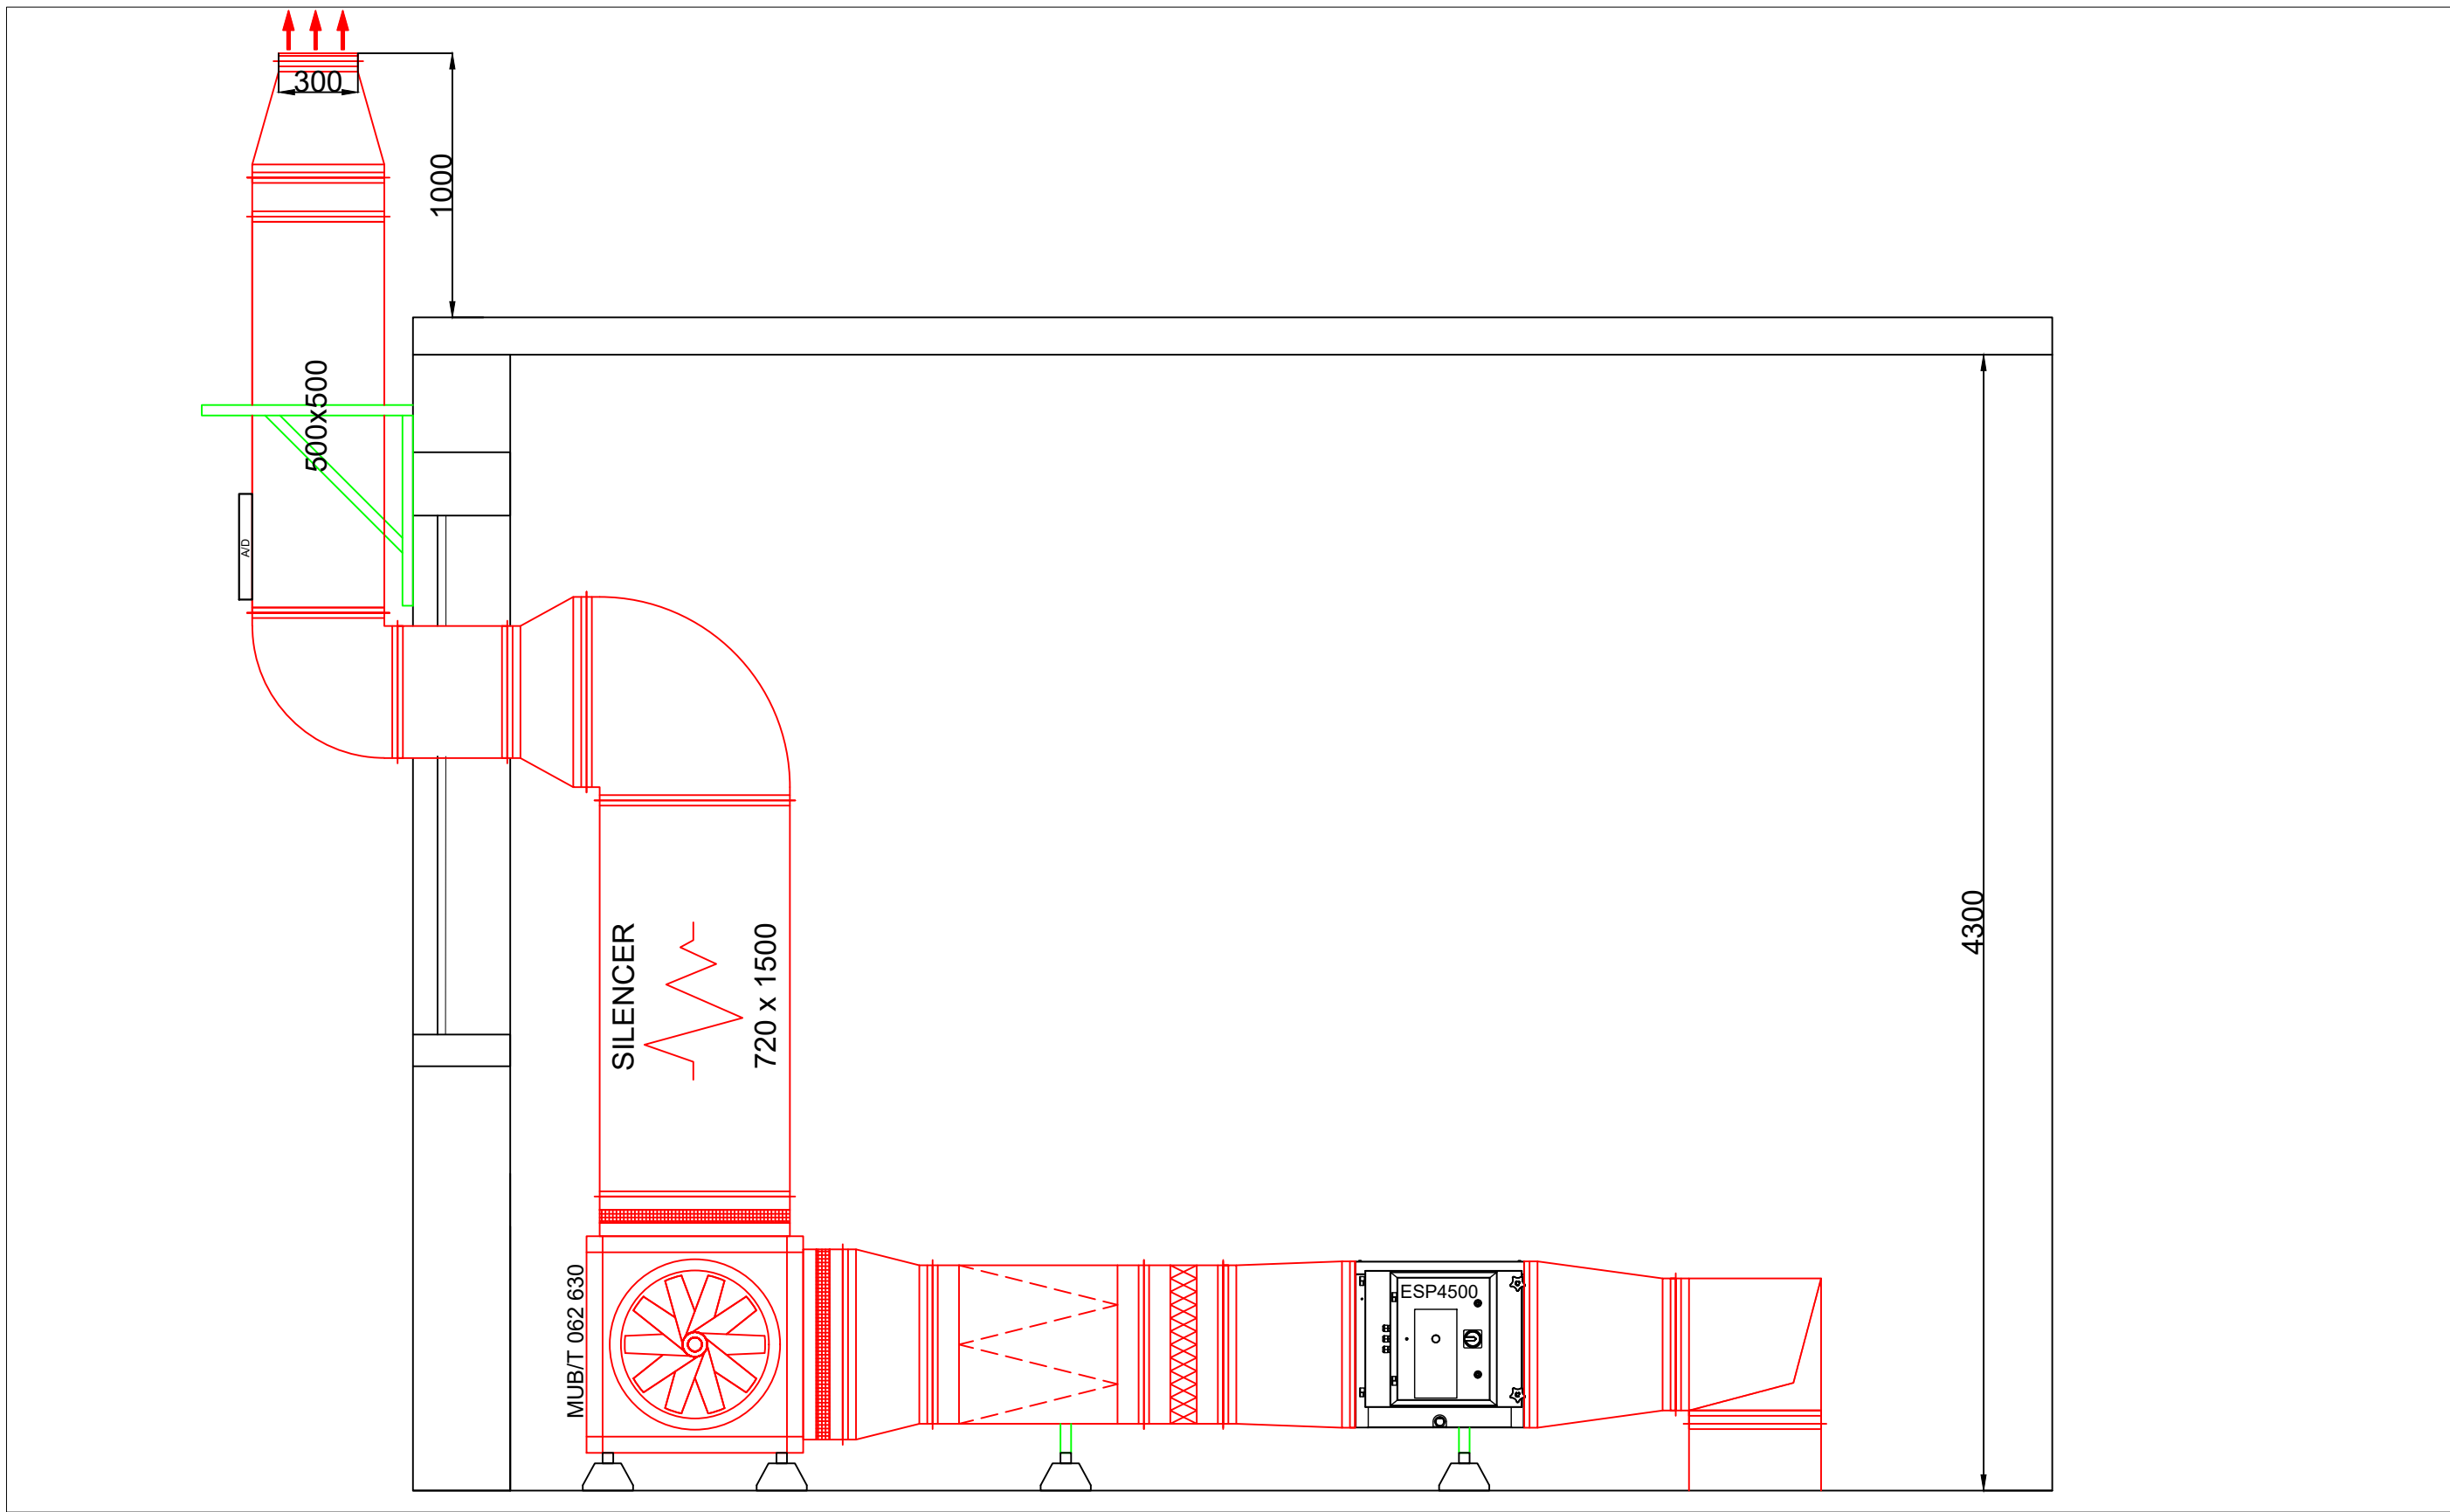


PLAN - Toilet & Extract run

Scale 1:50

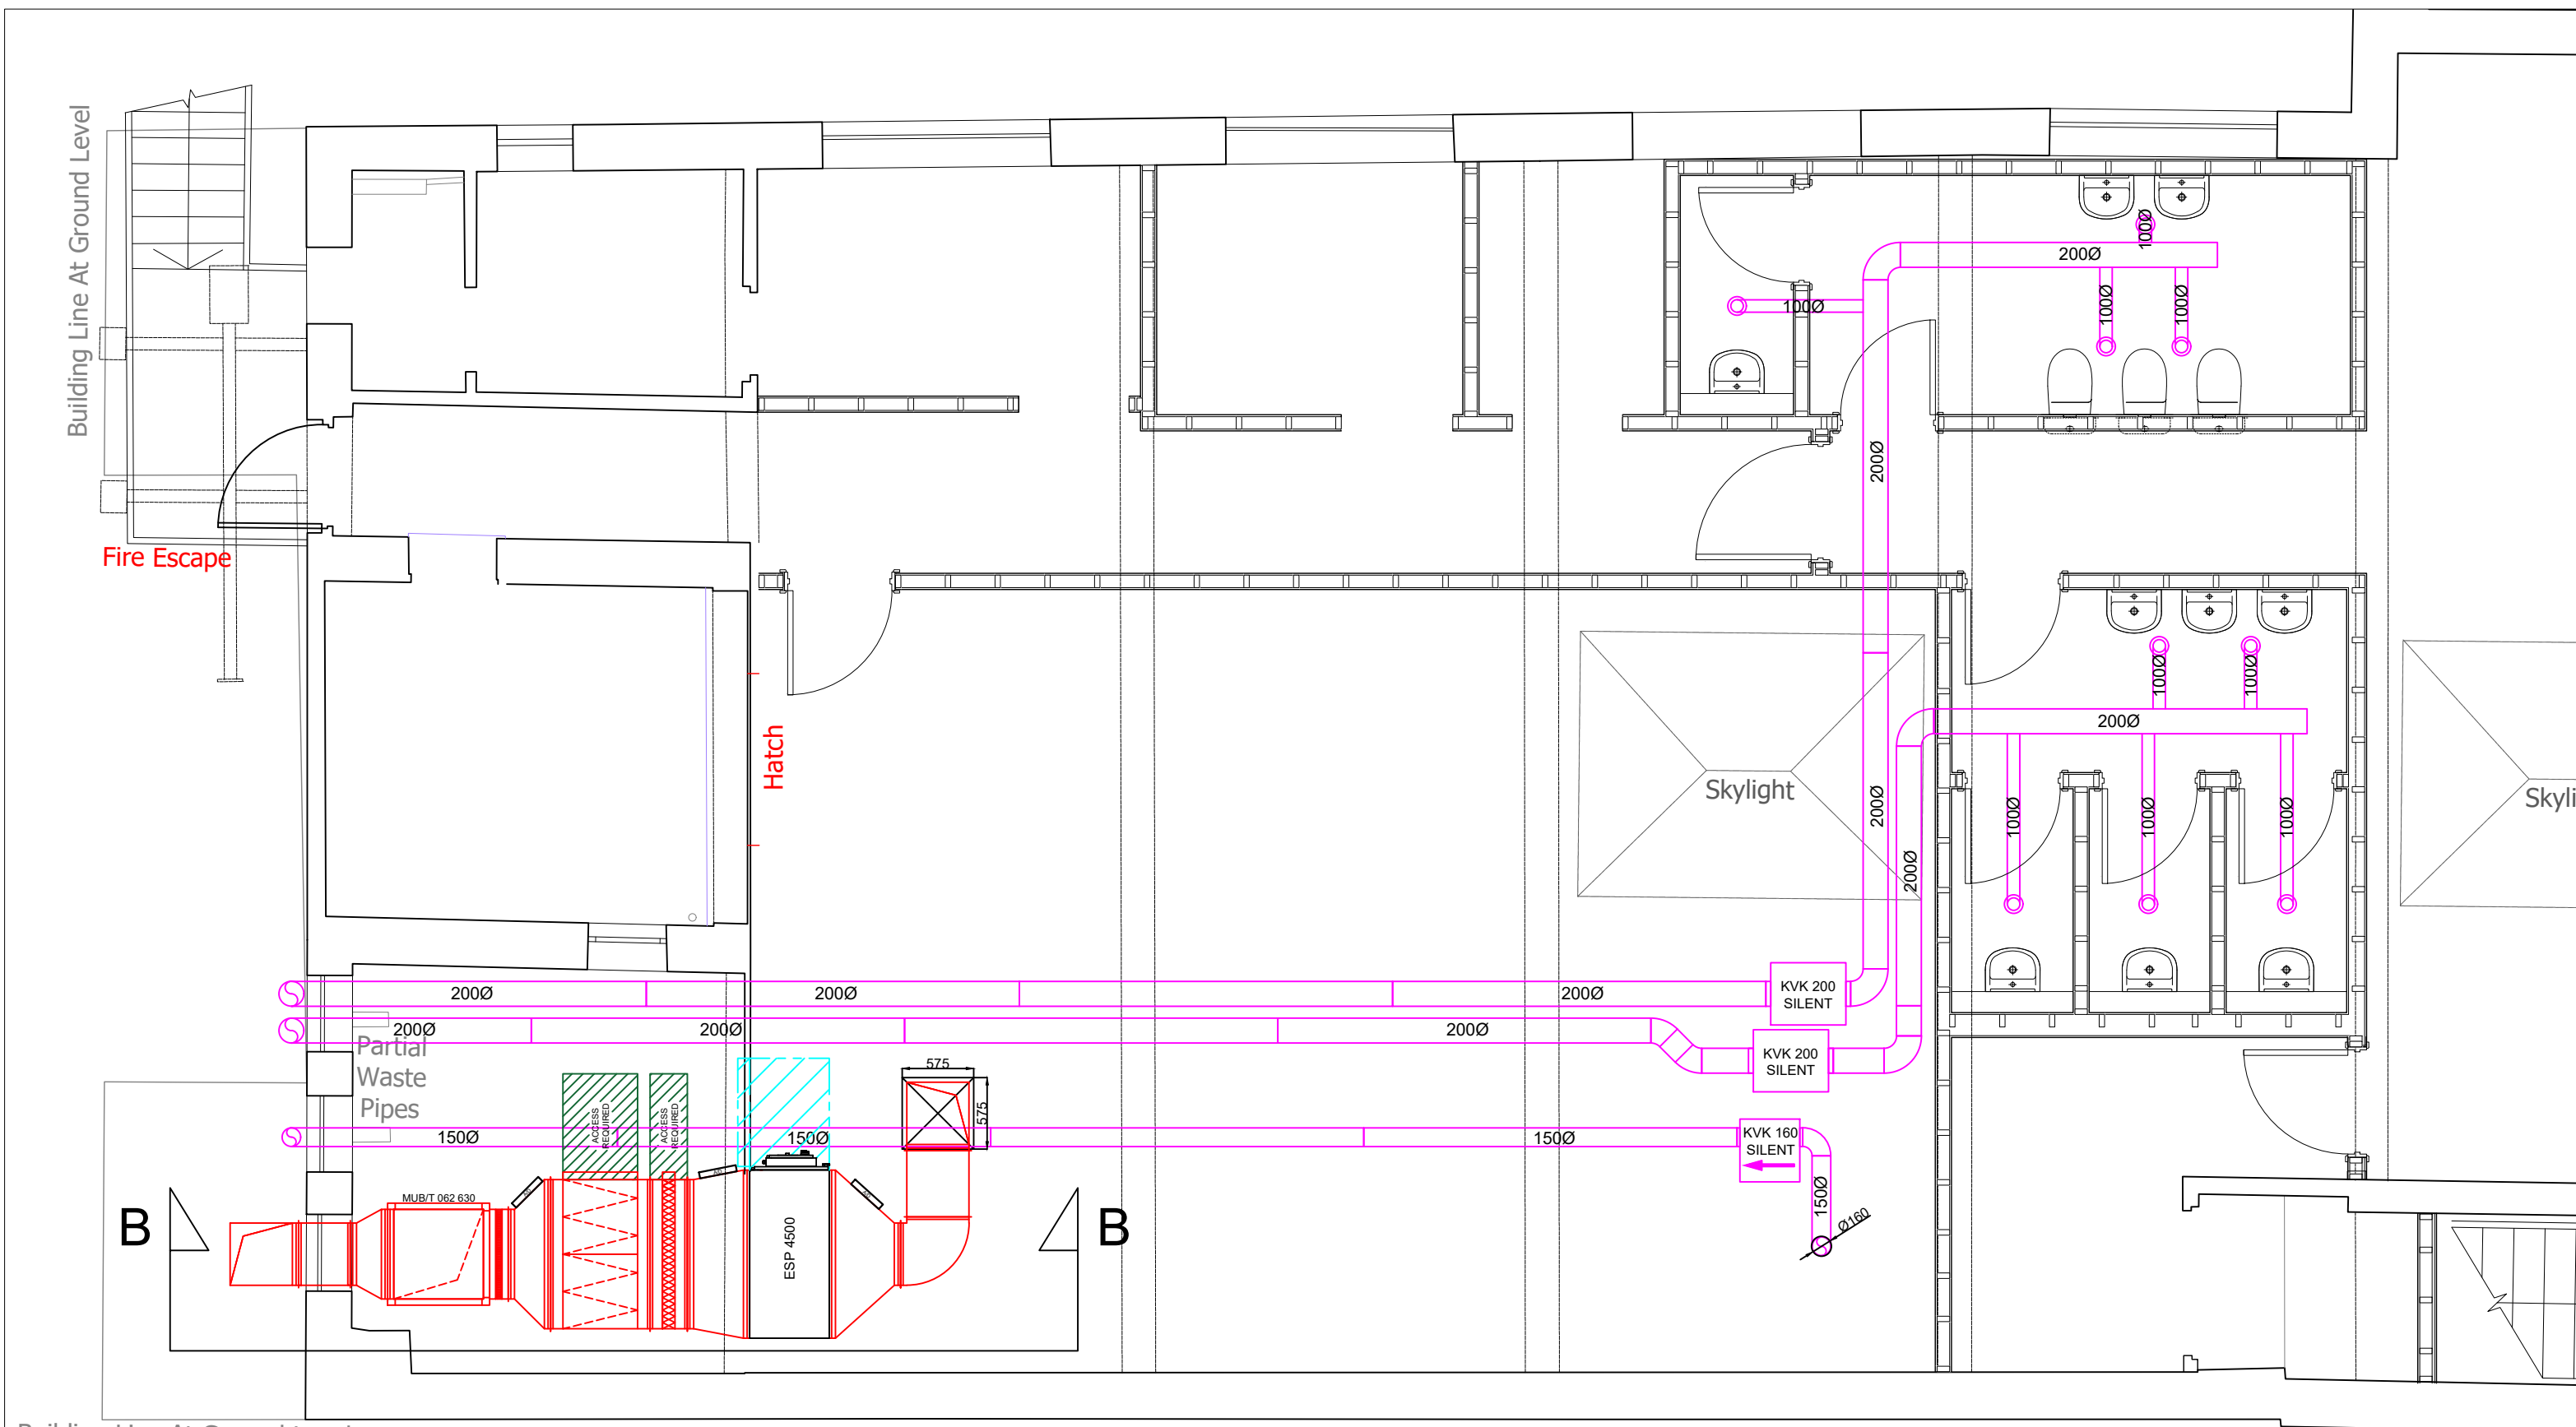

PLAN - GF

Scale 1:100

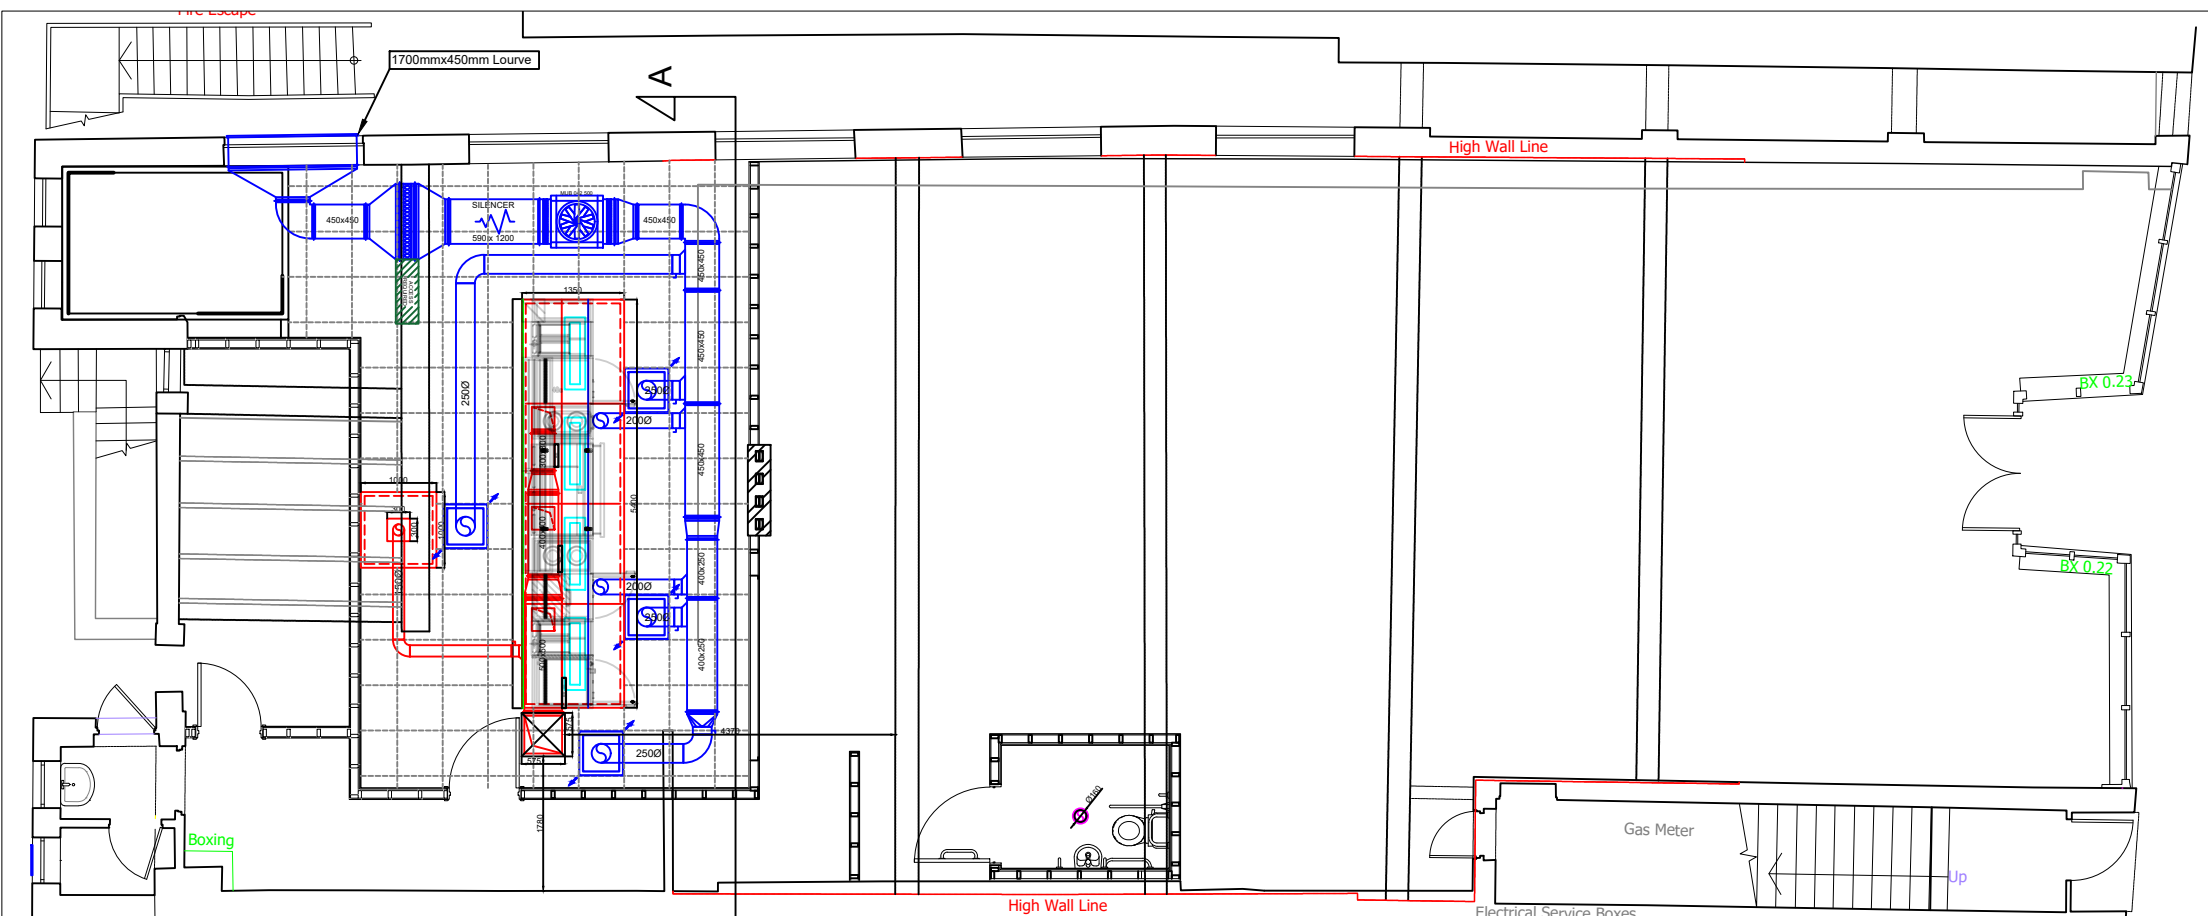

DO NOT SCALE FROM THIS DRAWING!
All measurements in mm with a tolerance +/- 1mm
All power & services installation by client/M&E Contractor
Cabling grid for illustration purposes only. To be filled by others.
Drawing to be printed in colour
ALL FIRE RATED DUCT MANUFACTURED TO BS479-24 RATED TO 120 MINUTES

Approximate canopy weight:	285kg
Approximate condensate weight:	40kg
Drawing to be used in conjunction with:	
Architect:	RPCA LNS061.02
Kitchen:	Tailormade (New Lounge) Proposed REV-1
Landlord:	-

Odour Control Checklist	
Pre-Filter:	600x600x1200
Carbon:	600x600x1200
Bag Filter:	-
HEPA:	-
ESP:	ESP 4500
UV Ozone:	-

Extract	VCD	Pre-filter	Double deflection grille	Canopy LED light
Extract fire rated	Carbon	Toilet Valve	Eggcrate grille	Flex
Supply	Cladding	Fire damper	Pump house anti vibration foot	Access door
Toilet extract	Bracketry	Fire & smoke damper		

Extract Fan Information:
Fan Model: MUB/T 062 630
Input Current: 8.08A 3ph
Airflow: 1.55m³/s @95SPa
Sound Level: 58dB at 3m sabine
Weight: 112.5kg
Controller: FC102-5.5kW

Supply Fan Information:
Fan Model: MUB 042 500
Input Current: 2.07A 3ph
Airflow: 1.32m³/s @500Pa
Sound Level: 52dB at 3m sabine
Weight: 53kg
Controller: FC102-2.2kW

Ancillary Fan Information:
Fan Model: KVK 200 SILENT
Input Current: 0.21A 1ph
Airflow: -
Sound Level: 33dB at 3m sabine
Weight: 13.5kg
Controller: -

Ancillary Fan Information:
Fan Model: KVK 160 SILENT
Input Current: 0.4A 1ph
Airflow: -
Sound Level: 37dB at 3m sabine
Weight: 17.2kg
Controller: -

Project:	Eastleigh Lounge
Client:	Loungers
Drawing No:	-01
Drawn By:	LW
Drawing view:	PLAN & SECTION
Status:	FOR APPROVAL
Site Address:	7-9, Market Street, Eastleigh, Hampshire SO50 5RH
Date:	15/09/2026
Revision:	-
Paper Size:	A1