


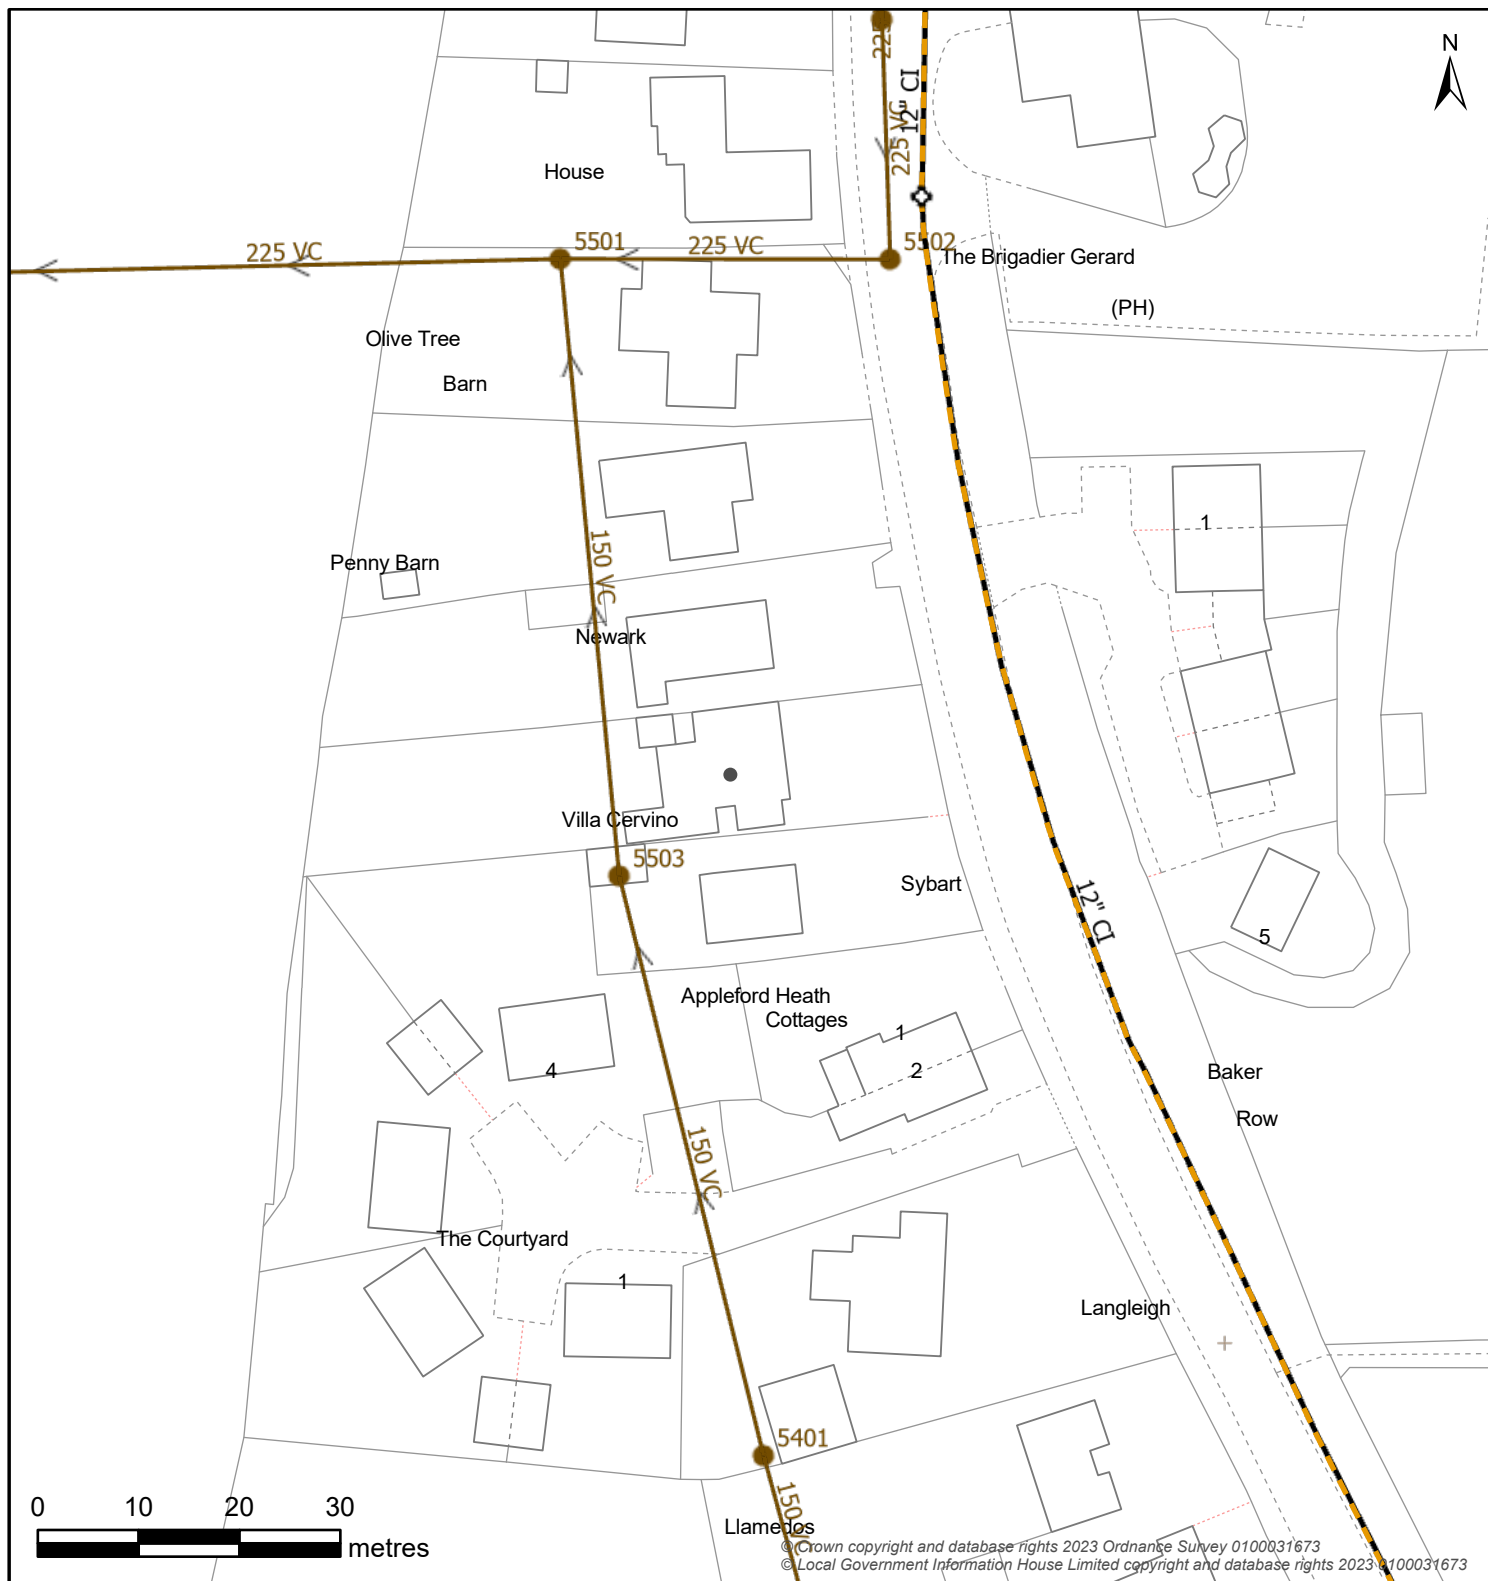

Boundary Box		Break Pressure Tank		Capped End		Hydrant		
Boundary Box	BPT Break Pressure Tank	Capped End	Emptying Plug	Fire Hydrant	Washout Hydrant			
Pressure Monitoring		Service Reservoir		Meter		Valve - Controllable		
Logger	Covered	Tower	Meter	Open Valve	Closed Valve	Stop Tap		
Site				Valve - Flow				
Abstraction Point	Supply Works	Air Valve	Non-Return Valve	Washout Empty Valve				
Booster Station	Transfer Station	Valve - Pressure			Pipe Bridge			
Surface Reservoir	Underground Source	Pressure Reducing Valve	Pressure Sustaining Valve	Pipe Bridge				
Water Pipe				Water Area				
Communication	Trunk	Decommissioned	Water Supply Zone	District Meter Area				
Distribution	Raw	Discolouration						
Non-Potable	Private							

Map Title: SW Print

Printed By: Sachin.Lamani

Date Printed: 24/01/2024

Map Scale: 750

The positions of pipes on this plan are believed to be correct, but Southern Water Services Ltd accept no responsibility in the event of inaccuracy. The actual positions should be determined on-site

