
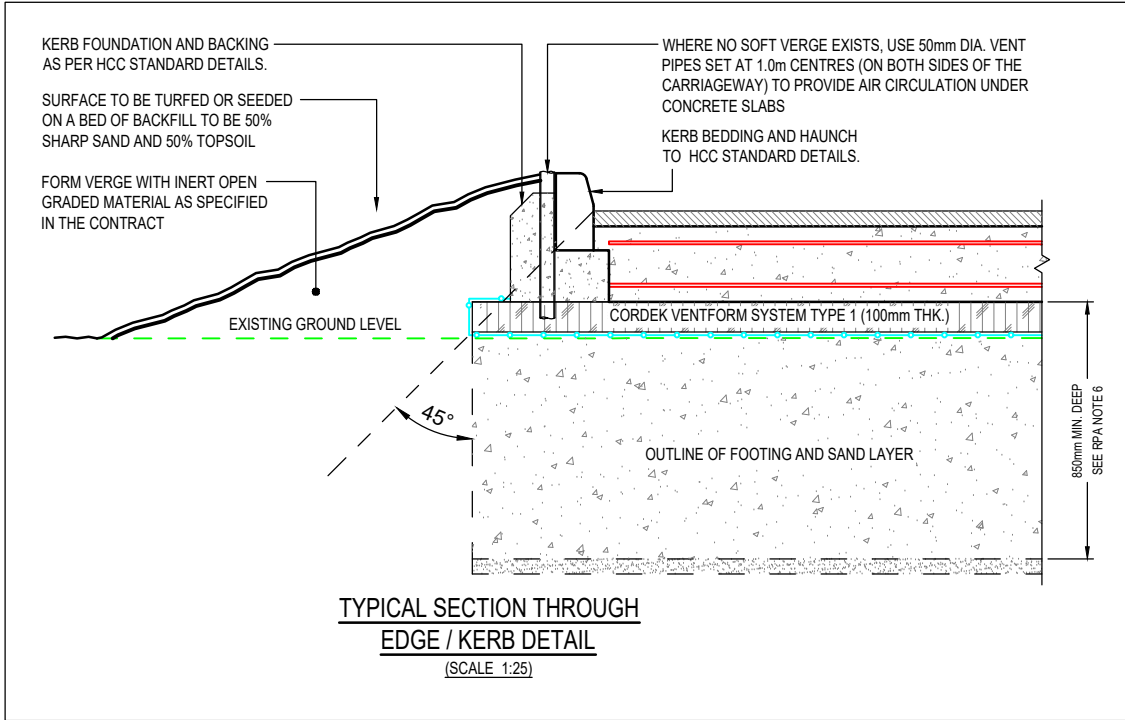


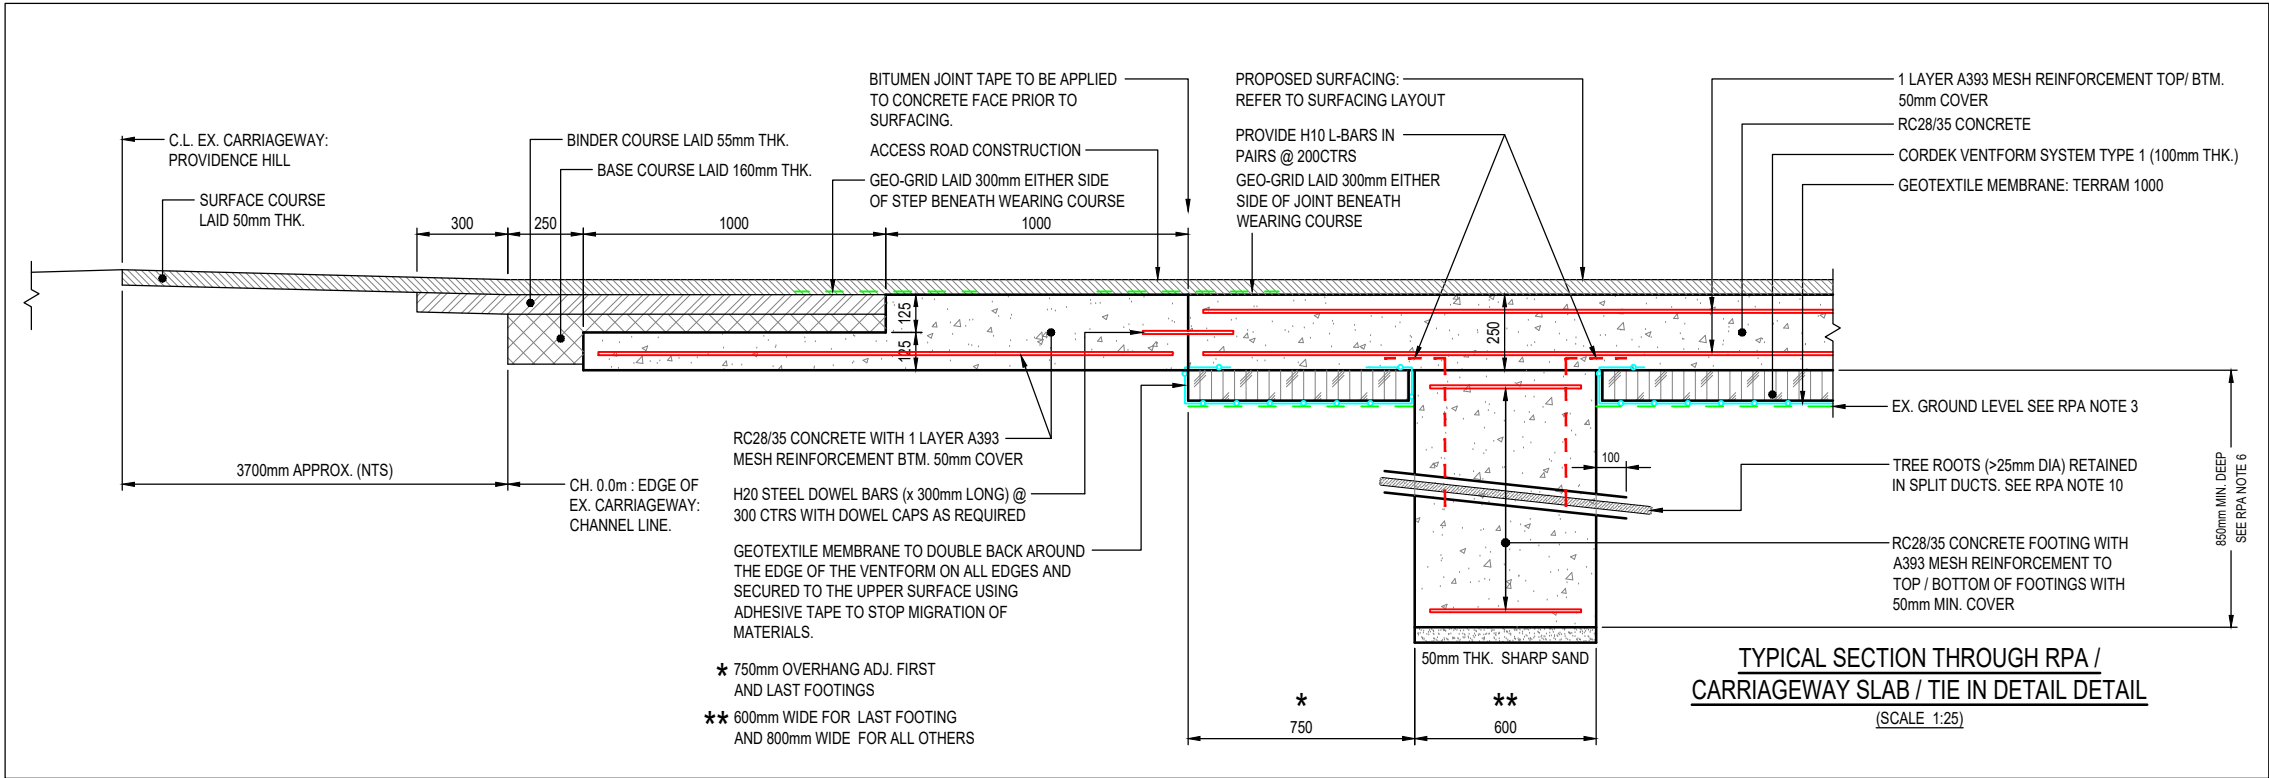

RPA CARRIAGEWAY NOTES

- WHERE APPROPRIATE, GROUND VEGETATION ALONG LINE OF PROPOSED ROAD TO BE TREATED WITH A TRANSLOCATED HERBICIDE (GLYPHOSATE) AS ADVISED BY HIGHWAYS ARBORICULTURALIST.
- ALL EARTHWORKS WITHIN THE ROOT PROTECTION AREA OF RETAINED TREES TO BE HAND EXCAVATED IN ACCORDANCE WITH BS 5837:2012.
- UNLESS OTHERWISE STATED IN APPENDIX 30/10 GROUND PREPARATION WITHIN THE ROOT PROTECTION AREA OF RETAINED TREES TO BE RESTRICTED TO THE REMOVAL OF THE LOOSE TOPSOIL/HUMUS LAYER ONLY. ANY MAJOR HOLLOWES TO BE FILLED WITH INERT NO-FINES AGGREGATE TO PROVIDE A LEVEL SURFACE.
- FOOTINGS TO BE LAID OUT IN A RADIAL PATTERN AT RIGHT ANGLES TO CARRIAGEWAY CENTRELINE. POSITIONS CAN BE ADJUSTED TO AVOID MAJOR ROOTS.
- EXACT LOCATION OF ALL EXCAVATION TO BE AGREED ON SITE.
- FOOTINGS REQUIRE DEEPENING TO 1150mm WHERE CBR IS <5%.
- FOR SITES WITH A CROSSFALL, FOOTINGS SHALL BE PROFILED TO ACHIEVE THE DESIRED ROAD SURFACE PROFILE
- INDIVIDUAL FOOTINGS TO BE DUG BY HAND IN ONE OPERATION WITH LOOSE SOIL REMOVED TO ENSURE GOOD AND SMOOTH SIDES AND BASE. CONCRETE TO BE POURED INTO FOOTINGS AS SOON AFTER EXCAVATION AS POSSIBLE.
- ALL TREE ROOTS GREATER THAN 25mm IN DIAMETER TO BE RETAINED AND WORKED AROUND.
- RETAINED ROOTS WITHIN THE FOOTINGS TO BE ENCASED IN SPLIT DUCTING OF AN APPROPRIATE DIAMETER TO GIVE 5 TO 20mm CLEARANCE AROUND THE ROOT. DUCTING TO EXTEND A MINIMUM OF 100mm BEYOND THE FOOTING ON EITHER SIDE. DUCTING TO BE TAPED TOGETHER AFTER PLACEMENT.
- ALL CONCRETE TO BE DESIGNATED MIX RC 28/35 WITH CONSISTENCE CLASS S2.
- CONCRETE TO BE COMPACTED USING INTERNAL VIBRATION.
- WHERE SERVICES MUST BE PLACED WITHIN THE ROOT PROTECTION AREA, THEY SHOULD BE POSITIONED TO AVOID FOOTINGS WITH REFERENCE TO NJUG GUIDANCE AND DUCTED TO AVOID FUTURE DISTURBANCES.
- CORDEK VENTFORM SYSTEM TO BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURERS INSTRUCTIONS.

The drawings, information and data recorded in this document ("the information") is the property of Paul Basham Associates. This document and the information are solely for the use of the authorised recipient and this document may not be used, copied or reproduced in whole or part for any purposes other than which it was supplied by Paul Basham Associates. Paul Basham Associates makes no representation, undertakes no duty and accepts no responsibilities to any third party who may use or rely upon this document or the information.

GENERAL NOTES

- THIS DRAWING IS INTENDED TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS, ENGINEERS, SERVICES AND SPECIALIST DRAWINGS, DETAILS AND SPECIFICATIONS.
- ANY VARIATIONS OR DISCREPANCIES BETWEEN THESE DRAWINGS IN TERMS OF DIMENSIONS OR DETAILS SHOULD BE DRAWN TO THE ATTENTION OF THE ARCHITECT AND/OR THE ENGINEER FOR CLARIFICATION.
- ALL FIGURED DIMENSIONS TO BE TAKEN IN PREFERENCE TO SCALED DIMENSIONS. DO NOT SCALE THIS DRAWING.
- PAUL BASHAM ASSOCIATES ACCEPTS NO RESPONSIBILITY FOR THE ACCURACY OF BACKGROUND INFORMATION PRODUCED BY THIRD PARTIES – THIS MUST BE TREATED AS INDICATIVE ONLY.
- THIS DRAWING SHOULD ONLY BE USED FOR CONSTRUCTION IF THE PROJECT PHASE IN THE TITLE FRAME BELOW IS SHOWN AS "CONSTRUCTION". PAUL BASHAM ASSOCIATES TAKE NO RESPONSIBILITY FOR CONSTRUCTION WORKS UNDERTAKEN TO DRAWINGS WHICH ARE NOT MARKED UNDER THIS PHASE.

PRELIMINARY

DRAWING/DESIGN IS STILL 'IN DEVELOPMENT'
YOU ARE ADVISED TO MAKE DUE ALLOWANCE

P01	FIRST ISSUE	10.07.2024	RL	RW
Rev	Description	Date	By	App'd
Date Created	Drawn By	Approved By	Suitability Code	
26.06.2024	RL	RW	-	
PBA Project Number		Scale	(AT A3)	
197.0004		AS SHOWN		
PBA Drawing No:			Revision	
197.5004-0012			P01	

Project Name
CAREHOME, BROOKFIELD
PROVIDENCE HILL, BURSLEDON

Project Phase
PRELIMINARY

Title
SITE ENTRANCE:
RPA CARRIAGEWAY
CONSTRUCTION DETAILS

paulbasham
associates
Paul Basham Associates Ltd
The Bothy, Cams Hall Estate, Fareham, PO16 8UT
01329 711 000
info@paulbashamassociates.com www.paulbashamassociates.com

Client

COLTEN
CARE
'Cherishing You'