

NOISE IMPACT ASSESSMENT

BS 8233:2014

Residential – Impact from Commercial &
Road Noise



NOISE
ASSESSMENTS LTD
YOUR LOCAL ACOUSTIC SPECIALIST

REPORT DETAILS

Report Title	Residential Development – Impact from Commercial & Road Noise
Site Address	12 Derby Road, Eastleigh, SO50 5LY
Project No.	NALPRO260624.01a
Consultant Contact	jonathan@noiseassessments.co.uk

QUALITY ASSURANCE

Issue No.	Status	Issue Date	Comments	Author	Approved
1	Final	04/08/24			
2	Final	10/10/24	Updated based on council comments	J Mape BSc (Hons) PgDip TechIOA IOA Cert. Environ. Noise Noise Consultant	D Warren Director

This report has been prepared by Noise Assessments the trading name of Noise Assessments Limited, with all reasonable skill, care and diligence within the terms of the Contract with the client, incorporating our General Terms and Conditions of Business and taking account of the resources devoted to it by agreement with the client.

We disclaim any responsibility to the client and others in respect of any matters outside the scope of the above.

This report is confidential to the client and we accept no responsibility of whatsoever nature to third parties to whom this report, or any part thereof, is made known. Any such party relies on the report at their own risk.

Noise Assessments Limited – Companies House Registered No. 12207511

Contents

Assessment Summary	1
1. Proposal	3
2. Noise Policy and Guidance	3
3. Subjective Impressions	10
4. Measurement Location	10
5. Measurement Procedure	11
6. Measurement Equipment	11
7. Weather Conditions	12
BS4142:2014 Assessment	12
8. Noise Survey	12
9. Noise level Calculations	12
CRTN: Calculation of Road Traffic Noise Assessment	15
10. Noise Survey at the Front of the Site	15
11. Noise level Calculations	16
12. Summary	19
APPENDIX A - Measurement Details	21
APPENDIX B - Equipment Details	21
APPENDIX C - Calibration Details	21
APPENDIX D - Meteorology Details	21
APPENDIX E – BS8233 Rigorous Design Calculation example and AVO Table	22
APPENDIX F – Traffic Survey Data	24
APPENDIX G Location and Layout	25
APPENDIX H Terminology and Definitions	27

Assessment Summary

Noise Assessments Ltd was commissioned with the development at 12 Derby Road, Eastleigh, SO50 5LY (herein referred to as the site), to assess the impact of a proposed change of use from commercial (Use Class E) into residential (C3) – apartment on the ground floor.

Planning permission is being sort and following consultations, a noise assessment has been requested to demonstrate current noise from the commercial site and external ventilation system flue at the rear of the site and road noise from the front of the site does not impact future residents in the new dwelling. The proposed bedroom windows have no line of sight to the extraction flue or delivery van to the nearby local convenience store (if deliveries to the front do not occur).

The operating times of the fish and chip takeaway are:

Monday 4:30-9pm

Tuesday 11:30am-2pm, 4:30-9pm

Wednesday 11:30am-2pm, 4:30-9pm

Thursday 11:30am-2pm, 4:30-9pm

Friday 11:30am-2pm, 4:30-9pm

Saturday 11:30am-2pm, 4:30-9pm

Sunday 4:30-9pm

Commercial Noise at the Rear of the Site

The potential for noise impact arising from the nearby commercial site, however during the monitoring periods, no specific noise (humming, banging etc) was identified.

Based on the environmental noise in the area, the results demonstrate that, with windows open, internal LAeq and LMax noise levels during the day and night-time within habitable rooms on the ground to second floors at the rear of the development are expected to exceed the recommended target levels and openable windows cannot therefore be relied upon for ventilation for an extended period.

Assuming the use of minimum 26 dB Rw+Ctr rated glazing (6/12/6mm) and 32 dB Dne,w+Ctr trickle ventilation (Trimvent Select Xtra S13), daytime environmental noise would be reduced from 54 dB LAeq,16hr to interior levels of 29 dB LAeq,16hr within habitable rooms. The assumed standard of construction would place the internal levels in habitable rooms below 35 dB, therefore within the desirable category.

Assuming the use of minimum 26 dB Rw+Ctr rated glazing (6/12/6mm) and 32 dB Dne,w+Ctr trickle ventilation (Trimvent Select Xtra S13), night-time environmental noise in bedrooms would be reduced from 45 dB LAeq,8hr to interior levels 19 dB LAeq,8hr with maximum individual noise events reduced from 72.0 dB LAFmax to 38 dB LAFmax, therefore within the desirable category.

No external amenity spaces are proposed for the development.

Road traffic Noise at the Front Façade of the Site

A traffic noise survey was carried out at the site from location M2 for representative periods of the daytime and night/early morning. The traffic noise monitoring was carried out for several 15-minute sample periods.

The results demonstrate that, with windows open, internal LAeq and LMax noise levels during the day and night-time within habitable rooms at the front of the development are expected to exceed the recommended target levels and openable windows cannot therefore be relied upon for ventilation for an extended period.

Internal Noise Levels in Habitable Rooms at the Front Façade of the Site

Assuming the use of minimum 32 dB Rw+Ctr rated glazing (10/12/6mm) and 32 dB Dne,w+Ctr trickle ventilation (Trimvent Select Xtra S13), daytime road noise would be reduced from 57 dB LAeq,16hr to interior levels of 25 dB LAeq,16hr within habitable rooms. The assumed standard of construction would place the internal levels in habitable rooms below 35 dB, therefore within the desirable category.

Assuming the use of minimum 32 dB Rw+Ctr rated glazing (10/12/6mm) and 32 dB Dne,w+Ctr trickle ventilation (Trimvent Select Xtra S13), night-time road noise in bedrooms would be reduced from 57 dB LAeq,8hr to interior levels 25 dB LAeq,8hr with maximum individual noise events reduced from 61dB LAFmax to 29 dB LAFmax, therefore within the desirable category.

No external amenity spaces are proposed for the development.

In Summary

A noise intrusion assessment has demonstrated that, via the adoption of the proposed glazing and ventilation strategy internal noise levels within proposed habitable rooms in the site are consistent with the guide values outlined in BS 8233 and by the WHO. Products with higher acoustic performance specifications may be utilised if desired.

The assessment includes a means of ventilation to provide occupants with the ability to maintain adequate background ventilation rates for heating and cooling without having to rely entirely on openable windows.

1. Proposal

- 1.1 Noise Assessments Ltd was commissioned with the development at 12 Derby Road, Eastleigh, SO50 5LY (herein referred to as the site), to assess the impact of a proposed change of use from commercial (Use Class E) into residential (C3) – apartment on the ground floor.
- 1.2 Planning permission is being sort and following consultations, a noise assessment has been requested to demonstrate current noise from the commercial site and external ventilation system flue at the rear of the site and road noise from the front of the site does not impact future residents in the new dwelling. The proposed bedroom windows have no line of sight to the extraction flue or delivery van to the nearby local convenience store (if deliveries to the front do not occur).
- 1.3 The operating times of the fish and chip takeaway are:

Monday 4:30-9pm
 Tuesday 11:30am-2pm, 4:30-9pm
 Wednesday 11:30am-2pm, 4:30-9pm
 Thursday 11:30am-2pm, 4:30-9pm
 Friday 11:30am-2pm, 4:30-9pm
 Saturday 11:30am-2pm, 4:30-9pm
 Sunday 4:30-9pm

Existing Context

- 1.4 The proposed site is surrounded by a commercial site and residential properties along a main road, with the takeaway flue extraction 9m to the west of the proposed dwellings.

2. Noise Policy and Guidance

Noise Policy Statement for England (NPSE)

- 2.1 The NPSE sets out the Government's policy on noise and includes the long term vision of promoting good health and a good quality of life through the effective management of noise within the context of Government policy on sustainable development.
- 2.2 This long term vision is supported by the following aims:
- 2.3 Through the effective management and control of environmental, neighbour and neighbourhood noise within the context of Government policy on sustainable development:
 - avoid significant adverse impacts on health and quality of life;
 - mitigate and minimise adverse impacts on health and quality of life; and
 - where possible, contribute to the improvement of health and quality of life.

2.4 There are two established concepts from toxicology that are currently being applied to noise impacts, for example, by the World Health Organisation. They are:

- NOEL (No Observed Effect Level) – this is the level below which no effect can be detected. In simple terms, below this level, there is no detectable effect on health and quality of life due to the noise;
- LOAEL (Lowest Observed Adverse Effect Level) – this is the level above which adverse effects on health and quality of life can be detected.

2.5 Extending these concepts further, NPSE leads to the concept of a significant observed adverse effect level:

- SOAEL (Significant Observed Adverse Effect Level) – this is the level above which significant adverse effects on health and quality of life occur.

2.6 NPSE acknowledges that it is not possible to have a single objective noise-based measure that defines NOEL, LOAEL and SOAEL that is applicable to all sources of noise in all situations. It is therefore suggested that more specific advice from other applicable noise standards and guidance could be employed to determine suitable noise level criteria within the overall principles of the NPSE.

National Planning Policy Framework (NPPF)

2.7 The revised NPPF was updated on 5 September 2023 and 19 December 2023 and sets out the government's planning policies for England and how these are expected to be applied. This document replaces the first NPPF published in March 2012 and includes minor clarifications to the revised version published in July 2018, February 2019, July 2021.

2.8 Where issues of noise impact are concerned the NPPF provides brief guidance in Chapter 15 '*Conserving and enhancing the natural environment*' as follows:

Paragraph 170:

Planning policies and decisions should contribute to and enhance the natural and local environment by preventing new and existing development from contributing to, being put at unacceptable risk from, or being adversely affected by, unacceptable levels of soil, air, water or noise pollution or land instability.

Paragraph 180:

Planning policies and decisions should also ensure that new development is appropriate for its location taking into account the likely effects (including cumulative effects) of pollution on health, living conditions and the natural environment, as well as the potential sensitivity of the site or the wider area to impacts that could arise from the development. In doing so they should:

- a) mitigate and reduce to a minimum potential adverse impacts resulting from noise from new development – and avoid noise giving rise to significant adverse impacts on health and the quality of life;
- b) identify and protect tranquil areas which have remained relatively undisturbed by noise and are prized for their recreational and amenity value for this reason; and
- c) limit the impact of light pollution from artificial light on local amenity, intrinsically dark landscapes and nature conservation.

Paragraph 182:

Planning policies and decisions should ensure that new development can be integrated effectively with existing businesses and community facilities (such as places of worship, pubs, music venues and sports clubs). Existing businesses and facilities should not have unreasonable restrictions placed on them as a result of development permitted after they were established. Where the operation of an existing business or community facility could have a significant adverse effect on new development (including changes of use) in its vicinity, the applicant (or 'agent of change') should be required to provide suitable mitigation before the development has been completed.

Planning Practice Guidance (PPG)

- 2.9 PPG is written in support of the NPPF and provides an increased level of specific planning guidance.
- 2.10 It suggests that noise needs to be considered when new developments may create additional noise and when new developments would be sensitive to the prevailing acoustic environment. It is also suggested that noise should not be considered in isolation and separately from issues such as the economic, social and other environmental dimensions of proposed development.
- 2.11 Local planning authorities' plan-making and decision taking should take account of the acoustic environment and in doing so consider:
 - whether or not a significant adverse effect is occurring or likely to occur;
 - whether or not an adverse effect is occurring or likely to occur; and
 - whether or not a good standard of amenity can be achieved.


Technical Guidance

ProPG: Planning and Noise

- 2.12 Professional Practice Guidance on Planning and Noise for new residential development (ProPG) was published May 2017 by the Chartered Institute of Environmental Health (CIEH), the Association of Noise Consultants (ANC) and the Institute of Acoustics (IOA). The guidance has been produced to provide practitioners with guidance on the management of noise within the planning system in England.
- 2.13 The guidance focuses on proposed new residential development and existing transport noise sources and reflects the Government's overarching Noise Policy Statement for England (NPSE, the National Planning Policy Framework (NPPF) and Planning Practice Guidance (including PPGN), as well as other authoritative sources of guidance.
- 2.14 The guidance provides advice for Local Planning Authorities (LPAs) and developers, and their respective professional advisers which complements Government planning and noise policy and guidance and, in particular, aims to:
- Advocate full consideration of the acoustic environment from the earliest possible stage of the development control process;
 - Encourage the process of good acoustic design in and around new residential developments;
 - Outline what should be taken into account in deciding planning applications for new noise-sensitive developments;
 - Improve understanding of how to determine the extent of potential noise impact and effect; and
 - Assist the delivery of sustainable development.
- 2.15 ProPG provides guidance for the producing an initial site noise risk assessment, pre-mitigation, based on the prevailing daytime and night-time noise levels across the site, from which the site (or areas thereof) can be zoned. The Figure below shows the noise risk assessment criteria taken from Figure 1 of the ProPG.
- 2.16 ProPG recommends internal and external sound levels in line with those described in BS 8233 and WHO Guidelines.

BS 8233:2014 Guidance on sound insulation and noise reduction for buildings

- 2.17 This British Standard was published in February 2014 and supersedes BS 8233:1999, which is withdrawn.
- 2.18 This Standard provides guidance for the control of noise in and around buildings and is applicable to the design of new buildings, or refurbished buildings undergoing a change of use, but does not provide guidance on assessing the effects of changes in the external noise levels to occupants of an existing building.

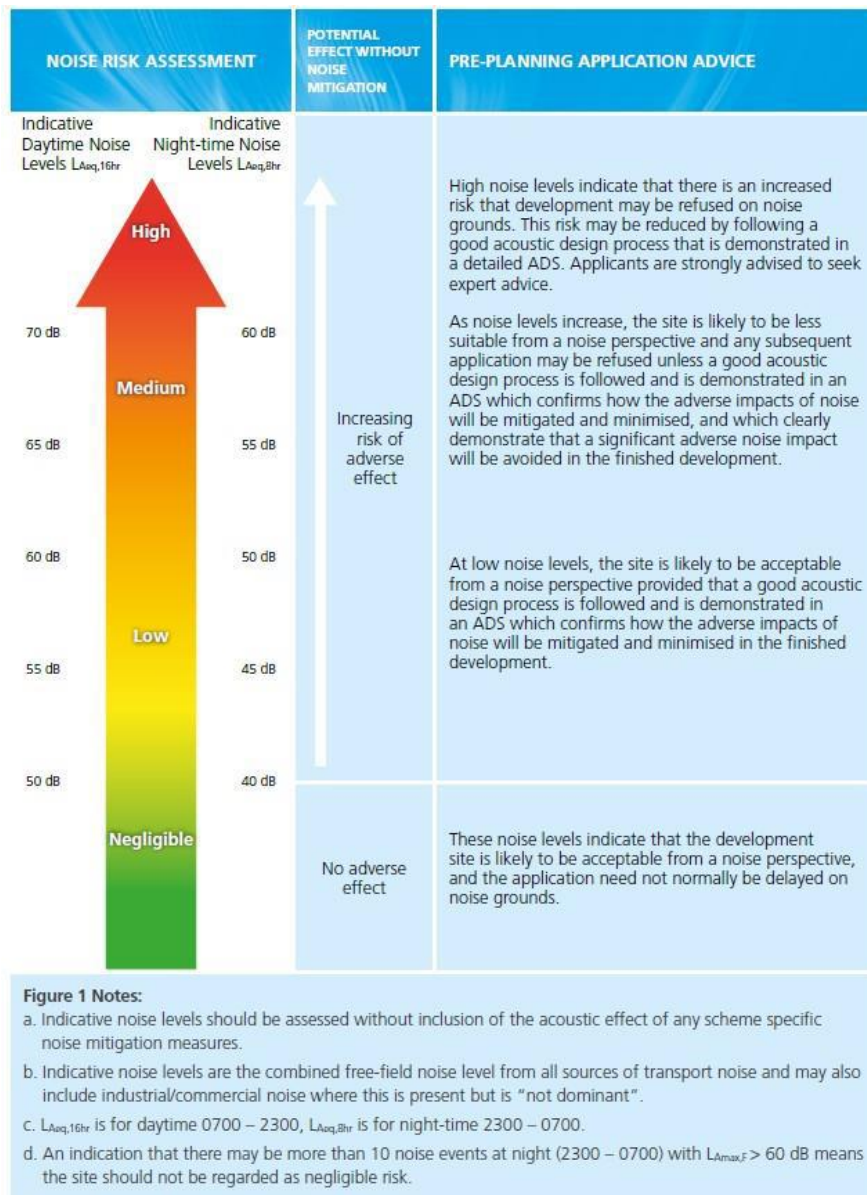

2.19 For dwellings, the main considerations are:

- for bedrooms, the acoustic effect on sleep; and
- for other rooms, the acoustic effect on resting, listening and communicating.

2.20 It is desirable that the internal ambient noise level does not exceed the following guideline values.

Activity	Location	07:00 – 23:00	23:00 – 07:00
Resting	Living room	35 dB $L_{Aeq,16\text{hour}}$	-
Dining	Dining room/area	40 dB $L_{Aeq,16\text{hour}}$	-
Sleeping (daytime resting)	Bedroom	35 dB $L_{Aeq,16\text{hour}}$	30 dB $L_{Aeq,8\text{hour}}$

2.21 For traditional external areas that are used for amenity space, such as gardens, it is desirable that the external noise level does not exceed 50 dB $L_{Aeq,T}$, with an upper guideline value of 55 dB $L_{Aeq,T}$ which would be acceptable in noisier environments.

2.22 However, it is also recognized that these external noise guideline values are not achievable in all circumstances where development might be desirable. In higher noise areas, such as city centres or urban areas adjoining the strategic transport network, a compromise between elevated noise levels and other factors, such as the convenience of living in these locations or making efficient use of land resources to ensure development needs can be met, might be warranted. In such a situation, development should be designed to achieve the lowest practicable levels in these external amenity spaces, but should not be prohibited.

2.23 When determining the sound insulation of a building envelope, the requirements should be determined on the basis of the assessment of:

- the level and characteristics of the noise outside the building
- the design noise levels in the rooms and other spaces of the building

2.24 Initial estimates may be obtained using calculations based on single-figure data, however, for detailed noise intrusion calculations to be undertaken, knowledge or assumptions of the following are required.

- Frequency characteristics of the noise source(s).
- Frequency characteristics of the sound reducing elements.
- Surface area of the common construction separating the two areas.
- Reverberation time of the receiving space.

World Health Organisation (WHO)

2.25 The World Health Organisation 'Guidelines for Community Noise' 1999 aims to provide environmental health authorities and professionals with guidance on the adverse health effects of community noise on people.

2.26 This document presents a summary of research and opinions on the impacts of noise and recommends guideline values for avoidance of particular effects e.g. annoyance and sleep

disturbance. It is the primary reference point for other guidance value based documents, such as BS 8233.

- 2.27 The following guideline values have been derived according to specific environments. The values relevant to residential development are shown in the table below.

Specific Environment	Critical Health Effect(s)	L _{Aeq} (dB)	Time base (hrs)	L _{Amax,f} (dB)
Outdoor living area	Serious annoyance, daytime and evening	55	16	-
	Moderate annoyance, daytime and evening	50	16	-
Dwelling, indoors	Speech intelligibility and moderate annoyance, daytime and evening	35	16	
Inside bedrooms	Sleep disturbance, night-time	30	8	45

- 2.28 The above values are consistent with those recommended within BS 8233, however unlike BS 8233:2014, the WHO guidelines present a specific guide value for L_{Amax} levels affecting bedrooms. The research suggests that sleep disturbance effects have been observed at individual L_{Amax} exposures of 45 dB or less. Consequently, it is important to limit the number of individual noise events with a L_{Amax} exceeding 45 dB.

AVO: Acoustics, Ventilation and Overheating Residential Design Guide

- 2.29 The AVO guide recommends an approach to acoustic assessments for residential development that takes into consideration the interdependence of provisions for acoustics, ventilation and overheating. The application of the AVO Guide is intended to demonstrate good acoustic design in accordance with ProPG. A two-stage assessment approach is advised as:

- Stage 1: Site Risk Assessment
- Stage 2: Detailed Assessment of Adverse Effect

- 2.30 The guide provides a means of assessment to satisfy the need to consider acoustics, ventilation and overheating at the planning stage. It also assists in educating clients, environmental health officers, planning officers and other stakeholders of the interdependence of design for acoustics, ventilation and overheating.

CRTN: Calculation of Road Traffic Noise – 1988

- 2.31 This document was published by the Department for Transport and the Welsh office in 1988. It sets out the procedures used to calculate noise generated by road traffic. The calculation method is based on various input variables such as traffic speed, road surface and the

percentage of heavy's (HGVs) as well as the site geometry and barrier attenuation. The calculation inputs allow for the LA10, 18hour and LA10, 1hour to be calculated at any given receiver.

- 2.32 The document also provides methods for measuring the noise produced by road traffic stating three different methodologies. The first, "The Measurement Method" is used for direct measurement of the LA10, 18hour. The second, "The Shortened Measurement Procedure" for measurement of the LA10, 3hour noise level from which the LA10, 18hour and LAeq, 16hour level can be derived. The third method Comparative Measurements' is a procedure to ascertain noise levels from a single road traffic route at various points, where the road traffic on that route is the dominant source. CRTN states that if the Shortened Measurement Procedure is followed, a correction of -1dB can be applied to approximate the LA10,18hour noise level a further subtraction -2dB gives an approximation of the LAeq,16hour.

BS4142:2014– Method for Rating & Assessing Industrial and Commercial Sound

- 2.33 BS4142:2014 – Methods for rating and assessing industrial and commercial sound' is a recognised standard for assessing the noise impact of fixed plant machinery via relation of noise emissions to current background noise levels.

3. Subjective Impressions

- 3.1 The noise climate in and around the site is dominated by road noise along Derby Road. The site forms part of a mainly residential area with some commercial units. Noise at the rear has been identified as bird song, faint road noise, people chatting and faint flue noise.

4. Measurement Location

- 4.1 Noise monitoring equipment for measuring sound levels was set up to capture daytime and night-time noise on 9th to 10th July 2024. The location of the measurement position is shown in Figure 1.
- 4.2 Noise data was also collected for road noise over 17th and 18th September 2024
- 4.3 The data collected during this period has been used to characterise the existing acoustic environment at the proposed development site.
- 4.4 Measurement and site location are shown in figure 1 below:



Figure 1: Site & Measurement Location

- Measurement location M1
- Measurement location M2
- ▬ Site location

5. Measurement Procedure

- 5.1 Noise levels were measured from the 9th to 10th July 2024 and 17th and 18th September 2024. Full measurement times and durations can be found in **Appendix A**.

6. Measurement Equipment

- 6.1 Measurements were undertaken using a calibrated, Pulsar N45 class 1 sound level meters. Full equipment details can be found in **Appendix B**.
- 6.2 Measurements at the monitoring locations were 'free field' (no vertical reflective surfaces within 3.5 metres of the microphone) and at a height of between 1.2 – 1.5 metres above ground level. During all measurements the microphone was protected with an outdoor windshield.
- 6.3 The calibration level of the meters was checked before and after the survey with a sound calibrator with no variation in the levels observed.

- 6.4 The sound level meter was set to measure various noise parameters including LAeq and LMax values using a 'fast' time weighting.
- 6.5 Full calibration details can be found in **Appendix C**.

7. Weather Conditions

- 7.1 Weather conditions were deemed acceptable for noise measurement. Full meteorological conditions are detailed in **Appendix D**.

BS4142:2014 Assessment

8. Noise Survey

- 8.1 A noise survey was conducted at monitoring location M1 on the 9th to 10th July 2024 to understand the potential noise impact from commercial activity at the rear of the site. For the purposes of the assessment the loudest 16hr day and 8hr night were selected and are tabulated below.

Measurement Summary				
Measurement	Date	Period	LAeq (dB)	LAFmax (dB)
M2	09/07/24	Day (16hr)	52	N/A
	10/07/24	Night (8hr)	45	72

- 8.2 The potential for noise impact arising from the nearby commercial sites, however during the monitoring periods, no specific noise (humming, banging etc) was identified.

9. Noise level Calculations

- 9.1 Noise intrusion levels with windows open have been determined assuming that the insulation provided by a window, partially open for ventilation, is 15 dB as suggested by BS 8233 and WHO.

Parameter	Measured External Free-Field Noise Level at 2nd Floor facade	2nd Floor Internal Noise Level with Windows Open	2nd Floor Internal Noise Level with Windows Closed and Vents Open	ProPG Guidance	BS 8233 Classification
Living Space					
Daytime L _{Aeq,16hr} (dB)	53	38	29	Low Risk of Adverse Effects	Desirable (≤35)
Bedrooms					
Daytime L _{Aeq,16hr} (dB)	53	38	29	Low Risk of Adverse Effects	Desirable (≤35)
Bedrooms					
Night-time L _{Aeq,8hr} (dB)	45	30	19	Low Risk of Adverse Effects	Desirable (≤30)
Night-time L _{Amax(f)} (dB)	72	57	38	Low Risk of Adverse Effects	Desirable (≤45)

- 9.2 The results demonstrate that, with windows open, internal LAeq and LAmax noise levels during the day and night-time within habitable rooms at the rear of the development are expected to exceed the recommended target levels and openable windows cannot therefore be relied upon for ventilation for an extended period.

Internal Noise Levels in Habitable Rooms

- 9.3 Assuming the use of minimum 26 dB Rw+Ctr rated glazing (6/12/6mm) and 32 dB Dne,w+Ctr trickle ventilation (Trimvent Select Xtra S13), daytime environmental noise would be reduced from 54 dB LAeq,16hr to interior levels of 29 dB LAeq,16hr within habitable rooms. The assumed standard of construction would place the internal levels in habitable rooms below 35 dB, therefore within the desirable category.
- 9.4 Assuming the use of minimum 26 dB Rw+Ctr rated glazing (6/12/6mm) and 32 dB Dne,w+Ctr trickle ventilation (Trimvent Select Xtra S13), night-time environmental noise in bedrooms would be reduced from 45 dB LAeq,8hr to interior levels 19 dB LAeq,8hr with maximum individual noise events reduced from 72.0 dB LAFmax to 38 dB LAFmax, therefore within the desirable category.

- 9.5 The potential for adverse impact arising from the nearby commercial sites (humming, banging et), however during the monitoring periods, no specific noise was identified.

AVO – Stage 1 Overheating Risk Assessment

- 9.6 In January 2020 the Acoustics Ventilation and Overheating: Residential Design Guide (AVO) was published by the Association of Noise Consultants. Therefore, the risk of overheating within proposed dwellings can be considered in line with the AVO guide.
- 9.7 In accordance with AVO, the noise levels across the proposed development site as described in the table above have been compared to the Level 1 risk assessment shown in Table 3.2 of AVO, to establish the potential risk of an overheating condition.
- 9.8 The table above indicates that site will be subject to a 'Medium' risk of an overheating condition during the daytime during periods of high volumes of traffic. Therefore, mitigation is considered necessary and discussed below.

Assessment of Daytime Noise Levels in Living Rooms and Bedrooms

- 9.9 The results demonstrate that, with windows open, internal LAeq and LAmx noise levels during the day and night-time within habitable rooms at the front of the development on all floors are expected to exceed the recommended target levels and openable windows cannot therefore be relied upon for ventilation for an extended period.
- 9.10 The assessment suggests that an alternative means of ventilation is required to provide occupants with the ability to maintain adequate background ventilation rates without having to rely entirely on openable windows. Care should be taken not to confuse a reliance on closed windows to achieve the noise level criteria with the need to have sealed glazing units. Windows may remain openable for rapid or purge ventilation, or at the occupant's choice.
- 9.11 In situations where there is a reliance on closed windows to meet the guide value, there needs to be an appropriate alternative means of ventilation that does not compromise the façade insulation or the resulting internal noise level. Typically trickle ventilators can be used and sound attenuating types are available.
- 9.12 The following is a list of manufacturers and suppliers of acoustic ventilation products.

Rytons

<http://rts.vents.co.uk/blog/products/background-ventilators/>

Titon

<https://www.titon.com/uk/products/ventilation-systems/window-vents/>

R.W.Simon Ltd

<https://www.rwsimon.co.uk/products/window-ventilation/>

Greenwood

<https://www.greenwood.co.uk/window-vents>

Noise Levels in External Amenity Areas

9.13 No external amenity spaces are proposed for the development.

CRTN: Calculation of Road Traffic Noise Assessment

10. Noise Survey at the Front of the Site

- 10.1 A noise survey at monitoring location M2 was conducted on the 17th to 18th September 2024.
- 10.2 The traffic noise survey was carried out at the site from location M2 for representative periods of the daytime and night/early morning. The traffic noise monitoring was carried out for several 15-minute sample periods.
- 10.3 The measured daytime noise levels have been evaluated in accordance with the 'shortened measurement method' described in the Department of Transport document 'Calculation of Road Traffic Noise' (CRTN), 1988.
- 10.4 The CRTN shortened measurement method involves taking traffic noise measurements (LA10) over representative sample periods within any three consecutive hours. By using the LA10 (3 hour), as the arithmetic mean of the measured LA10 values, the LA10 (18 hour) value can then be calculated. The LA10 (18 hour) values have then been converted into the equivalent LAeq (16 hour) values using the -2 dB correction that is described in BS 8233:2014.
- 10.5 The measured night/early morning period LAeq values have been logarithmically averaged to obtain the LAeq (3 hour) night-time value which has been taken as representative of the LAeq(8 hour) night-time value.
- 10.6 The daytime and night-time road traffic noise exposure levels are shown below (see **Appendix E**).

Location	Daytime dB LAeq (07:00 – 23:00 hrs)	Night time dB LAeq (23:00 – 07:00 hrs)
Development property façade M2	57	57

10.7 Peaks of noise from passing vehicles at night was 60 – 61 dB LAmax at Location M1.

Noise Levels in External Amenity Areas

10.8 No external amenity areas are provided with this development.

11. Noise level Calculations

11.1 Noise intrusion levels with windows have been determined assuming that the insulation provided by a window open.

Parameter	Measured External Free-Field Noise Level at facade	Internal Noise Level with Windows Open for Ventilation	Internal Noise Level with Windows Closed and Vents Open	ProPG Guidance	BS 8233 Classification
<i>Living Space</i>					
Daytime L _{Aeq,16hr} (dB)	57	42	25	Low Risk of Adverse Effects	Desirable (≤35)
<i>Bedrooms</i>					
Daytime L _{Aeq,16hr} (dB)	57	42	25	Low Risk of Adverse Effects	Desirable (≤35)
<i>Bedrooms</i>					
Night-time L _{Aeq,8hr} (dB)	57	42	25	Low Risk of Adverse Effects	Desirable (≤30)
Night-time L _{Amax(f)} (dB)	61	46	29	Low Risk of Adverse Effects	Desirable (≤45)

AVO – Stage 1 Overheating Risk Assessment

11.2 In January 2020 the Acoustics Ventilation and Overheating: Residential Design Guide (AVO) was published by the Association of Noise Consultants. Therefore, the risk of overheating within proposed dwellings can be considered in line with the AVO guide.

11.3 In accordance with AVO, the noise levels across the proposed development site as described in the table above have been compared to the Level 1 risk assessment shown in Table 3.2 of AVO, to establish the potential risk of an overheating condition.

- 11.4 The table above indicates that site will be subject to a 'Medium' risk of an overheating condition during the daytime during periods of high volumes of traffic. Therefore, mitigation is considered necessary and discussed below.

Assessment of Daytime Noise Levels in Living Rooms and Bedrooms

- 11.5 The results demonstrate that, with windows open, internal LAeq and LMax noise levels during the day and night-time within habitable rooms at the front of the development are expected to exceed the recommended target levels and openable windows cannot therefore be relied upon for ventilation for an extended period.
- 11.6 The assessment suggests that an alternative means of ventilation is required to provide occupants with the ability to maintain adequate background ventilation rates without having to rely entirely on openable windows. Care should be taken not to confuse a reliance on closed windows to achieve the noise level criteria with the need to have sealed glazing units. Windows may remain openable for rapid or purge ventilation, or at the occupant's choice.
- 11.7 In situations where there is a reliance on closed windows to meet the guide value, there needs to be an appropriate alternative means of ventilation that does not compromise the façade insulation or the resulting internal noise level. Typically trickle ventilators can be used and sound attenuating types are available.
- 11.8 The following is a list of manufacturers and suppliers of ventilation products.

Rytens

<http://rts.vents.co.uk/blog/products/background-ventilators/>

Titon

<https://www.titon.com/uk/products/ventilation-systems/window-vents/>

R.W.Simon Ltd

<https://www.rwsimon.co.uk/products/window-ventilation/>

Greenwood

<https://www.greenwood.co.uk/window-vents>

Internal Noise Levels in Habitable Rooms at the Front Façade of the Site

- 11.9 Assuming the use of minimum 32 dB Rw+Ctr rated glazing (10/12/6mm) and 32 dB Dne,w+Ctr trickle ventilation (Trimvent Select Xtra S13), daytime road noise would be reduced from 57 dB LAeq,16hr to interior levels of 25 dB LAeq,16hr within habitable rooms. The assumed standard of construction would place the internal levels in habitable rooms below 35 dB, therefore within the desirable category.
- 11.10 Assuming the use of minimum 32 dB Rw+Ctr rated glazing (10/12/6mm) and 32 dB Dne,w+Ctr trickle ventilation (Trimvent Select Xtra S13), night-time road noise in bedrooms would be

reduced from 57 dB LAeq,8hr to interior levels 25 dB LAeq,8hr with maximum individual noise events reduced from 61dB LAFmax to 29 dB LAFmax, therefore within the desirable category.

11.11 For reducing the likelihood of overheating in the summer months the details of the window vents for the bedrooms/lounge volumetric calculations showing that the size of the vents will be sufficient for 4ACH is show below:

11.12 Habitable rooms to have 2500mm² of ventilation.

11.13 1x Titon SF Xtra Sound Attenuator TA5225 (V75) + TA5005 (SF 418) 2500EA, Dn,e,w (C;Ctr) = 41 (-1;-2)dB

12. Summary

- 12.1 Noise Assessments Ltd was commissioned with the development at 12 Derby Road, Eastleigh, SO50 5LY (herein referred to as the site), to assess the impact of a proposed change of use from commercial (Use Class E) into residential (C3) – apartment on the ground floor.
- 12.2 Planning permission is being sort and following consultations, a noise assessment has been requested to demonstrate current noise from the commercial site and external ventilation system flue at the rear of the site and road noise from the front of the site does not impact future residents in the new dwelling. The proposed bedroom windows have no line of sight to the extraction flue or delivery van to the nearby local convenience store (if deliveries to the front do not occur).
- 12.3 The operating times of the fish and chip takeaway are:

Monday 4:30-9pm
 Tuesday 11:30am-2pm, 4:30-9pm
 Wednesday 11:30am-2pm, 4:30-9pm
 Thursday 11:30am-2pm, 4:30-9pm
 Friday 11:30am-2pm, 4:30-9pm
 Saturday 11:30am-2pm, 4:30-9pm
 Sunday 4:30-9pm

Commercial Noise at the Rear of the Site

- 12.4 The potential for noise impact arising from the nearby commercial site, however during the monitoring periods, no specific noise (humming, banging etc) was identified.
- 12.5 Based on the environmental noise in the area, the results demonstrate that, with windows open, internal LAeq and LMax noise levels during the day and night-time within habitable rooms on the ground to second floors at the rear of the development are expected to exceed the recommended target levels and openable windows cannot therefore be relied upon for ventilation for an extended period.
- 12.6 Assuming the use of minimum 26 dB Rw+Ctr rated glazing (6/12/6mm) and 32 dB Dne,w+Ctr trickle ventilation (Trimvent Select Xtra S13), daytime environmental noise would be reduced from 54 dB LAeq,16hr to interior levels of 29 dB LAeq,16hr within habitable rooms. The assumed standard of construction would place the internal levels in habitable rooms below 35 dB, therefore within the desirable category.
- 12.7 Assuming the use of minimum 26 dB Rw+Ctr rated glazing (6/12/6mm) and 32 dB Dne,w+Ctr trickle ventilation (Trimvent Select Xtra S13), night-time environmental noise in bedrooms would be reduced from 45 dB LAeq,8hr to interior levels 19 dB LAeq,8hr with maximum individual noise events reduced from 72.0 dB LAFmax to 38 dB LAFmax, therefore within the desirable category.

- 12.8 No external amenity spaces are proposed for the development.

Road traffic Noise at the Front Façade of the Site

- 12.9 A traffic noise survey was carried out at the site from location M2 for representative periods of the daytime and night/early morning. The traffic noise monitoring was carried out for several 15-minute sample periods.
- 12.10 The results demonstrate that, with windows open, internal LAeq and LMax noise levels during the day and night-time within habitable rooms at the front of the development are expected to exceed the recommended target levels and openable windows cannot therefore be relied upon for ventilation for an extended period.

Internal Noise Levels in Habitable Rooms at the West Façade of the Site

- 12.11 Assuming the use of minimum 32 dB Rw+Ctr rated glazing (10/12/6mm) and 32 dB Dne,w+Ctr trickle ventilation (Trimvent Select Xtra S13), daytime road noise would be reduced from 57 dB LAeq,16hr to interior levels of 25 dB LAeq,16hr within habitable rooms. The assumed standard of construction would place the internal levels in habitable rooms below 35 dB, therefore within the desirable category.
- 12.12 Assuming the use of minimum 32 dB Rw+Ctr rated glazing (10/12/6mm) and 32 dB Dne,w+Ctr trickle ventilation (Trimvent Select Xtra S13), night-time road noise in bedrooms would be reduced from 57 dB LAeq,8hr to interior levels 25 dB LAeq,8hr with maximum individual noise events reduced from 61dB LAFmax to 29 dB LAFmax, therefore within the desirable category.
- 12.13 No external amenity spaces are proposed for the development.

Appendices

APPENDIX A - Measurement Details

Measurement	Start Date	Start Time	End Date	End Time
M1	09/07/24	10:30	10/07/24	14:30

APPENDIX B - Equipment Details

Equipment	Make	Model	Class	Serial Number
Sound Meter	Pulsar	N45	1	1365
Calibrator	Pulsar	PM1	1	011121C

APPENDIX C - Calibration Details

Measurement	Calibrator Ref Level (dB)	Level Before (dB)	Deviation Before (dB)	Level After (dB)	Deviation After (dB)
M1/M2	94.0	94.0	0	94.0	0

APPENDIX D - Meteorology Details

Date	Temp C	Wind Speed m/s*	Wind Direction	Humidity %	Precipitation mm	Cloud Cover (Oktas)
09/07/24	21	2.3	SW	78	0.1	2/8
17/09/24	18	1.8	S	82	0.0	4/8


APPENDIX E – BS8233 Rigorous Design Calculation example and AVO Table

BS8233:2014 Specification Calculation Summary

Bedroom - night time

Room Properties		Sound Insulation Properties					
Room Width (m)	3.0	Freq. Hz	125	250	500	1k	2k
Room Depth (m)	4.0	Wall, dB R_{w+Ctr}	41	45	45	54	58
Room Height (m)	2.4	Roof, dB R_{w+Ctr}	41	45	45	54	58
Glazed Area (m ²)	1.8	Glazing, dB R_{w+Ctr}	26	27	34	40	38
Is dwelling within roof?	☒	Vents, dB $D_{f,R,w+Ctr}$	34	38	43	42	34

Noise Levels, dB

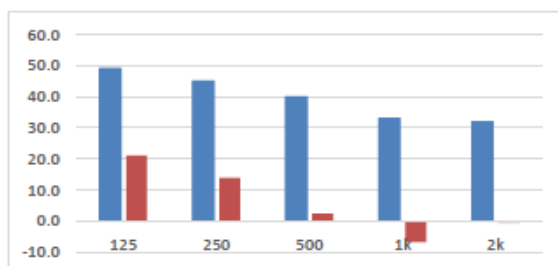

External Level 42 dB LAeq

Internal Level 9 dB LAeq

Insertion Loss 33 dB LAeq

Sound Insulation Requirement

Minimum Sound Insulation Requirement			Suitable Systems
Glazing	32	dB R_{w+Ctr}	Double Glazing <i>10/12/6mm</i>
Ventilation	40	dB $D_{f,R,w+Ctr}$	Acoustically treated trickle vent <i>Titan Xtra Sound Attenuator V75+C50</i>

Technical Calculations

Frequency, Hz	125	250	500	1k	2k
Term 1	0.000553	0.00022	7E-05	8.8E-05	0.00055
Term 2	0.000628	0.0005	1E-04	2.5E-05	4E-05
Term 3	5.96E-05	2.4E-05	2.4E-05	3E-06	1.2E-06
Term 4	0	0	0	0	0
Internal, dB L_{eq}	21.1	13.8	2.4	-6.8	-0.5
Internal, dB LAeq	5.0	5.2	-0.8	-6.8	0.7

Façade Components


Roof	Not Within Roof Space
Glazing	Double Glazing
Vents	Acoustically treated trickle vent

Calculations conducted in accordance with BS8233:2014 rigorous calculation method

$$L_{eq} = 10 \log_{10} \left(\sum_{i=1}^n \left(A_i \cdot 10^{\frac{-D_{i,eq}}{10}} + S_{i,eq} \cdot 10^{\frac{-R_{i,eq}}{10}} + S_{i,eq} \cdot 10^{\frac{-R_{i,eq}}{10}} + S_{i,eq} \cdot 10^{\frac{-R_{i,eq}}{10}} \right) \right) + 10 \log_{10} (S)$$

Suitable systems gives as reference only. Other products that achieve the required sound insulation values are available.

Table 3-2 Guidance for Level 1 site risk assessment of noise from transport noise sources ^[Note 1] relating to overheating condition

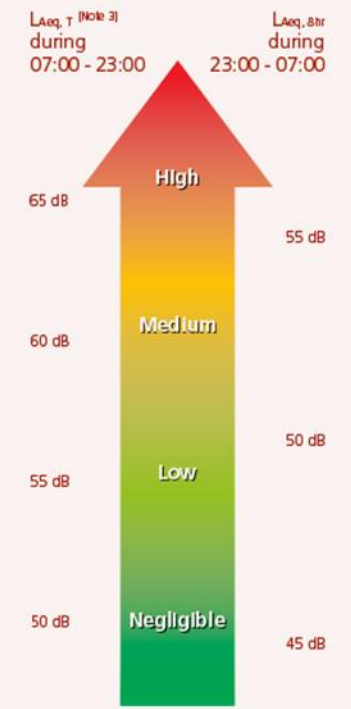Risk category for Level 1 assessment ^[Note 5]	Potential Effect without Mitigation	Recommendation for Level 2 assessment
	Increasing risk of adverse effect	Recommended Optional
	Use of opening windows as primary means of mitigating overheating is not likely to result in adverse effect	Not required

Note 1 The noise levels suggested assume a steady road traffic noise source but may be adapted for other types of transport. All levels are external free-field noise levels.

Note 2 The values presented in this table should not be regarded as fixed thresholds and reference can also be made to relevant dose-response relationships, ^[15, 17].

Note 3 A decision must be made regarding the appropriate averaging period to use. The averaging period should reflect the nature of the noise source, the occupancy profile and times at which overheating might be likely to occur. Further guidance can be found within the 2014 IEMA Guidelines ^[23].

Note 4 Refer also to references ^[1, 17, 18, 22] for further guidance regarding individual noise events. Where 78dB LAFmax is normally exceeded during the night-time period (23:00-07:00), a Level 2 assessment is recommended.

Note 5 The risk of an adverse effect occurring will also depend on how frequently and for what duration the overheating condition occurs. Refer to Figure 3-2.

Note 6 To evaluate the risk category for a dwelling, all three aspects of external noise exposure (i.e. daytime, night-time and individual noise events) should be evaluated. The highest risk category for any of the three aspects applies.

APPENDIX F – Traffic Survey Data

M2

Daytime (17/09/24)

Start	End	L _{Amax}	L _{A10}	L _{Aeq}	L _{A90}
15:45	16:45	66.5	59.8	56.1	66.5
16:45	17:45	67.4	60.0	55.2	67.4
17:45	18:45	66.2	58.8	55.4	66.2

LA10 (3 hr) = 60 dB

LA10 (18 hr) = LA10 (3 hr) -1 = 59 dB

LAeq (16 hr) = LA10 (18 hr) -2 = 57 dB

Night/Early Morning (18/09/24)

Start	End	L _{Amax}	L _{A10}	L _{Aeq}
04:00	05:00	61.1	57.7	55.5
05:00	06:00	60.4	59.6	56.7
06:00	07:00	61.2	60.4	57.6

Log Average LAeq = 57 dB LAeq(3 hr)


APPENDIX G Location and Layout

12 Derby Road, Eastleigh, SO50 5LY



© Crown copyright and database rights 2024 OS 100054135. Map area bounded by: 445288,118319 445488,118519. Produced on 02 June 2024 from the OS National Geographic Database. Supplied by UKPlanningMaps.com. Unique plan reference: p4f/uk/1106826/1489677



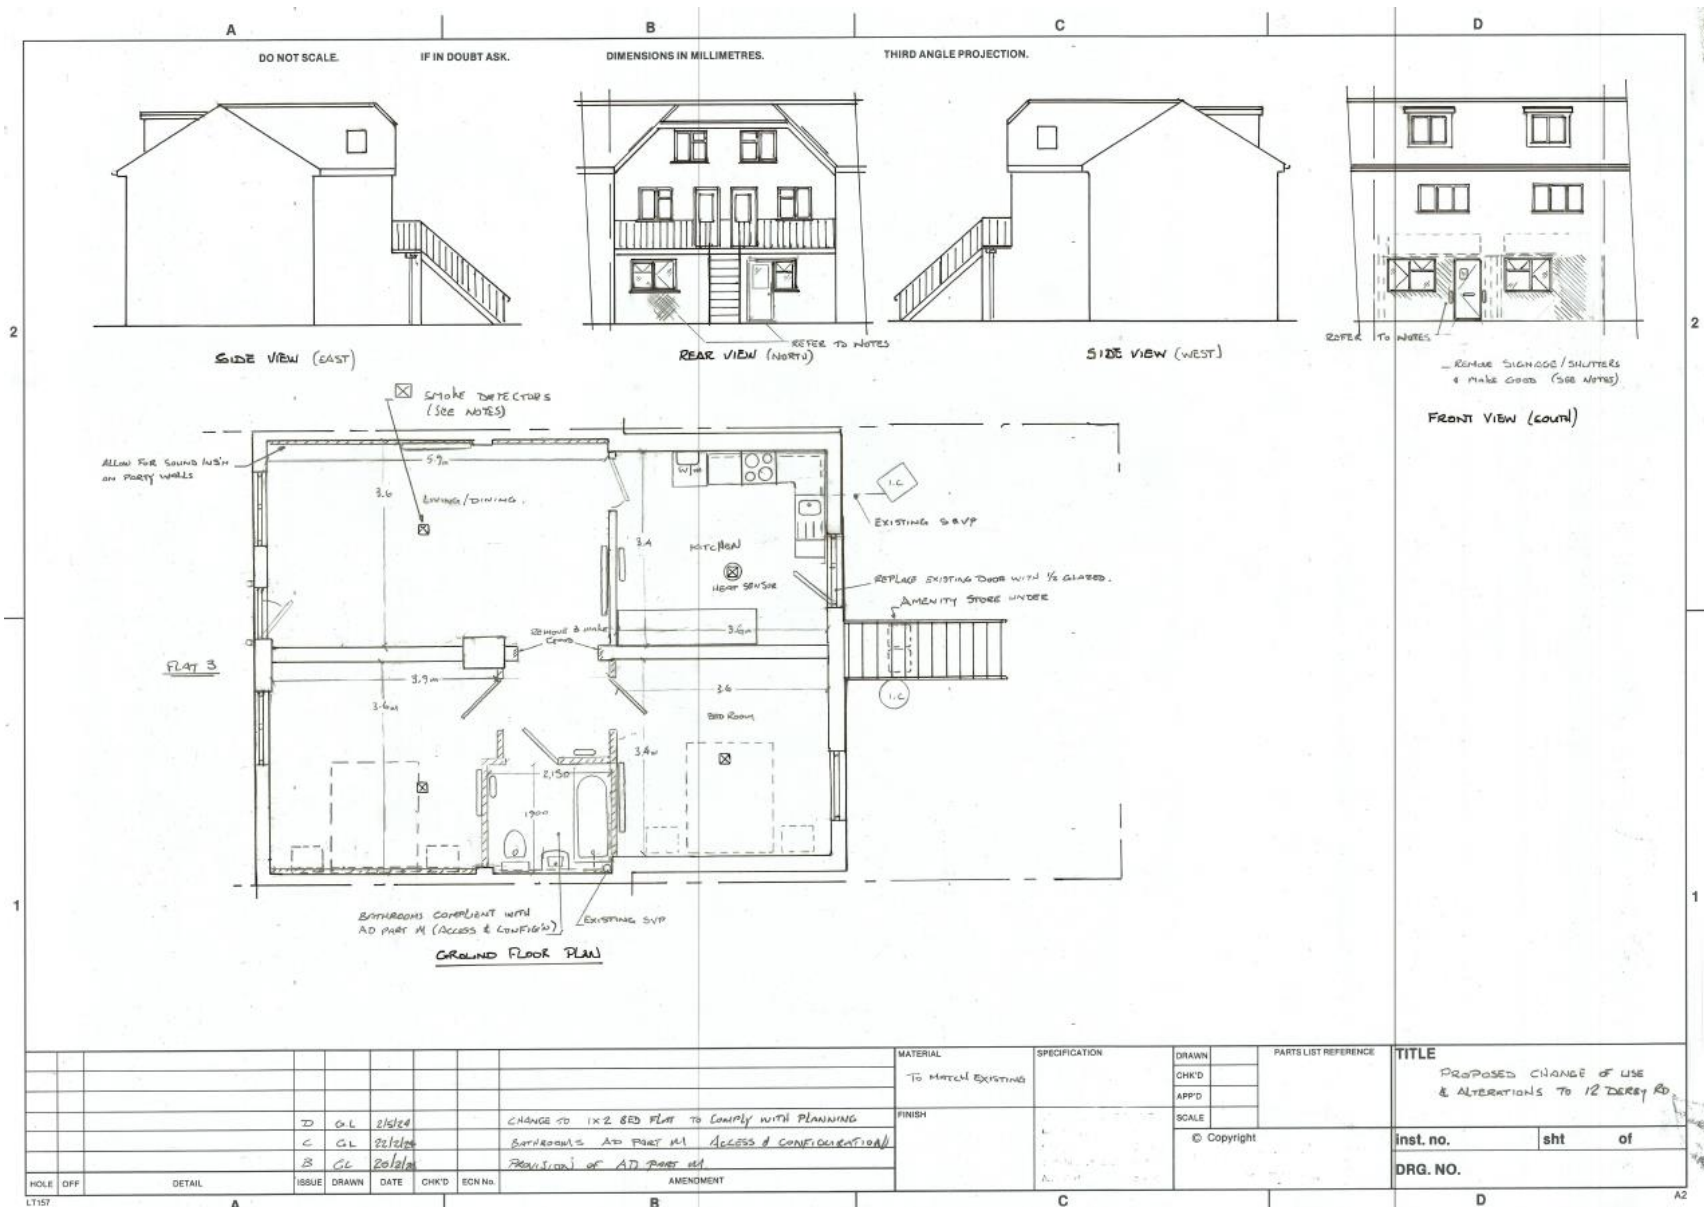

APPENDIX H Terminology and Definitions

Noise

Sound only becomes noise (often defined as 'unwanted sound' or sound that is considered undesirable or disruptive) when it causes or contributes to some harmful or otherwise unwanted effect, like annoyance or sleep disturbance.

Acoustic Environment

Sound from all sound sources as modified by the environment.

Equivalent continuous A-weighted sound pressure level $L_{Aeq,T}$

Value of the A-weighted sound pressure level of a continuous, steady sound that, within a specified time interval T, has the same mean square sound pressure as a sound under consideration whose level varies with time.

A-weighting

The human ear is most sensitive to frequencies in the range 1 kHz to 5 kHz. On each side of this range the sensitivity falls off. A-weighting is used in sound level meters to replicate this sensitivity and respond in the same way as the human ear.

Octave Band

Band of frequencies in which the upper limit of the band is twice the frequency of the lower limit.

Maximum Sound Pressure Level $L_{Amax,T}$

Highest value of the A-weighted sound pressure level with a specified time weighting that occurs during a given event or measuring period.

The $L_{A10,T}$ Sound Level

The A-weighted sound pressure that is exceeded for 10% of a given time interval, T. It is often used to evaluate road traffic noise.

The $L_{A90,T}$ Sound Level

The A-weighted sound pressure that is exceeded for 90% of a given time interval, T, measured using time weighting F. It is often referred to as the background noise level and which might in part be an indication of relative quietness at a given location

Free-field Level

The sound pressure level away from reflecting surfaces.

NOTE Measurements made 1.2 m to 1.5 m above the ground and at least 3.5 m away from other reflecting surfaces are usually regarded as free-field. To minimize the effect of reflections the

measuring position has to be at least 3.5 m to the side of the reflecting surface (i.e. not 3.5 m from the reflecting surface in the direction of the source).

Façade Level

The sound pressure level 1 m in front of the façade.

NOTE Facade level measurements of LpA are typically 1 dB to 2 dB higher than corresponding free-field measurements because of the reflection from the facade.

Indoor Ambient Noise

Noise in a given situation at a given time, usually composed of noise from many sources, inside and outside the building, but excluding noise from activities of the occupants.

ABOUT US

HERE TO HELP

We undertake various noise assessments and noise survey for a wide range of clients to meet their noise requirements and obligations, including for Planning Applications, new developments, building extensions, change of use, small businesses, restaurants, shops and much more.

QUALIFIED AND EXPERIENCED

Over 15 years UK and international acoustic engineering experience of undertaking Noise Monitoring, acoustic solutions, noise survey and Reporting.

Members of the Institute of Acoustics. Undertaken projects in Manchester, North West and across the UK.

GET THE PROJECT DONE

We offer competitive, cost effective acoustic solutions, delivering a noise survey report which complies with Local Planning Authority requirements and sound insulation or health and safety obligations.

We can also undertake Noise Modelling if required.