


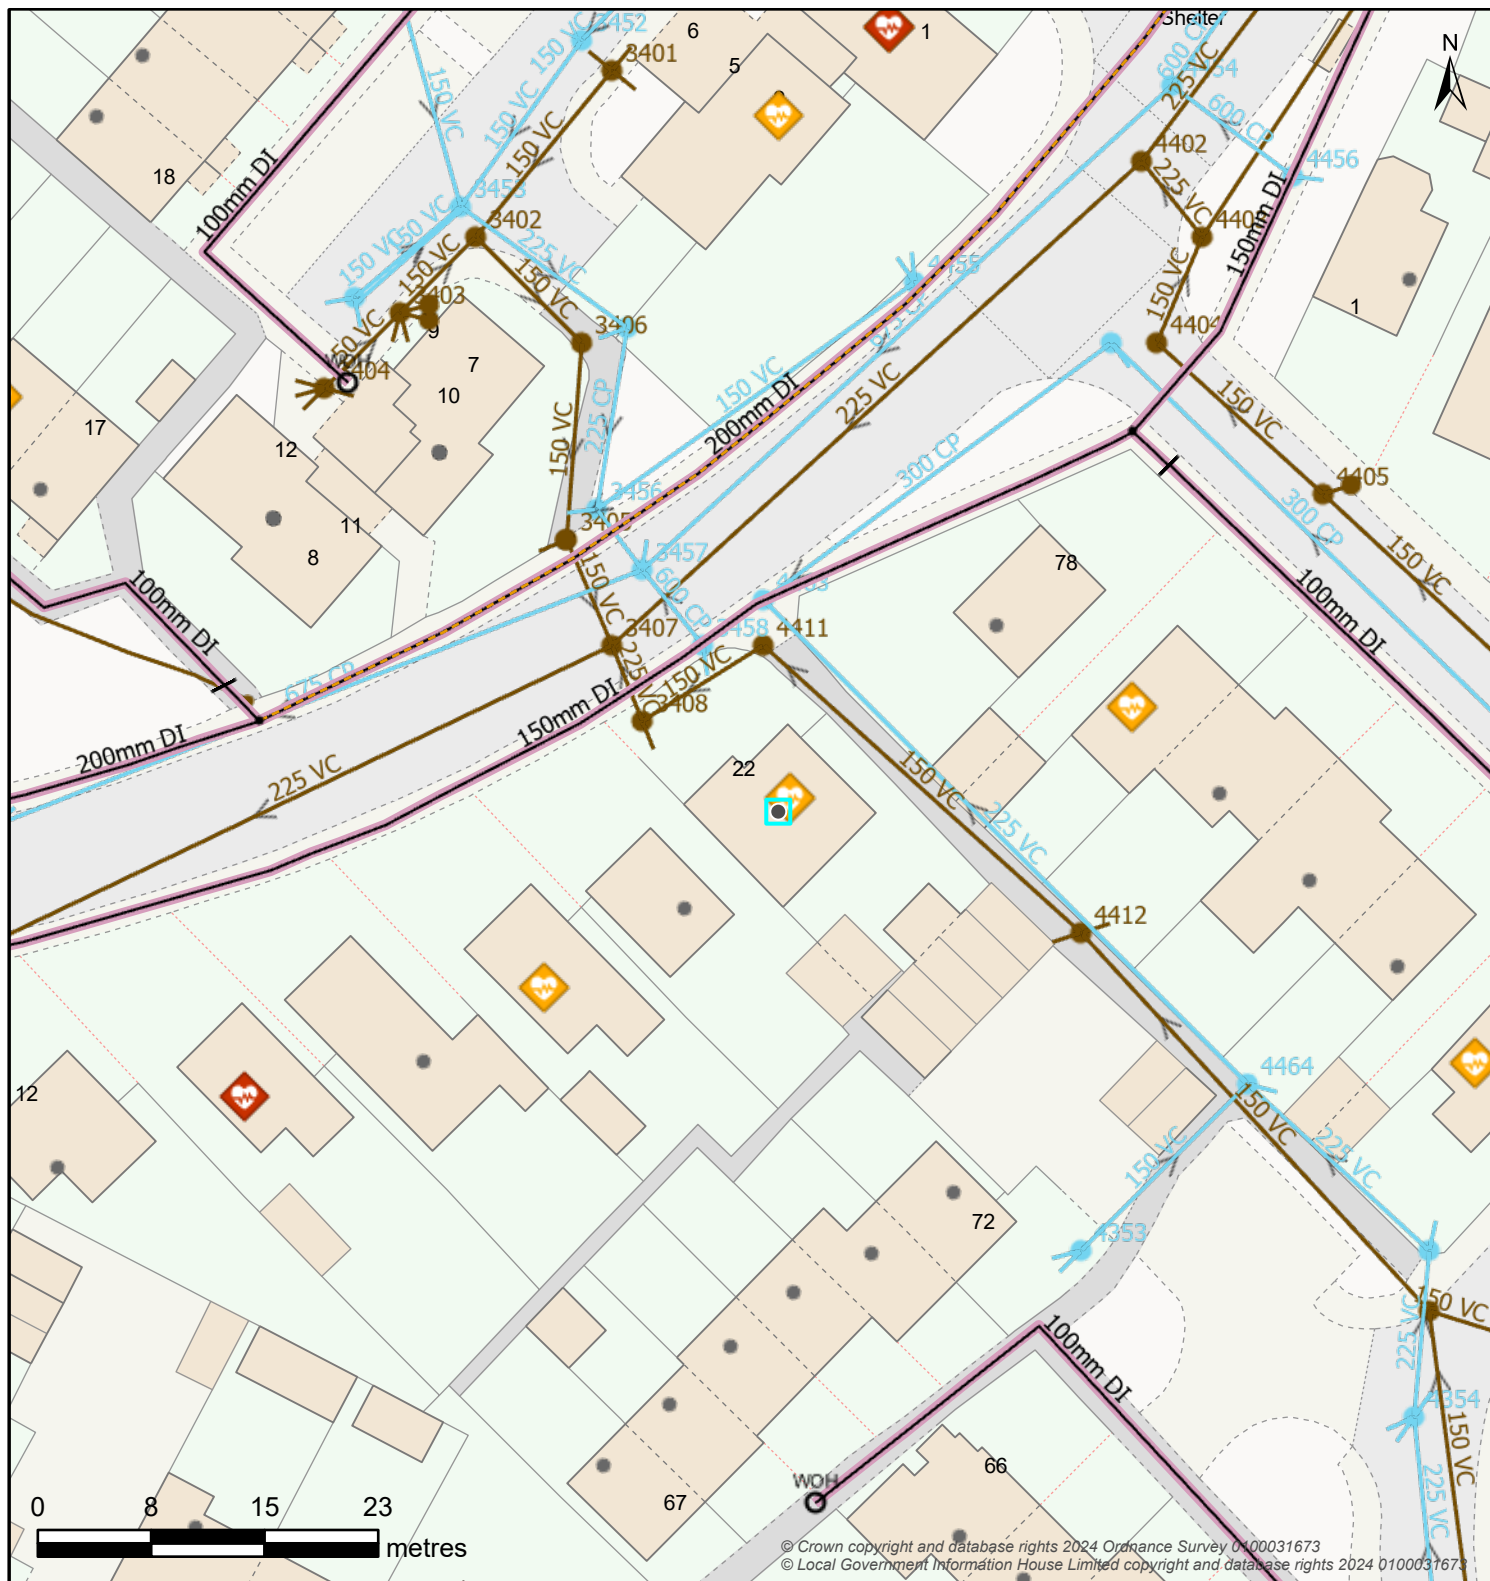

Boundary Box	Break Pressure Tank	Capped End	Hydrant		
Boundary Box	Break Pressure Tank	Capped End	Emptying Plug	Fire Hydrant	Washout Hydrant
Pressure Monitoring	Service Reservoir	Meter	Valve - Controllable		
Logger	Covered	Tower	Meter	Open Valve	Closed Valve
Stop Tap					
Site	Valve - Flow				
Abstraction Point	Supply Works	Air Valve	Non-Return Valve	Washout Empty Valve	
Booster Station	Transfer Station				
Surface Reservoir	Underground Source	Valve - Pressure		Pipe Bridge	
		Pressure Reducing Valve	Pressure Sustaining Valve	Pipe Bridge	
Water Pipe			Water Area		
Communication	Trunk	Decommissioned	Water Supply Zone	District Meter Area	
Distribution	Raw	Discolouration			
Non-Potable	Private				

Map Title: SW Print

Printed By: Kelly.Donaldson

Date Printed: 26/11/2024

Map Scale: 500

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

