

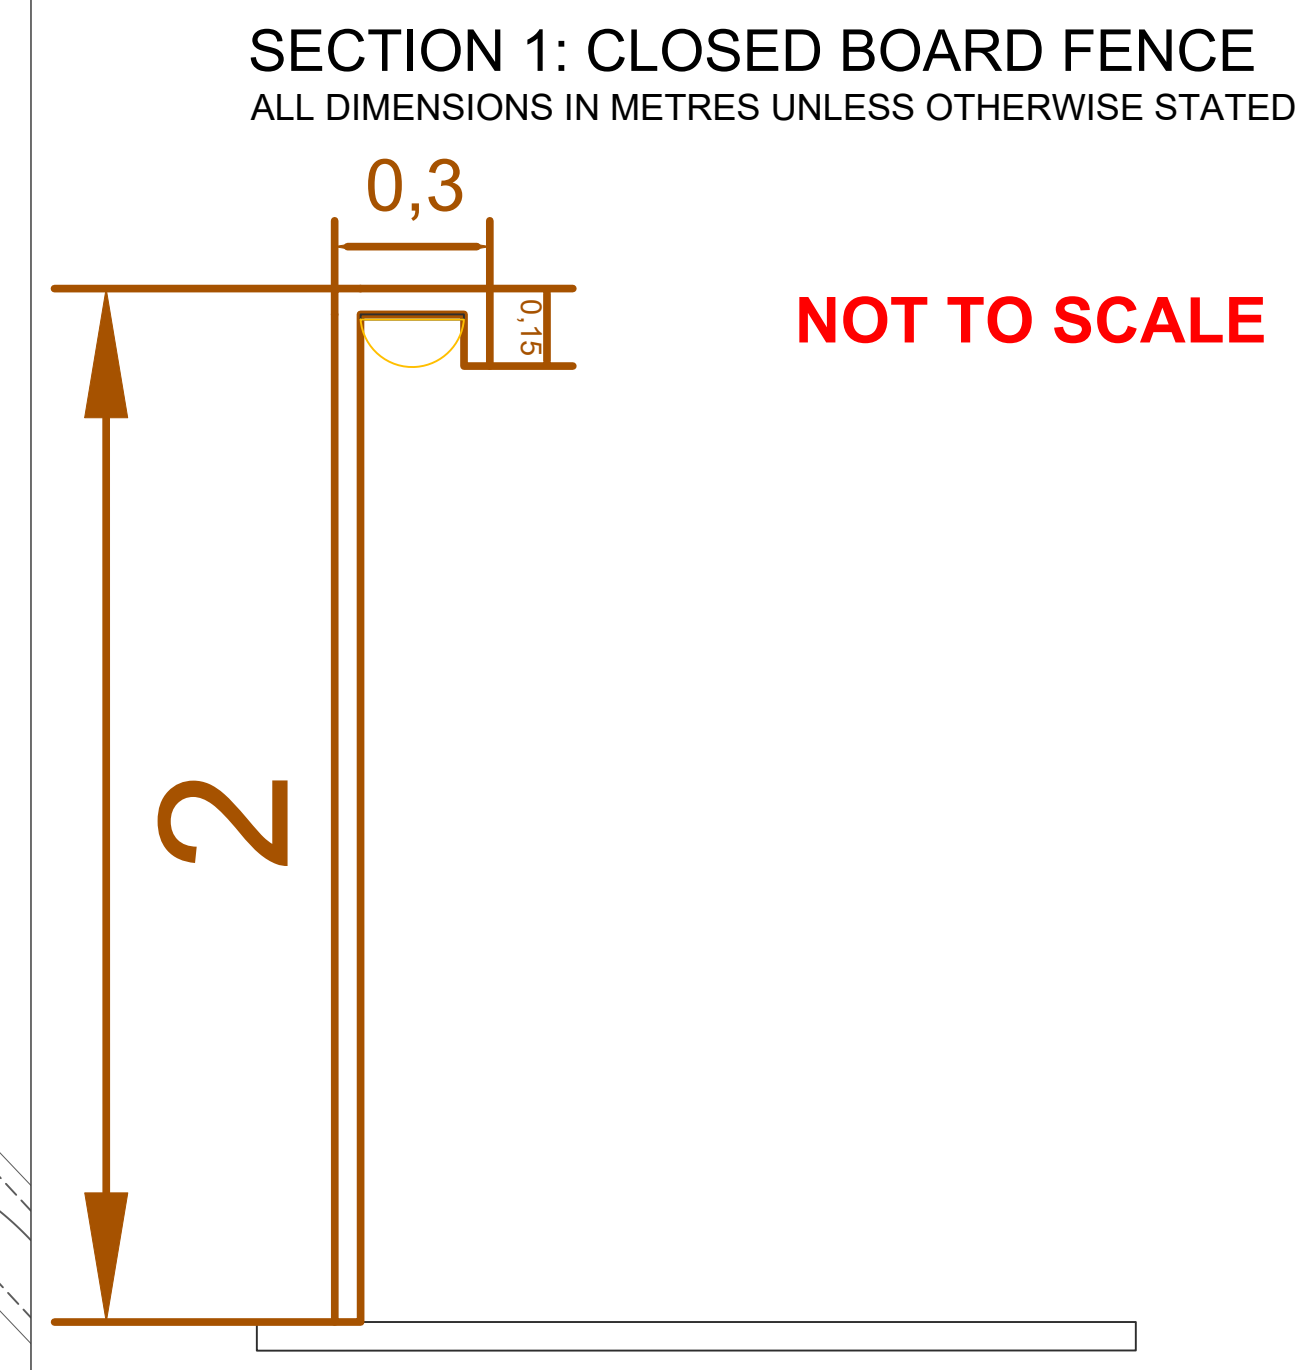


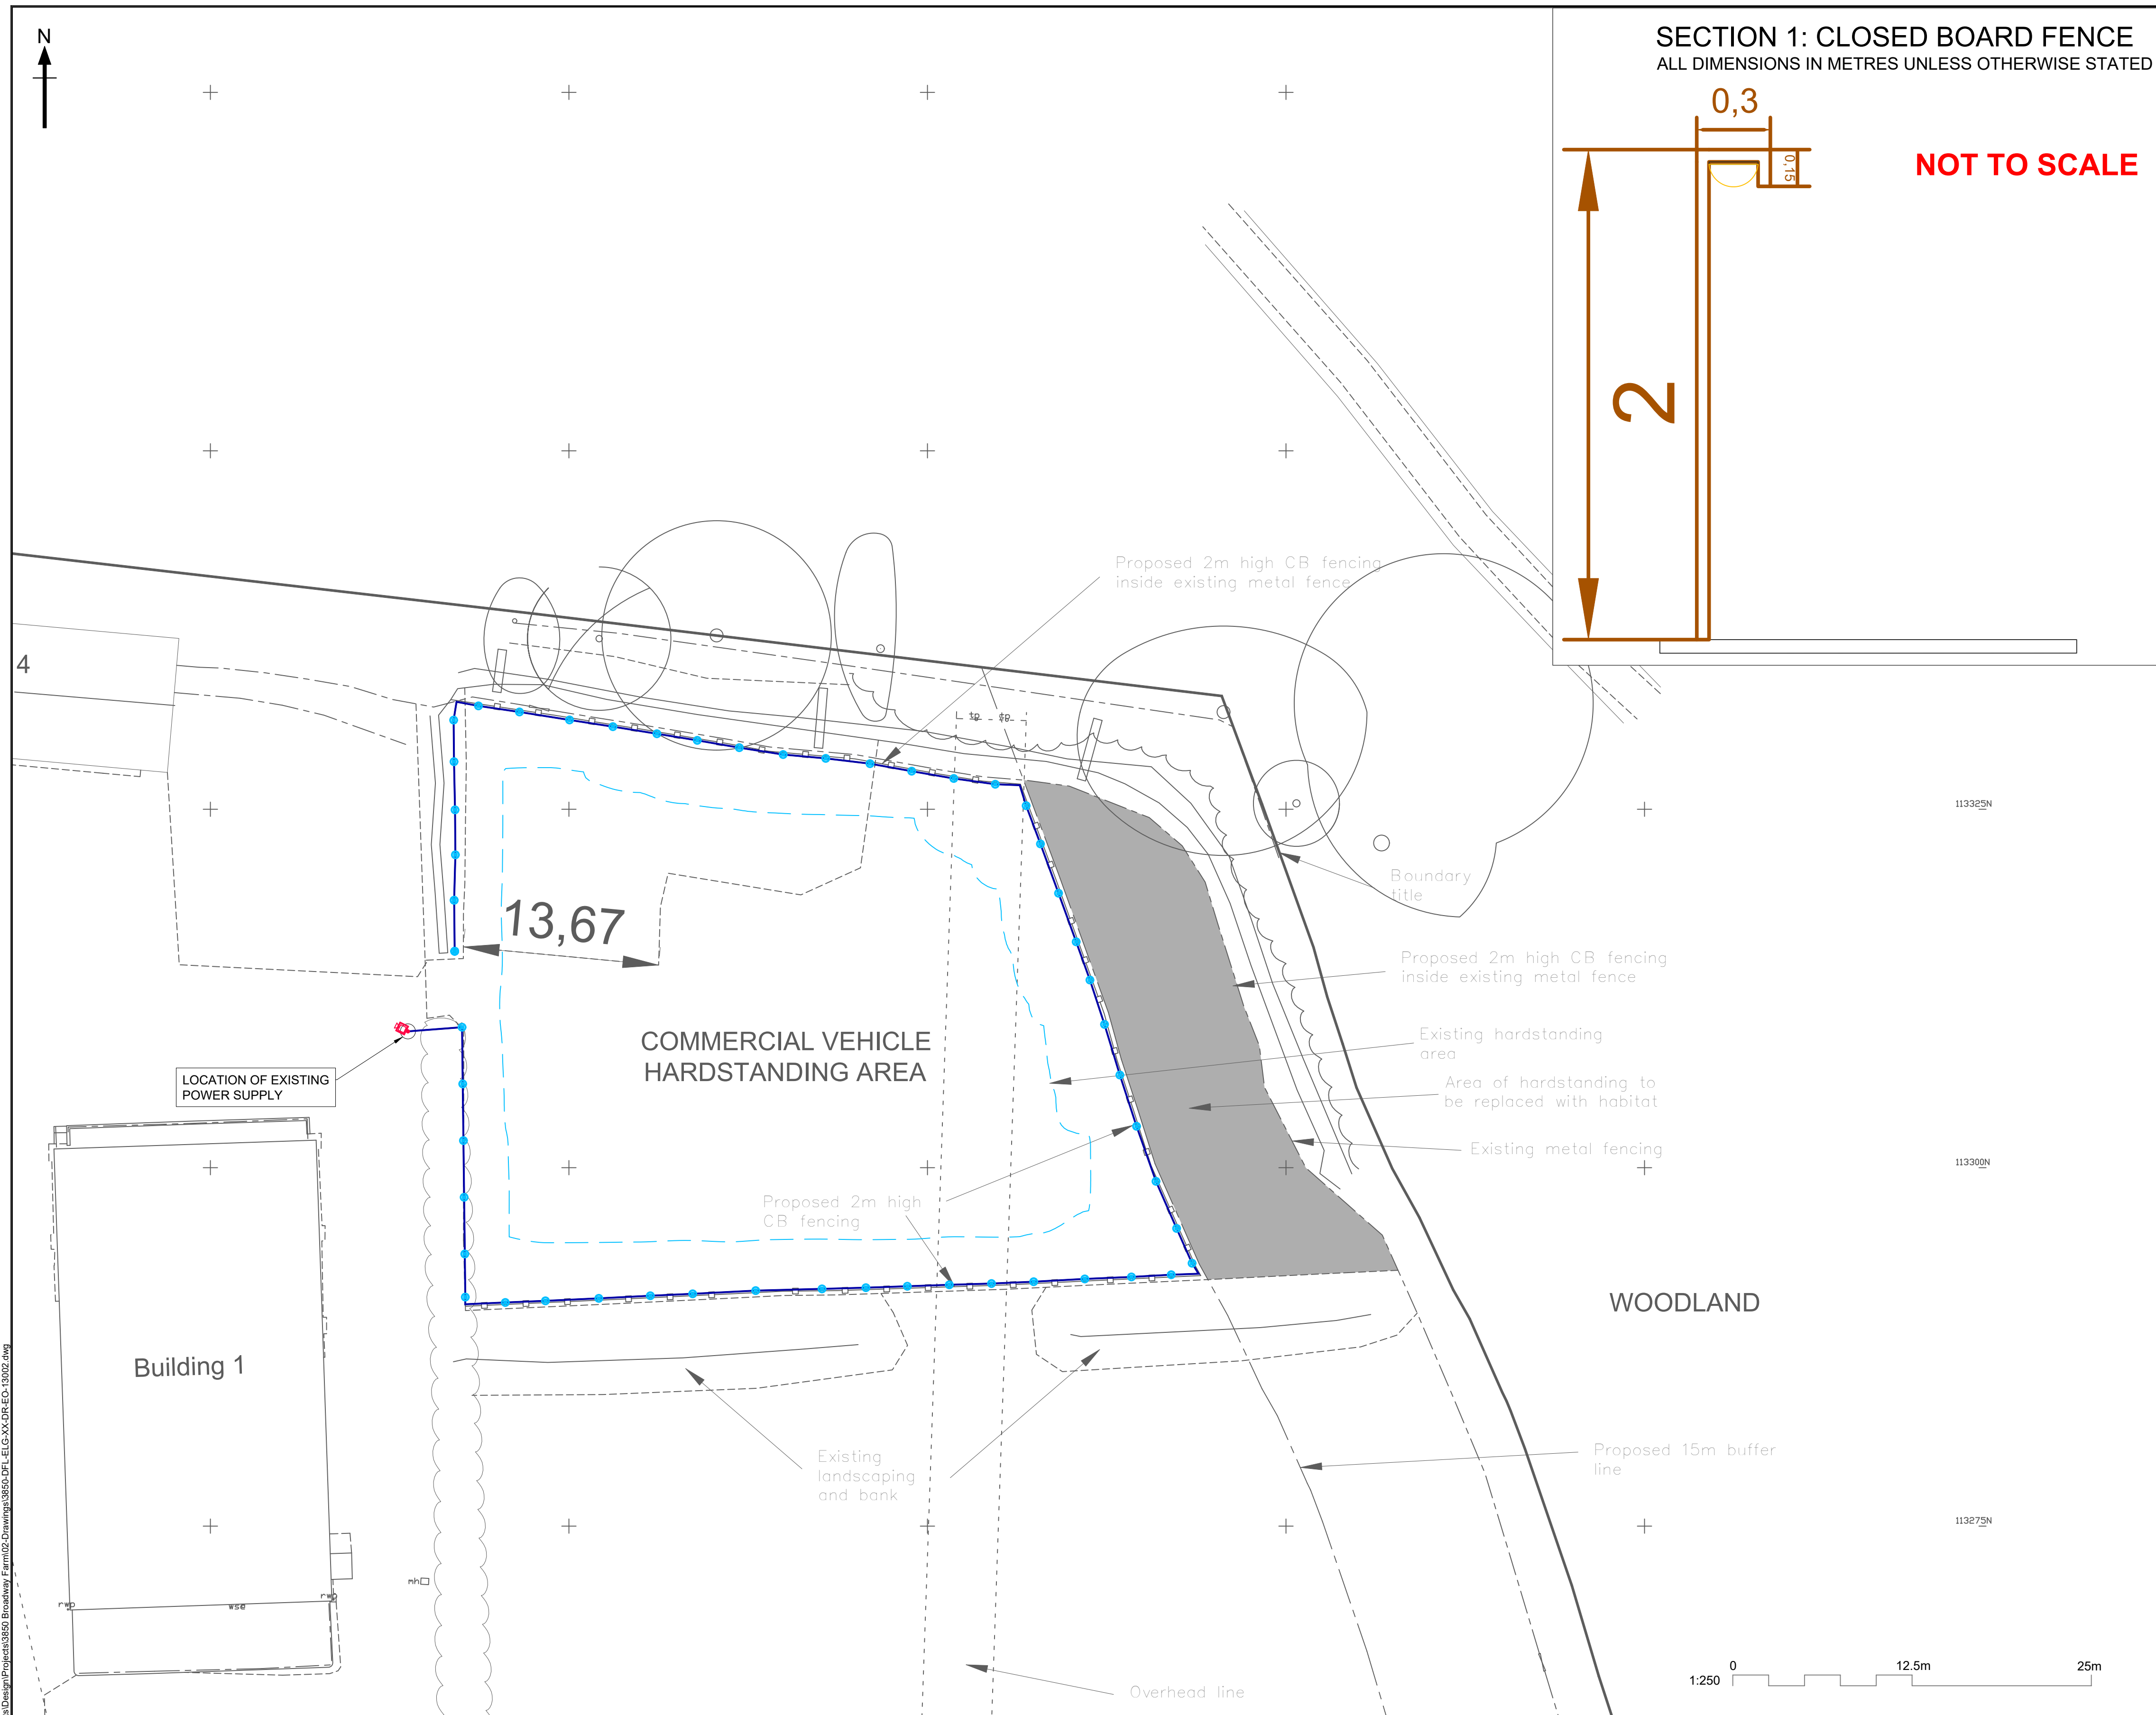

- ## NOTES
1. THIS IS AN AUTOCAD DRAWING AND SHOULD NOT BE AMENDED BY HAND.
 2. THE EXISTING LOCATIONS ARE APPROXIMATE AND THEIR ACCURACY CANNOT BE GUARANTEED.
 3. ALL DIMENSIONS IN METRES UNLESS OTHERWISE STATED.
 4. THIS DRAWING MUST NOT BE SCALED.
 5. DRAWINGS ARE TO BE PRINTED IN COLOUR.
 6. DRAWING TO BE READ IN CONJUNCTION WITH OTHER DESIGN DOCUMENTS:
 - 6.1. 3850-DFL-ELG-XX-TN-EO-13002-S3-P02 - LIGHTING STRATEGY
 7. LUMINAIRE POSITIONS ARE INDICATIVE BASED ON TYPICAL CONSTRUCTION FESTOON - FINAL LUMINAIRE POSITIONS MAY VARY BASED ON THE FINAL PRODUCT USED.
 8. EXISTING PASSIVE INFRARED SENSOR TO BE RETAINED AND INTEGRATED INTO THE NEW LIGHTING SYSTEM.
 9. LUMINAIRES TO BE MOUNTED IN RECESS ON CLOSED BOARD FENCE AS SHOWN IN SECTION 1.
 10. LOCATION OF THE EXISTING POWER SUPPLY IS INDICATIVE. THIS IS TO BE CONFIRMED ON SITE.

KEY:			0
QTY.	SYMBOL	DESCRIPTION	5
1		PROPOSED PASIVE INFRARED SENSOR	10
		PROPOSED CABLE ROUTE	20
		PROPOSED FESTOON LIGHTING	30
		ISOLUX CONTOURS	40
		0.2 LUX ISO-CONTOUR	50

NOT FOR
CONSTRUCTION

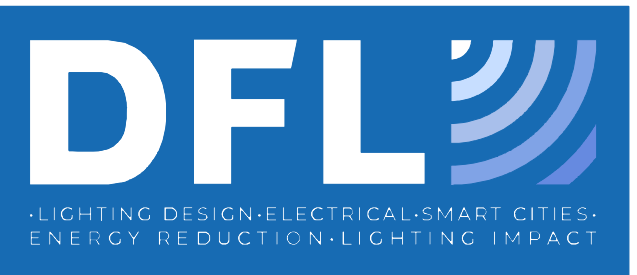

DFL-UK (Designs for Lighting Ltd)
17/18 City Business Centre
Winchester, Hampshire, SO23 7TA
Tel: 01962 855080
Email: info@df-l-uk.com



BROADWAY FARM

OPTION 2 LIGHTING DESIGN ON EXISTING HARD STANDING WITH BUFFER

DESIGNED	CAD	CHECKED	APPROVED
DS	SW	AJB	AJB
ISSUED	SHEET	SCALE	SHEET SIZE
SEP 2025	1 of 1	1:250	A1
DRAWING NUMBER	PROJECT ORIGINATOR		
	3850-DFL-ELG-XX-DR-EO-13002		
JOB NUMBER	STATUS	REVISION	
3850	S3	P01	

S3	P01	FIRST ISSUE	25.09.2025	SW	AJB	AJB
STATUS	REV	AMENDMENT DESCRIPTION	DATE	CAD	CHKD	APPD

PRELIMINARY DESIGN.
LOCATIONS TO BE CHECKED AGAINST STATS PRIOR
TO INSTALLATION.